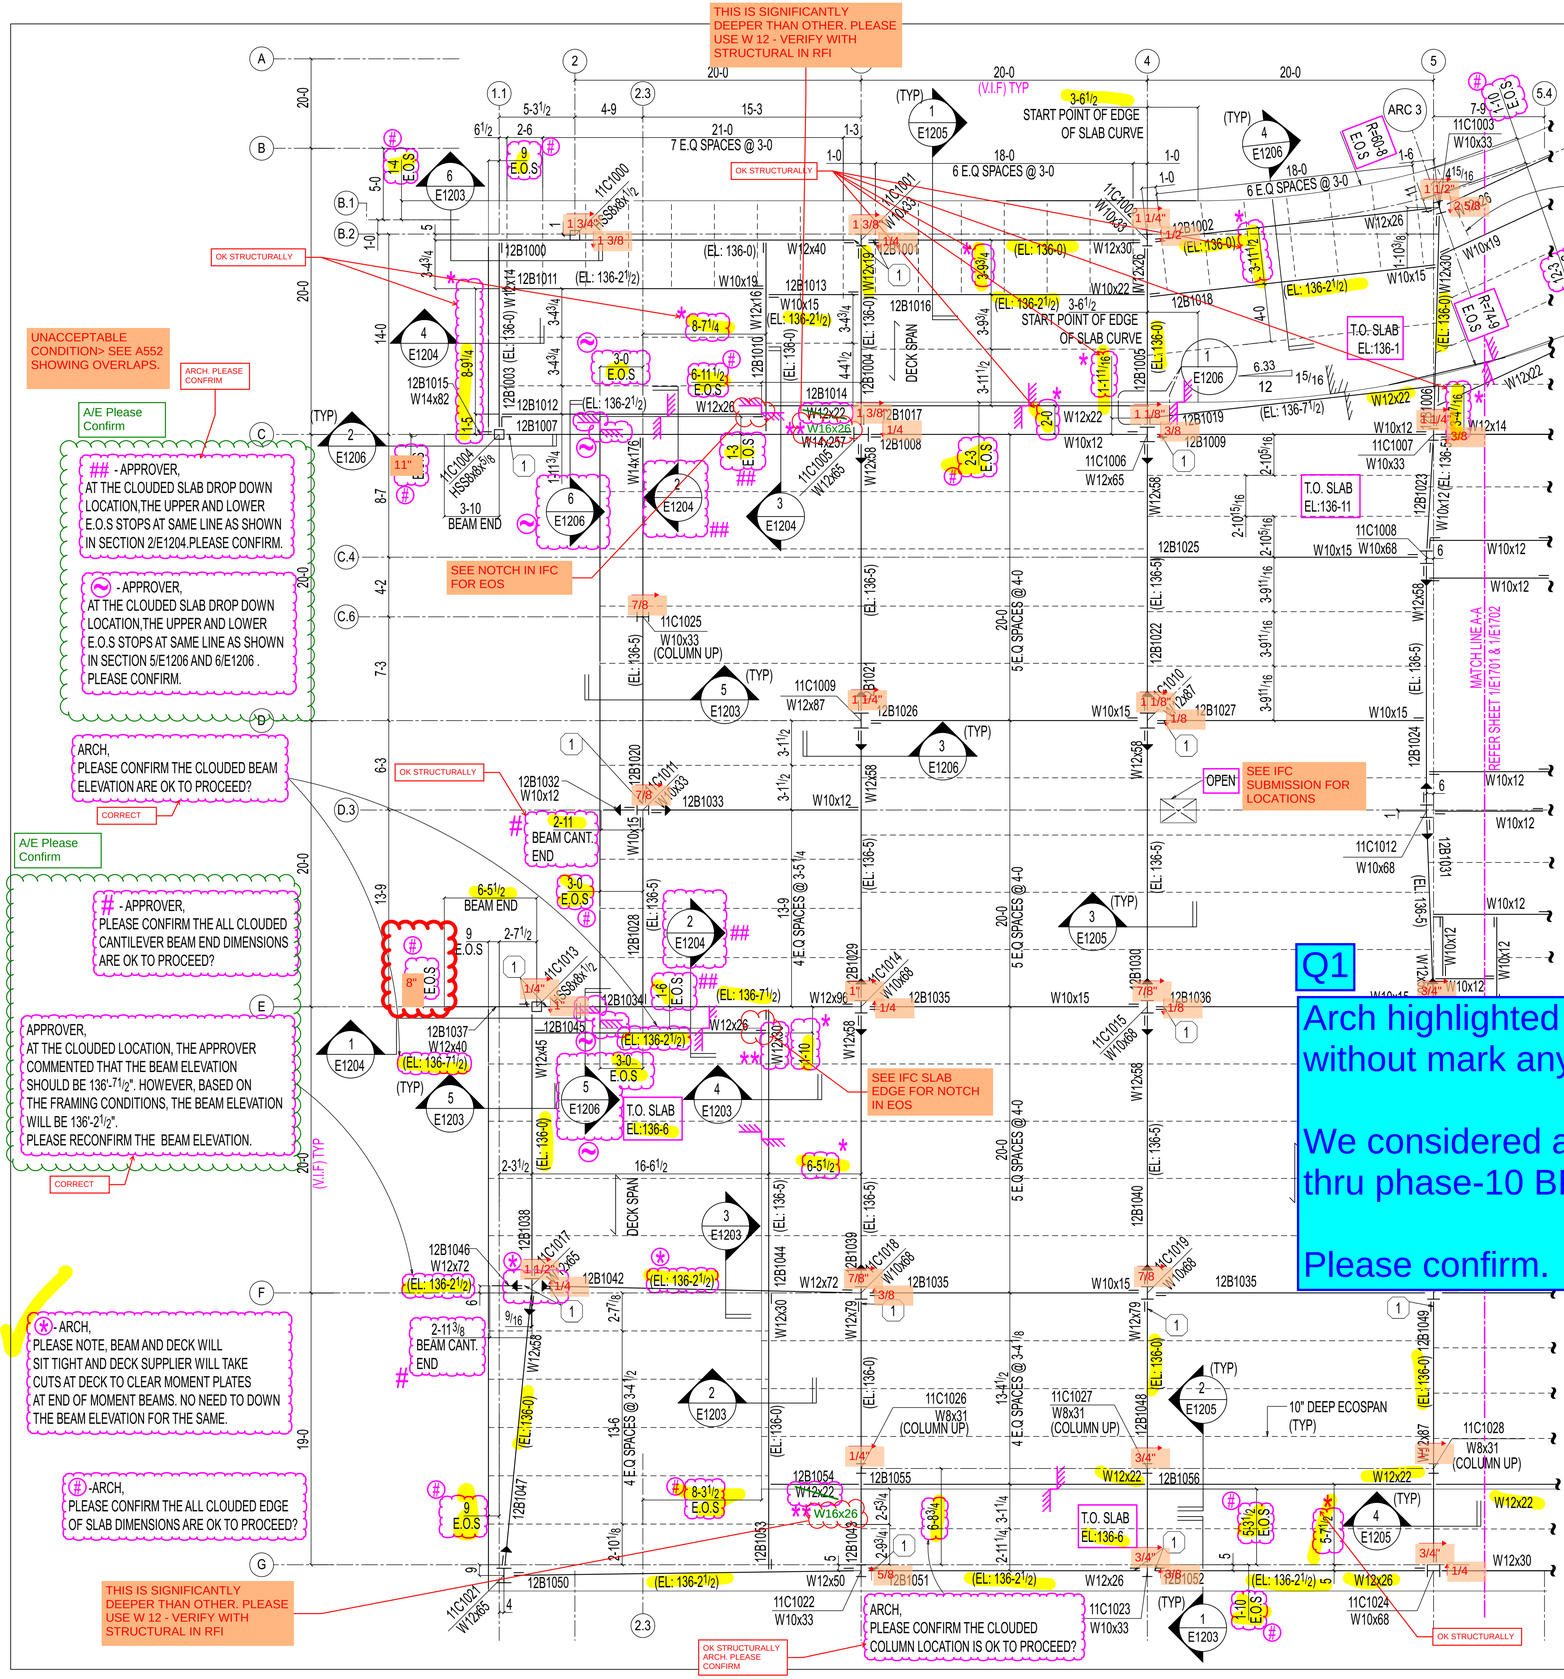

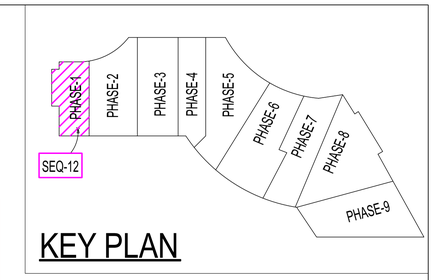

KEY PLAN

BBB GENERAL REVIEW NOTE:

KEY: TYPICAL
-EXISTING COL LOCATION PER VIKA SCAN.
-NEW COLUMN CANNOT EXCEED 1/2" OFF EXISTING COLUMN AXIS.
1 3/4"
1 3/8

A/E Please Confirm

* -APPROVER, AS PER THE APPROVER'S RETURNS COMMENT STATED THAT COORDINATE WITH ARCHITECTURAL SLAB EDGE PLANS FOR BEAM LOCATION. WE HAVE REVIEWED THE 1/A057 SLAB EDGE PLAN BUT WERE UNABLE TO LOCATE SOME OF THE BEAM LOCATIONS. PLEASE CONFIRM WHETHER ALL CLOUDED BEAM LOCATIONS ARE OK TO PROCEED.

** -APPROVER, AS PER THE APPROVER'S RETURNS ARCH COMMENT, WE HAVE CHANGED BEAM SECTION SIZE.PLEASE CONFIRM ALL CLOUDED BEAM SECTION SIZE.

1 / E1201

PARTIAL LEVEL-09 FRAMING PLAN (PHASE-1) (SEQ#12)

(REF: 1/S134_A)

PROJECT NORTH & TRUE NORTH

NOTES:
1.TOP OF SLAB EL: 136'-11" (U.N.O).
2.E.O.S - INDICATES EDGE OF SLAB.
3.▶ - DENOTES MOMENT CONNECTION.
4.ALL FIELD BOLTS SHALL BE 3/4" Ø F1852N TC BOLTS.(U.N.O).
5.ALL GRID DIMENSION TO BE VERIFY IN FIELD.(U.N.O).
6.⟷ - INDICATES METAL DECK SPAN ORIENTATION DIRECTION.
7.ALL ELEVATION SHOWN FOR TOP OF BEAM (U.N.O).
8. DENOTES SLAB DEVIATION.
9.ALL JOIST TO BE 10" DEEP ECOSPAN COMPOSITE FLOOR JOIST.(U.N.O).
10.TOP OF STEEL EL: 136'-7 1/2".(U.N.O).
11.ALL FIELD BOLTS SHALL BE SNUG TIGHTENED.U.N.O.

Q1

Arch highlighted most of our queries/clouded items in yellow without mark any comments.

We considered all yellow highlighted items by arch from Phase-1 thru phase-10 BFA sheets as OK to proceed.

Please confirm.

	DATE
	Mar 15 2025
	May 27 2025

LEGEND:
TYP - TYPICAL
V.I.F - VERIFY IN FIELD
E.O.S - EDGE OF SLAB
U.N.O - UNLESS NOTED OTH
EL. - ELEVATION
T.O. - TOP OF

STEEL FAB ENTERPRISES, LLC
AISC CERTIFIED FABRICATOR AND ERECTOR
MISCELLANEOUS METALS FABRICATOR AND ERECTORS
623 BAUMGARDNER ROAD, LANCASTER, PA 17603
TEL. (717)464-0330 FAX (717)464-9464
WWW.STEELFABENTERPRISES.COM

DINGS 1 LP.

SHINGTON, DC 20024

SK#20
One page
One Query
Date: 06-27-2025

PROJ. NO. :	25001	REV # B
DWG NO. :	E1201	

PLAN (PHASE-1) (SEQ#12)