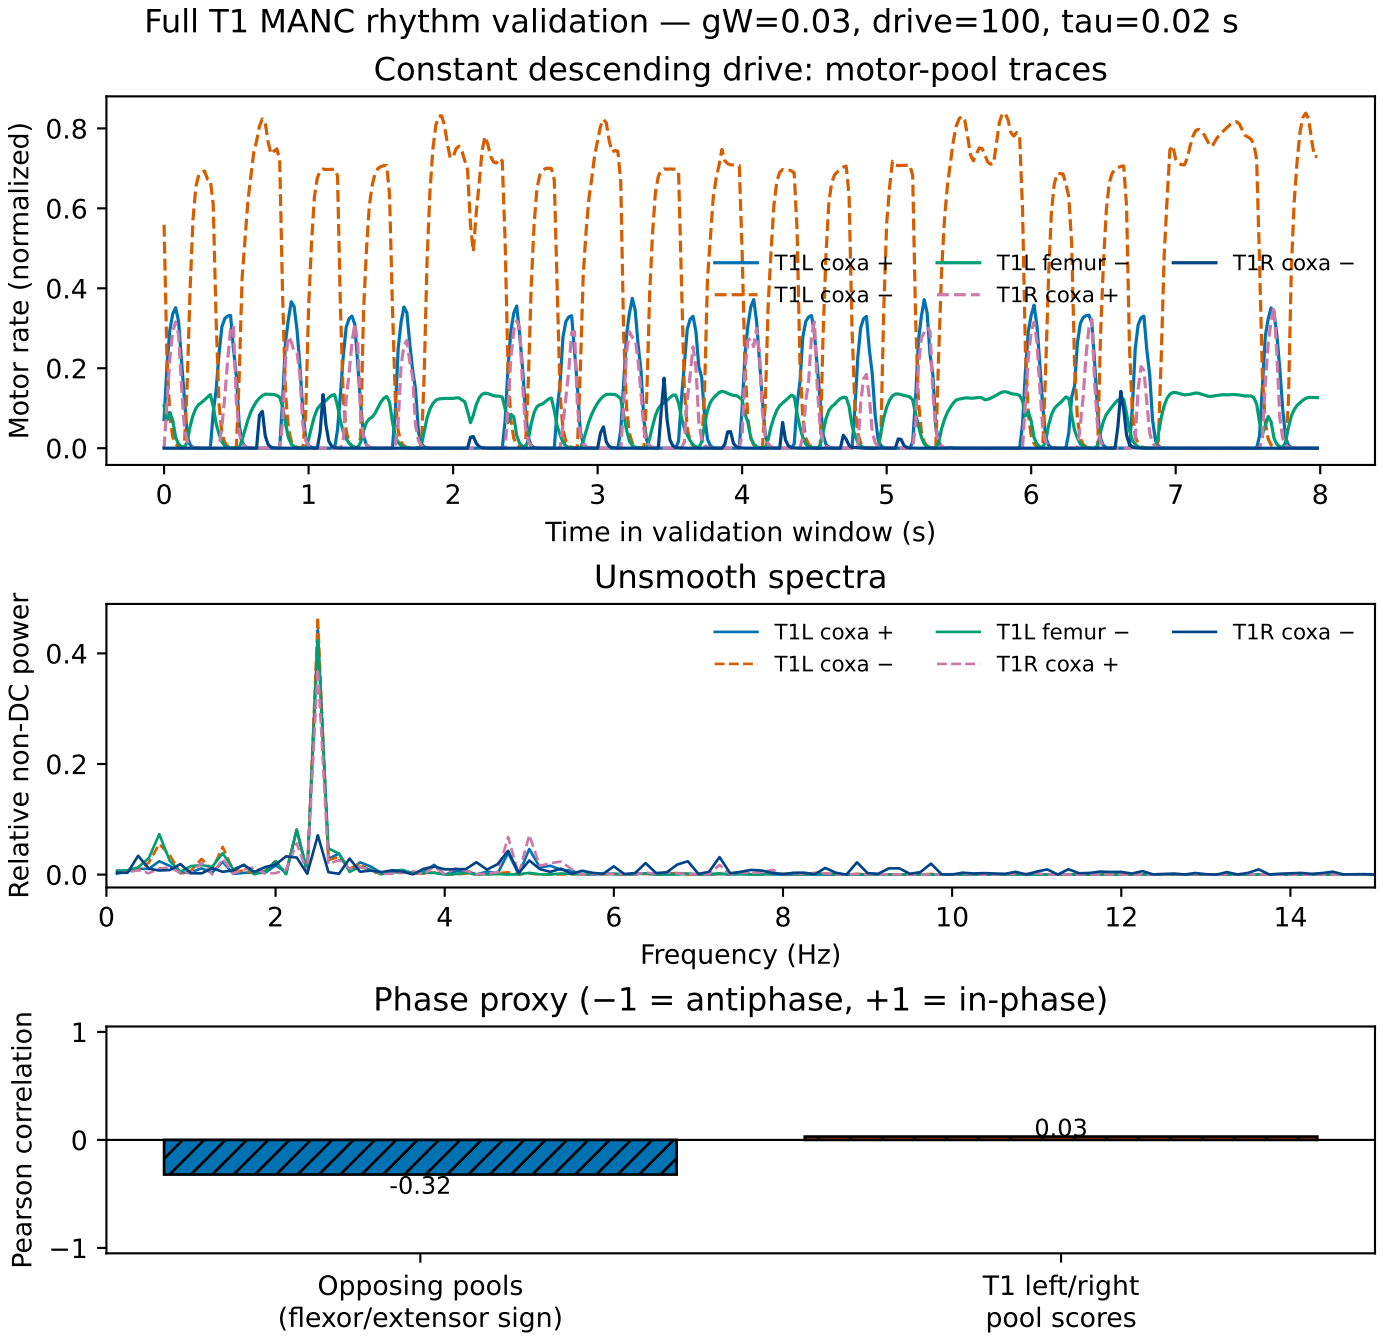
Full T1 MANC rhythm validation — gW=0.03, drive=100, tau=0.02 s
Constant descending drive: motor-pool traces
Motor rate (normalized)
Time in validation window (s)
T1L coxa +
T1L coxa −
T1L femur −
T1R coxa +
T1R coxa −
Unsmooth spectra
Relative non-DC power
Frequency (Hz)
Phase proxy (−1 = antiphase, +1 = in-phase)
Pearson correlation
-0.32
0.03
Opposing pools
(flexor/extensor sign)
T1 left/right
pool scores