

Strategy. One ultra-premium master carton, printed with brand artwork only — oversized gold foil shield and wordmark. All product identification and COA verification are applied post-print as labels into dedicated uncoated, varnish-free knockout zones. One box, four blister inserts: single 10 ml, double 10 ml, 10 ml + 3 ml, and 3 × 3 ml.

1 — COLOUR, LOCKED FOR PRINT

BASE
Forest Green PMS 5535 C
HEX #22372C
CMYK 78, 47, 71, 60
Pantone 5535 C

FOIL
Metallic Gold
Hot foil PMS 871
Flat proxy #C9A227
Shield, wordmark, rules

LABEL STOCK
Pure Matte Black
HEX #17170F
CMYK 0, 0, 0, 100
Carton label base only

KNOCKOUT
Uncoated Zone
No varnish, no laminate
Front label + QR only
Bare board or base ink

To the printer: ignore any washed-out colour on the digital proof. Print the base at exactly CMYK 78, 47, 71, 60 (Pantone 5535 C)— deep and fully saturated, no pastel, no tint, 100% opacity. Supply all files CMYK, never RGB. The two knockout zones must be 100% uncoated and varnish-free so label adhesive bonds permanently.

2 — MATERIALS & FINISHES

BOARD	18pt SBS, solid bleached sulfate
OUTER COAT	Velvet soft-touch matte lamination
TACTILE	Raised spot UV over pattern, off knockouts
CLOSURE	Gold foil tamper-evident seal over top tuck
INSERT	Thermoformed PET blister, black or clear
LABEL STOCK	Waterproof matte BOPP, permanent

3 — TYPOGRAPHY, MATCHED TO THE LOGO

Aa Bb Cc

Montserrat — Black / Bold

Wordmark, product names, headings.
Geometric grotesque matching the logo
lettering. Uppercase, tracking +2%.

Aa Bb Cc

Barlow / Barlow Condensed

Generic name, concentration, volume,
warnings, lot and expiry. 5.5 pt minimum on
the vial label.



Two changes from the earlier spec. Inner width goes 44 → 49 mm and depth 22 → 24 mm: a double-vial PET tray needs 48 mm of width alone — two Ø 22.4 mm cavities plus the wall between and outboard of them. The wider 49 mm front and back panels also let the 30 × 20 mm QR sticker land with generous clearance a side.

3 mm bleed beyond every cut line. All foil and copy 3 mm inside cut and fold lines. Knockout zones carry no varnish and no soft-touch laminate. Final production dieline to be issued by the converter and matched to this layout.


PANEL COPY, AS BUILT

FRONT	Wordmark above shield, foil. 40 × 22 mm knockout.
BACK	Blank base ink. 27 × 17 mm QR knockout only — no printed copy.
SIDES	ARCTOS LABS, vertical, foil, 8 pt. Both sides identical — no research-use line, no web address.

FRONT PANEL · 49 × 64 MM



BACK PANEL · 49 × 64 MM

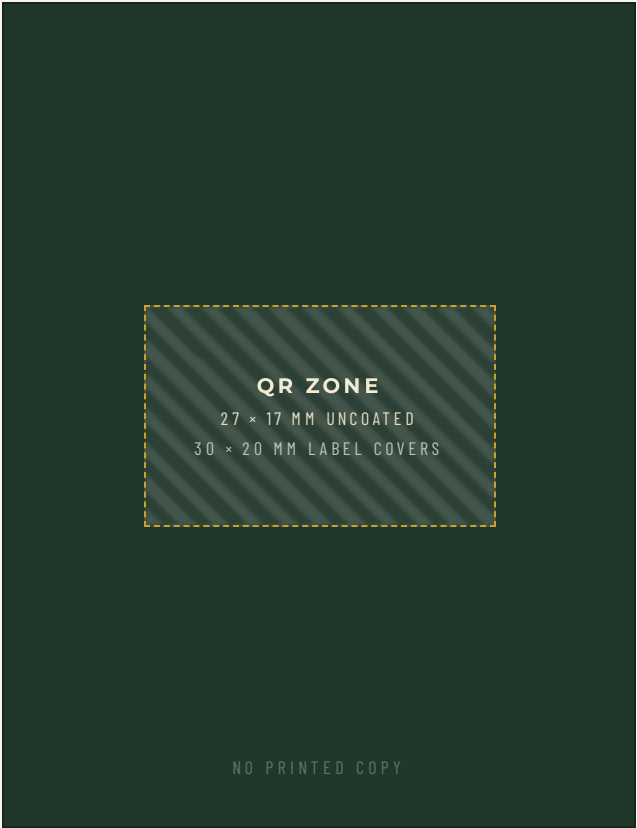

SHIELD SCALE

Supplied lockup, split: ARCTOS LABS wordmark set large above the bear-and-shield, 40 mm wide, 3 mm from the top cut. Shield below at 27.5 mm tall × 23.2 mm wide, clearing the knockout by 3 mm. Both gold foil, centred, no outline, no containing box.

FRONT LABEL ZONE

40 × 22 mm, not the 60 × 25.4 mm from the earlier spec – 60 mm cannot fit a 49 mm panel. The 60 × 25.4 mm size stays for the vial. Zone sits 3 mm above the bottom cut.

QR ZONE


27 × 17 mm uncoated area, centred on the back panel. The 30 × 20 mm Niimbot B2 Pro label overhangs it by 1.5 mm all round, so no printed edge shows.

BACK PANEL IS BLANK

Base ink only, plus the knockout. No scan instruction, no research-use line, no compound copy, no barcode – that wording is printed into the QR sticker at pack time. Packages are hand loaded, so the applied QR carries batch and COA.

BOTH SIDE PANELS IDENTICAL — ARCTOS LABS ONLY, VERTICAL, GOLD FOIL, 8 PT (ENLARGED 50%)

A · VIAL LABEL · 60 × 25.4 MM · ACTUAL SIZE

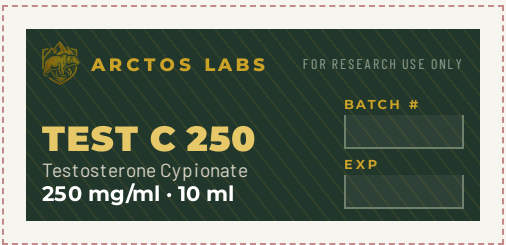

HAND-WRITE FIELDS

Batch # and Exp are stacked vertically at the right edge, each a 16 × 4 mm open box on bare label stock — sized for four digits in fine permanent marker. No printed rule inside the box, so ink is not fighting foil.


TYPE, SCALED UP

Product name now 17.5 px / ~4.6 mm cap height on one line, wordmark 9 px, strength line 10.5 px — the label fills to the 2 mm safe margin on all four sides. Dashed frame = 3 mm bleed all round.

FINISHING & FIT


Waterproof matte BOPP on Forest Green PMS 5535 C base — matches the carton, not the black carton label. Bear-and-shield mark, wordmark and type in gold foil; raised spot UV over the background pattern only — never over type. 10 mL / 22 mm vial, 69 mm circumference: 60 mm leaves a 9 mm fill window. Sits 4 mm above the base.

B · CARTON PRODUCT LABEL · 40 × 22 MM · 1.6×

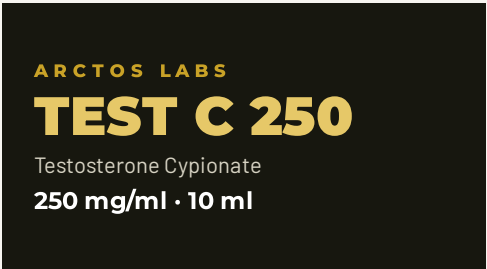

Matte black BOPP, gold foil lettering, soft-touch laminate. No shield — the carton already carries it. Applied into the front knockout zone.

C · QR LABEL · 30 × 20 MM · 1.6×

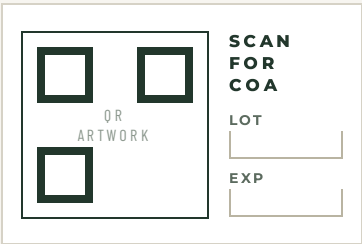

Thermal direct, Niimbot B2 Pro, 30 × 20 mm — the size already in use for 3 ml vials. Quiet zone ≥ 2 mm. This sticker carries the scan-for-COA wording; the carton back stays blank. Lot and expiry stacked, hand-written or printed.

Both trays are thermoformed PET at the same 48 × 23 mm × 62 mm deep footprint and drop into the same master carton. Only the cavity count changes, so a single carton SKU covers single and double vial products. Two further promotional inserts are specified on page 6.

SINGLE VIAL TRAY · CAVITY 1 ONLY · PLAN 48 × 23 MM



DOUBLE VIAL TRAY · 2 CAVITIES · CENTRES 23.4 MM APART



Plan views at 2×, looking down into the tray. Cavity depth 50 mm and 3° draft are not shown — see the table. One tool serves both trays: the single-vial version blanks off cavity 2, so cavity 1 keeps the same off-centre position in both.

MATERIAL	0.35 mm thermoformed PET, black or clear
FOOTPRINT	48 × 23 mm × 62 mm deep
CAVITY	Ø22.4 mm × 50 mm deep, 3° draft
RETENTION	Three friction ribs per cavity, 0.4 mm proud
PURPOSE	Friction-fits vials — no rattle, no breakage in transit
CAVITY SPACING	23.4 mm centres · 1.0 mm wall between · 1.1 mm outboard


Why 49 × 24 mm inner. Across the tray: 1.1 + 22.4 + 1.0 + 22.4 + 1.1 = 48 mm. The earlier 44 × 22 mm inner was physically impossible for a double vial. 49 × 24 mm takes the tray with clearance and serves both versions from one carton.

TOP CLOSURE & PREPRESS CHECKLIST

Tamper seal Gold foil tamper-evident seal, 12 × 40 mm, wraps the top tuck flap onto the front and back panels. Destructive-face stock so it tears on opening.	Knockouts Front 40 × 22 mm rectangle and back 27 × 17 mm area: no varnish, no soft-touch laminate, no spot UV. Adhesive must bond to the printed base directly.	Files to supply CMYK dieline with separate layers for base ink, foil, spot UV, varnish-free mask and die cut. 3 mm bleed. Fonts outlined.
--	--	--

Four inserts total, all thermoformed from the same 0.35 mm PET into the same 48 × 23 × 62 mm shell. The 24 mm carton depth allows one row of cavities only, which caps a mixed bundle at 10 ml + one 3 ml upright; three 3 ml vials clear the 48 mm width only by lying down in stacked cradles.

TRAY 3 · 1 × 10 ML + 1 × 3 ML · PLAN 48 × 23 MM

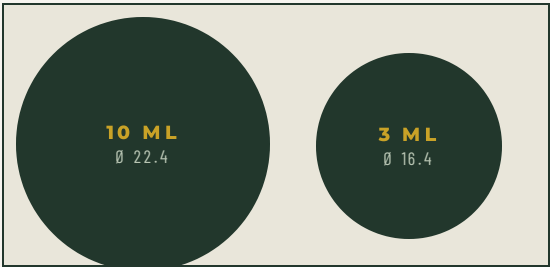

Across the plan: 1.1 + 22.4 + 4.0 + 16.4 + 4.1 = 48.0 mm, the spare width taken up as thicker walls for retention. Both vials stand upright; the 3 ml cavity floor steps up 17 mm so both necks finish level for easy pick-out. A second 3 ml cannot join them — see the matrix.

TRAY 4 · 3 × 3 ML · ELEVATION 48 × 62 MM



Three vials standing side by side would need 53.4 mm across a 48 mm tray, so all three lie flat in half-round cradles, caps alternating left-right for even wall thickness. 37 mm cradle length in 48 mm of width leaves 5.5 mm a side. Cradles are half-round with 0.4 mm friction ribs at each end and a 6 mm finger relief at the cap end, so a vial lifts out without tools.

FIT MATRIX · 49 × 24 × 64 MM INTERIOR

INSERT	SPACE NEEDED	
Tray 1 — 1 × 10 ml	24.6 mm wide	FITS
Tray 2 — 2 × 10 ml	48.0 mm wide	FITS
Tray 3 — 10 ml + 1 × 3 ml	45.0 mm wide	FITS
Tray 4 — 3 × 3 ml	37 × 52.2 mm	FITS
10 ml + 2 × 3 ml upright	59.4 mm wide	NO
3 × 3 ml upright	53.4 mm wide	NO
4 × 3 ml, any layout	70.8 mm wide	NO

Why not 10 ml + 2 × 3 ml. Three upright cavities need 59.4 mm across a 48 mm tray, and laying the pair down fails too — a flat 3 ml is 37 mm long against a 22.4 mm lane, while a full-width cradle tier needs 17.4 mm of depth against the 10 mm the 52 mm vial leaves. That bundle needs a 60 × 24 × 64 mm carton, a second SKU on request.

Confirm before tooling: all 3 ml geometry assumes a 2R vial, Ø 16 × 35 mm with cap; a diameter over 17.5 mm drops tray 4 to two cradles.

Two tools, four inserts

Trays 1-3 share the upright tool, blanking off or resteping one cavity. Tray 4 needs a second tool for the cradle form — shell, flange and 3° draft carry over unchanged, so every insert drops into the same carton and uses the same tamper seal.