

Customer: Stark Truss


SID:

TID:

Date: 01 / 16 / 23

Page: 1 of 1

Truss Mfr. Contact: System Administrator

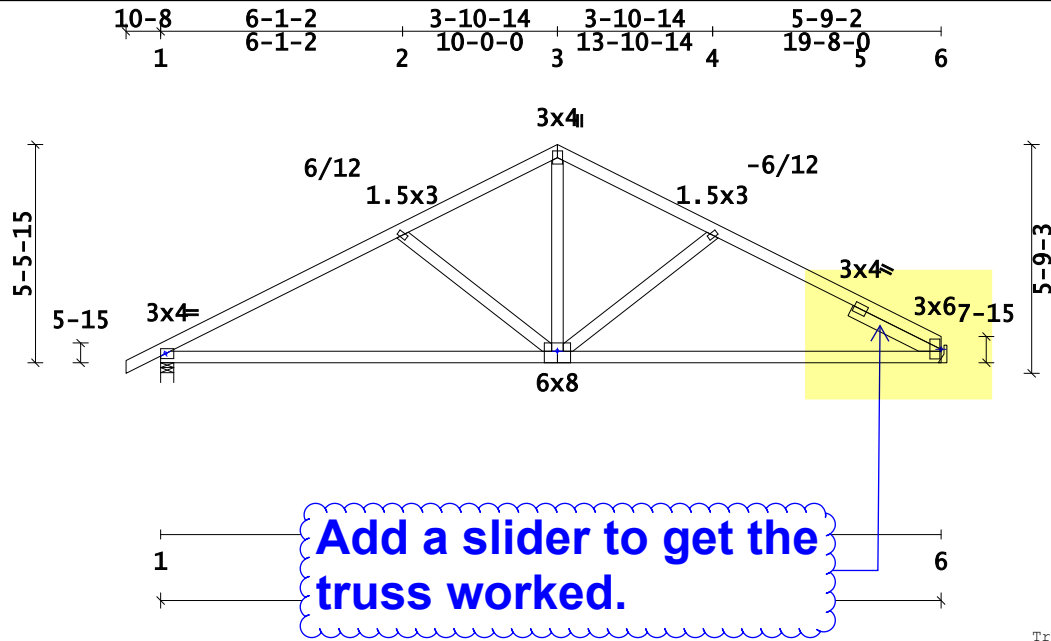

Truss Weight = 89.4 lb

Code/Design: IRC-2015/TPI-2014
PSF Live Dead Dur Factors
TC 20.0 10.0 Live Wind Snow
BC 0.0 10.0 Lum 1.15 1.60 1.15
Total 40.0 Plt 1.15 1.60 1.15
Spacing: 2-00-00 o.c. Plies: 1
Repetitive Member Increase: Yes
Green Lumber: No Wet Service: No
Fab Tolerance: 20% Creep (Kcr) = 2.0
OH Soffit Load: 2.0 psf

-----Snow Load Specs-----
ASCE7-10 Ground Snow (Pg) = 20.0 psf
Risk Cat: II Terrain Cat: C
Roof Exposure: Partially Exposed
Thermal Condition: Cold Ventilated(1.1)
Unobstructed Slippery Roof: No
Low-Slope Minimums(Pfmin): No
Unbalanced Snow Loads: Yes
Rain Surcharge: No Ice Dam Chk: Yes
Lu(max) = 20-00-00

-----Wind Load Specs-----
ASCE7-10 Wind Speed (V) = 115 mph
Risk Cat: II Exposure Cat: C
Bldg Dims: L = 36.0 ft B = 36.0 ft
M.R.H(h) = 15.0 ft Kzt = 1.0
Bldg Enclosure: Enclosed
Wind DL(psf): TC = 5.0 BC = 5.0
End Vertical Exposed: L = Yes R = Yes
Wind Uplift Reporting: ASCE7 MWFRS
C&C End Zone: 4-00-00

-----Additional Design Checks-----
10 psf Non-Concurrent BCLL: Yes
20 psf BC Limited Storage: Yes
200 lb BC Accessible Ceiling: No
300 lb TC Maintenance Load: No
2000 lb TC Safe Load: No
Unbalanced TCLL: Yes

Material Summary

TC	2x4	SP (ALSC6-2013)	#2
BC	2x4	SP (ALSC6-2013)	#2
Webs	2x4	SP (ALSC6-2013)	#3/Stud
Slider	2x4	SP (ALSC6-2013)	#3/Stud

Member Forces Summary

Max CSI in TC PANEL	1 - 2	0.35
Max CSI in BC PANEL	1 - 7	0.86
Max CSI in Web	5 - 6	0.26

...	Mem...	Ten	Comp	CSI.
TC	OH- 1	25	0	0.06
	1- 2	483	1203	0.35
	2- 3	397	917	0.28
	3- 4	412	914	0.25
	4- 5	492	1128	0.27
	5- 6	427	1080	0.18
BC	1- 7	1005	358	0.86
	6- 7	980	335	0.83
Web	2- 7	258	339	0.17
	3- 7	556	198	0.23
	4- 7	240	313	0.16
	5- 6	66	88	0.26

Reaction Summary

-----Reaction Summary(Lbs)-----
Jnt --X-Loc- React -Up- --Width- -Regd -Mat PSI
1 02-03 849 89 04-00 01-08 SPF 531
6 19-07-04 781 75 01-08 HGR SPF 565
Max Horiz = -90 / +106 at Joint 1

Loads Summary

This truss has been designed for the effects of an unbalanced top chord live load occurring at [10-00-00] using a 1.00 Full and 0.00 Reduced load factor.

See Loadcase Report for loading combinations and additional details.

Notes

Plates designed for Cq at 0.80 and Rotational Tolerance of 10.0 degrees
Plates located at TC pitch breaks meet the prescriptive minimum size requirement to transfer unblocked diaphragm loads across those joints.
Designed with hybrid plate values. See TD-SUB-0001 for info.

Deflection Summary

TrussSpan	Limit	Actual(in)	Location
Vert LL	L/360	L/999(-0.18)	1- 7
Vert DL	L/120	L/999(-0.18)	1- 7
Vert CR	L/240	L/646(-0.36)	1- 7
Horz LL	0.75in	(0.02) @Jt 6	
Horz CR	1.25in	(0.03) @Jt 6	
Ohng CR	2L/240	2L/999(-0.00)	1- 1

Bracing Data Summary

-----Bracing Data-----
Chords; continuous except where shown
Web Bracing -- None

Plate offsets (X, Y):

(None unless indicated below)
Jnt1(00-08,0), Jnt7(0,-00-08),
Jnt6(-01-14,00-01)

Customer: Stark Truss


SID:

TID:

Date: 01 / 16 / 23

Page: 1 of 1

Truss Mfr. Contact: System Administrator

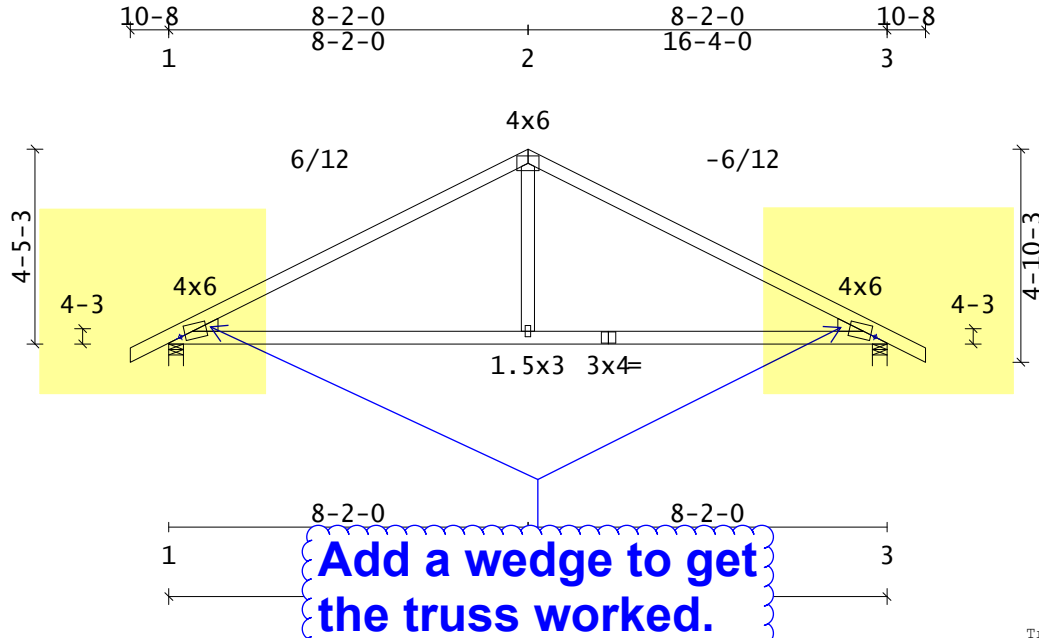

Truss Weight = 62.2 lb

Code/Design: IRC-2015/TPI-2014

PSF	Live	Dead	Dur	Factors
TC	20.0	10.0	Live	Wind Snow
BC	0.0	10.0	Lum	1.15 1.60 1.15
Total	40.0	Plt	1.15 1.60 1.15	
Spacing:	2-00-00	o.c.	Plies:	1
Repetitive Member Increase:	Yes			
Green Lumber:	No	Wet Service:	No	
Fab Tolerance:	20% Creep (Kcr)	=	2.0	
OH Soffit Load:	2.0	psf		

-----Snow Load Specs-----

ASCE7-10 Ground Snow (Pg) = 20.0 psf
Risk Cat: II Terrain Cat: C
Roof Exposure: Partially Exposed
Thermal Condition: Cold Ventilated(1.1)
Unobstructed Slippery Roof: No
Low-Slope Minimums(Pfmin): No
Unbalanced Snow Loads: Yes
Rain Surcharge: No Ice Dam Chk: Yes
Lu(max) = 20-00-00

-----Wind Load Specs-----

ASCE7-10 Wind Speed (V) = 115 mph
Risk Cat: II Exposure Cat: C
Bldg Dims: L = 36.0 ft B = 36.0 ft
M.R.H(h) = 15.0 ft Kzt = 1.0
Bldg Enclosure: Enclosed
Wind DL(psf): TC = 5.0 BC = 5.0
End Vertical Exposed: L = Yes R = Yes
Wind Uplift Reporting: ASCE7 MWFRS
C&C End Zone: 4-00-00

-----Additional Design Checks-----

10 psf Non-Concurrent BCLL:	Yes
20 psf BC Limited Storage:	Yes
200 lb BC Accessible Ceiling:	No
300 lb TC Maintenance Load:	No
2000 lb TC Safe Load:	No
Unbalanced TCLL:	Yes

Material Summary

TC	2x4	SP (ALSC6-2013)	#2
BC	2x4	SP (ALSC6-2013)	#2
Webs	2x4	SP (ALSC6-2013)	#3/Stud
Wedge	2x4	SP (ALSC6-2013)	#3/Stud

Member Forces Summary

Max CSI in TC PANEL	1 - 2	0.97
Max CSI in BC PANEL	1 - 4	0.73
Max CSI in Web	4 - 2	0.14

...Mem...	Ten	Comp	.CSI.
TC OH- 1	26	0	0.06
1- 2	369	899	0.97
2- 3	369	899	0.97
3-OH	26	0	0.06
BC 1- 4	728	176	0.73
3- 5	728	176	0.73
4- 5	728	176	0.70
Web 2- 4	368	0	0.14

Reaction Summary

Jnt	--X-Loc-	React	-Up-	--Width-	-Reqd	-Mat	PSI
1	02-00	709	75	04-00	01-08	SPF	531
3	16-02-00	709	75	04-00	01-08	SPF	531

Max Horiz = -79 / +79 at Joint 1

Loads Summary

This truss has been designed for the effects of an unbalanced top chord live load occurring at [8-02-00] using a 1.00 Full and 0.00 Reduced load factor.

See Loadcase Report for loading combinations and additional details.

Notes

Plates designed for Cq at 0.80 and Rotational Tolerance of 10.0 degrees
Plates located at TC pitch breaks meet the prescriptive minimum size requirement to transfer unblocked diaphragm loads across those joints.
This truss is not symmetric - proper orientation is critical.

Deflection Summary

TrussSpan	Limit	Actual(in)	Location
Vert LL	L/360	L/999(-0.15)	1- 4
Vert DL	L/120	L/999(-0.11)	1- 4
Vert CR	L/240	L/742(-0.26)	1- 4
Horz LL	0.75in	(0.05)	@Jt 1
Horz CR	1.25in	(0.07)	@Jt 1
Ohng CR	2L/240	2L/999(0.00)	1- 1
Ohng CR	2L/240	2L/999(0.00)	3- 3

Bracing Data Summary

-----Bracing Data-----
Chords; continuous except where shown
Web Bracing -- None

Plate offsets (X, Y):

(None unless indicated below)
Jnt1(04-01,01-11), Jnt3(-04-01,01-11)