


Customer: Stark Truss

Truss Mfr. Contact: System Administrator

SID:
TID: 2214224-08...
Date: 01 / 16 / 23
Page: 1 of 1

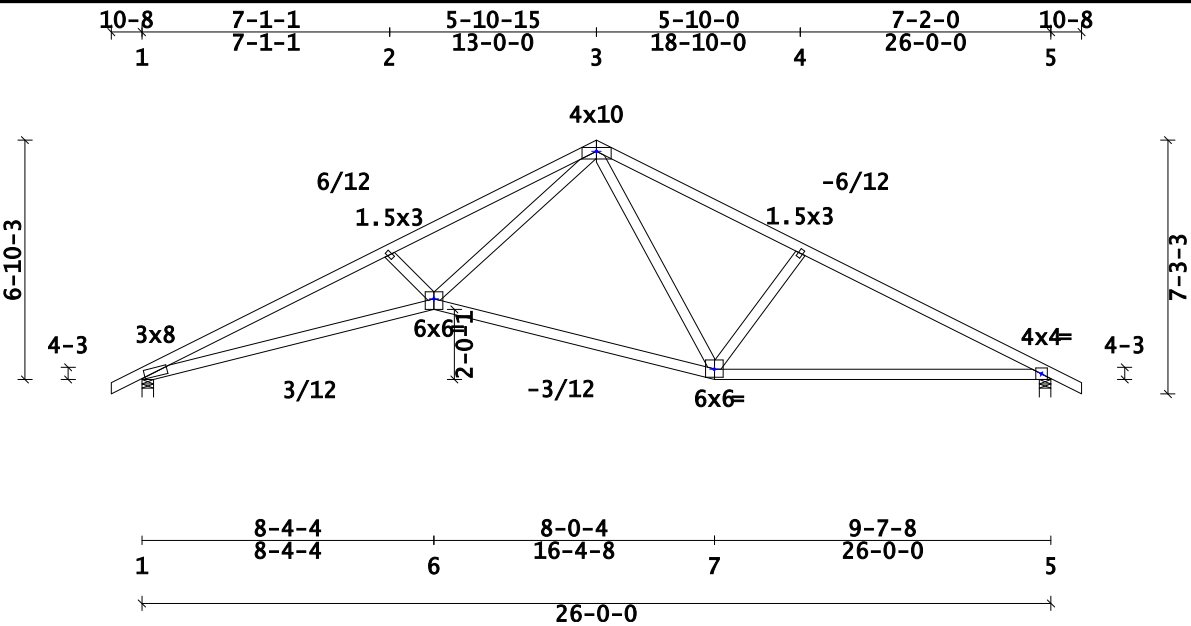

Truss Weight = 116.0 lb

Code/Design: IRC-2015/TPI-2014						-----Snow Load Specs-----						-----Wind Load Specs-----						-----Additional Design Checks-----						
PSF	Live	Dead	Dur Factors			ASCE7-10 Ground Snow (Pg) = 20.0 psf						ASCE7-10 Wind Speed (V) = 115 mph						10 psf Non-Concurrent BCLL: Yes						
TC	20.0	10.0	Live Wind Snow			Risk Cat: II Terrain Cat: C						Risk Cat: II Exposure Cat: C						20 psf BC Limited Storage: Yes						
BC	0.0	10.0	Lum	1.15	1.60	1.15	Roof Exposure: Partially Exposed						Bldg Dims: L = 36.0 ft B = 36.0 ft						200 lb BC Accessible Ceiling: No					
Total	40.0	Plt	1.15	1.60	1.15	Thermal Condition: Cold Ventilated(1.1)						M.R.H(h) = 25.0 ft Kzt = 1.0						300 lb TC Maintenance Load: No						
Spacing:	2-00-00 o.c.		Plies: 1			Unobstructed Slippery Roof: No						Bldg Enclosure: Enclosed						2000 lb TC Safe Load: No						
Repetitive Member Increase: Yes						Low-Slope Minimums (Pfmin): No						Wind DL(psf): TC = 5.0 BC = 5.0						Unbalanced TCLL: Yes						
Green Lumber: No Wet Service: No						Unbalanced Snow Loads: Yes						End Vertical Exposed: L = Yes R = Yes												
Fab Tolerance: 20% Creep (Kcr) = 2.0						Rain Surcharge: No Ice Dam Chk: No						Wind Uplift Reporting: ASCE7 MMFRS												
OH Soffit Load: 2.0 psf						Lu(max) = 20-00-00						C&C End Zone: 4-00-00												

Material Summary				
TC	2x4	SP (ALSC6-2013)	#2	
BC	2x4	SP (ALSC6-2013)	#2	
Webs	2x4	SP (ALSC6-2013)	#3/Stud	

Member Forces Summary				
Max CSI in TC PANEL	1	-	2	0.79
Max CSI in BC PANEL	1	-	6	0.87
Max CSI in Web	6	-	3	0.82

...	Mem...	Ten	Comp	.CSI.
TC	OH- 1	25	0	0.06
	1- 2	1221	3225	0.79
	2- 3	1163	2967	0.68
	3- 4	714	1511	0.61
	4- 5	742	1760	0.58
	5-OH	26	0	0.06
BC	1- 6	2904	1005	0.87
	5- 7	1506	542	0.83
	6- 7	1172	291	0.75
Web	2- 6	306	316	0.09
	3- 6	1986	664	0.82
	3- 7	358	141	0.15
	4- 7	334	409	0.16

Reaction Summary									
-----Reaction Summary(Lbs)-----									
Jnt	--X-Loc-	React	-Up-	--Width-	-Reqd	-Mat	PSI		
1	02-00	1096	193	04-00	01-08	SPF	531		
5	25-10-00	1096	192	04-00	01-08	SPF	531		
Max Horiz = -130 / +129 at Joint 1									

Loads Summary
This truss has been designed for the effects of an unbalanced top chord live load occurring at [13-00-00] using a 1.00 Full and 0.00 Reduced load factor.
See Loadcase Report for loading combinations and additional details.

Notes
Plates designed for Cq at 0.80 and Rotational Tolerance of 10.0 degrees
Plates located at TC pitch breaks meet the prescriptive minimum size requirement to transfer unblocked diaphragm loads across those joints.
Designed with hybrid plate values. See TD-SUB-0001 for info.

Deflection Summary			
TrussSpan	Limit	Actual(in)	Location
Vert LL	L/360	L/993(-0.31)	6- 7
Vert DL	L/120	L/784(-0.39)	6- 7
Vert CR	L/240	L/438(-0.70)	6- 7
Horz LL	0.75in	(0.15)	@Jt 5
Horz CR	1.25in	(0.29)	@Jt 5
Ohng CR	2L/240	2L/999(0.00)	1- 1
Ohng CR	2L/240	2L/999(0.00)	5- 5


Bracing Data Summary
-----Bracing Data-----
Chords; continuous except where shown
Web Bracing -- None

Plate offsets (X, Y):
(None unless indicated below)
Jnt3(0,-00-09), Jnt5(0,00-02),
Jnt6(0,-00-10), Jnt7(0,00-04)

Customer: Stark Truss

SID:
TID: 2214224-08...
Date: 01 / 16 / 23
Page: 1 of 1

Truss Mfr. Contact: System Administrator

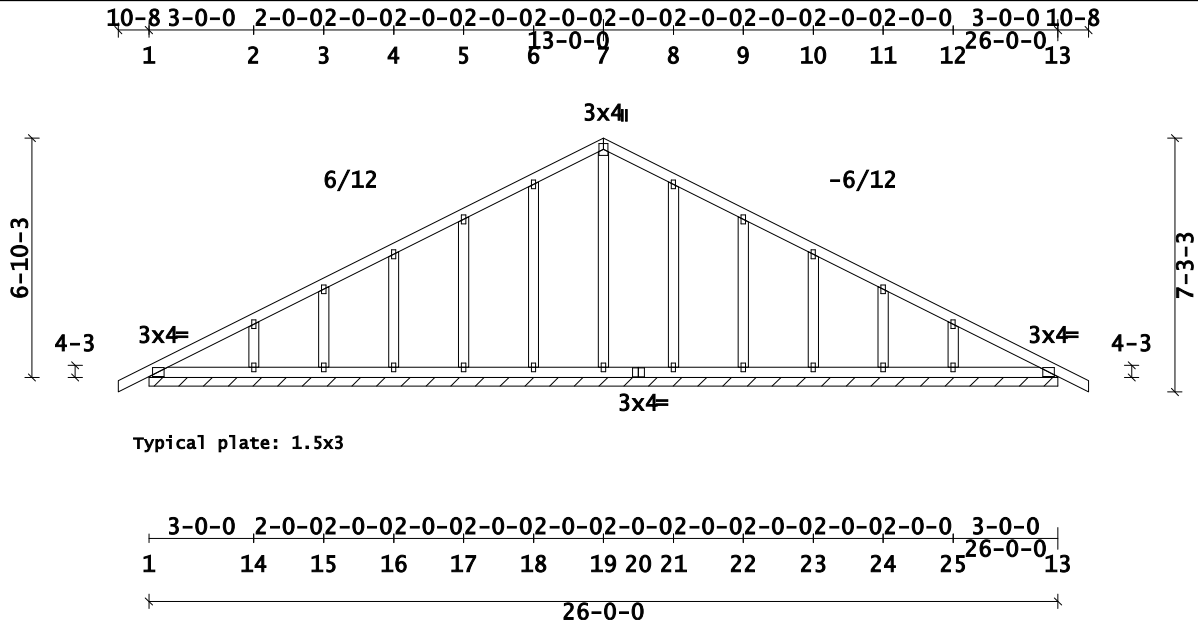

Truss Weight = 140.9 lb


Code/Design: IRC-2015/TPI-2014	-----Snow Load Specs-----	-----Wind Load Specs-----	-----Additional Design Checks-----
PSF Live Dead Dur Factors	ASCE7-10 Ground Snow (Pg) = 20.0 psf	ASCE7-10 Wind Speed (V) = 115 mph	10 psf Non-Concurrent BCLL: Yes
TC 20.0 10.0 Live Wind Snow	Risk Cat: II Terrain Cat: C	Risk Cat: II Exposure Cat: C	20 psf BC Limited Storage: Yes
BC 0.0 10.0 Lum 1.15 1.60 1.15	Roof Exposure: Partially Exposed	Bldg Dims: L = 36.0 ft B = 36.0 ft	200 lb BC Accessible Ceiling: No
Total 40.0 Plt 1.15 1.60 1.15	Thermal Condition: Cold Ventilated(1.1)	M.R.H(h) = 25.0 ft Kzt = 1.0	300 lb TC Maintenance Load: No
Spacing: 2'-00-00 o.c. Plies: 1	Unobstructed Slippery Roof: No	Bldg Enclosure: Enclosed	2000 lb TC Safe Load: No
Repetitive Member Increase: Yes	Low-Slope Minimums (Pfmin): No	Wind DL(psf): TC = 5.0 BC = 5.0	Unbalanced TCLL: Yes
Green Lumber: No Wet Service: No	Unbalanced Snow Loads: Yes	End Vertical Exposed: L = Yes R = Yes	
Fab Tolerance: 20% Creep (Kcr) = 2.0	Rain Surcharge: No Ice Dam Chk: No	Wind Uplift Reporting: ASCE7 MWFRS	
OH Soffit Load: 2.0 psf	Lu(max) = 20'-00-00	C&C End Zone: 4'-00-00	

Material Summary TC 2x4 SP (ALSC6-2013) #2 BC 2x4 SP (ALSC6-2013) #2 Webs 2x4 SP (ALSC6-2013) #3/Stud	Reaction Summary Reactions not shown: down < 400 and up < 150 ---- Reaction Summary (plf) ---- Jnt-Jnt React -Up- --Width- 1- 13 84 14 26'-00-00 Max Horiz = -129 / +129 at Joint 19	Deflection Summary TrussSpan Limit Actual(in) Location Vert LL L/360 L/999(-0.00) 25-13 Vert DL L/120 L/999(-0.00) 25-13 Vert CR L/240 L/999(-0.00) 25-13 Horz LL 0.75in (0.00) @Jt13 Horz CR 1.25in (0.00) @Jt13 Ohng CR 2L/240 2L/999(0.00) 1- 1 Ohng CR 2L/240 2L/999(0.00) 13-13
Member Forces Summary Max CSI in TC PANEL 1 - 2 0.07 Max CSI in BC PANEL 1 - 14 0.04 Max CSI in Web 18 - 6 0.10	Loads Summary This truss has been designed for the effects of an unbalanced top chord live load occurring at [13'-00-00] using a 1.00 Full and 0.00 Reduced load factor. See Loadcase Report for loading combinations and additional details.	Bracing Data Summary -----Bracing Data----- Chords; continuous except where shown Web Bracing -- None
...Mem... Ten Comp .CSI. TC 1- 7 234 103 0.07 7-13 233 103 0.07 BC 1-20 136 38 0.04 13-20 137 38 0.04 Web 2-14 168 152 0.05 3-15 86 113 0.02 4-16 94 121 0.03 5-17 122 146 0.06 6-18 160 171 0.10 7-19 5 93 0.07 8-21 160 171 0.10 9-22 126 146 0.06 10-23 94 121 0.03 11-24 86 113 0.02 12-25 168 152 0.05	Notes Gable webs are attached with min. 1x3 20 ga. plates. The max. rake overhang = 1/2 the truss spacing. If this truss is exposed to wind loads perpendicular to the plane of the truss, it must be braced according to a standard detail matching the wind criteria shown, or according to the Construction Documents and/or BCSI - B3. Plates designed for Cq at 0.80 and Rotational Tolerance of 10.0 degrees Plates located at TC pitch breaks meet the prescriptive minimum size requirement to transfer unblocked diaphragm loads across those joints. Designed with hybrid plate values. See TD-SUB-0001 for info. This truss is not symmetric - proper orientation is critical.	Plate offsets (X, Y): (None unless indicated below)

Customer: Stark Truss

SID:
TID: 2214224-08...
Date: 01 / 16 / 23
Page: 1 of 1

Truss Mfr. Contact: System Administrator

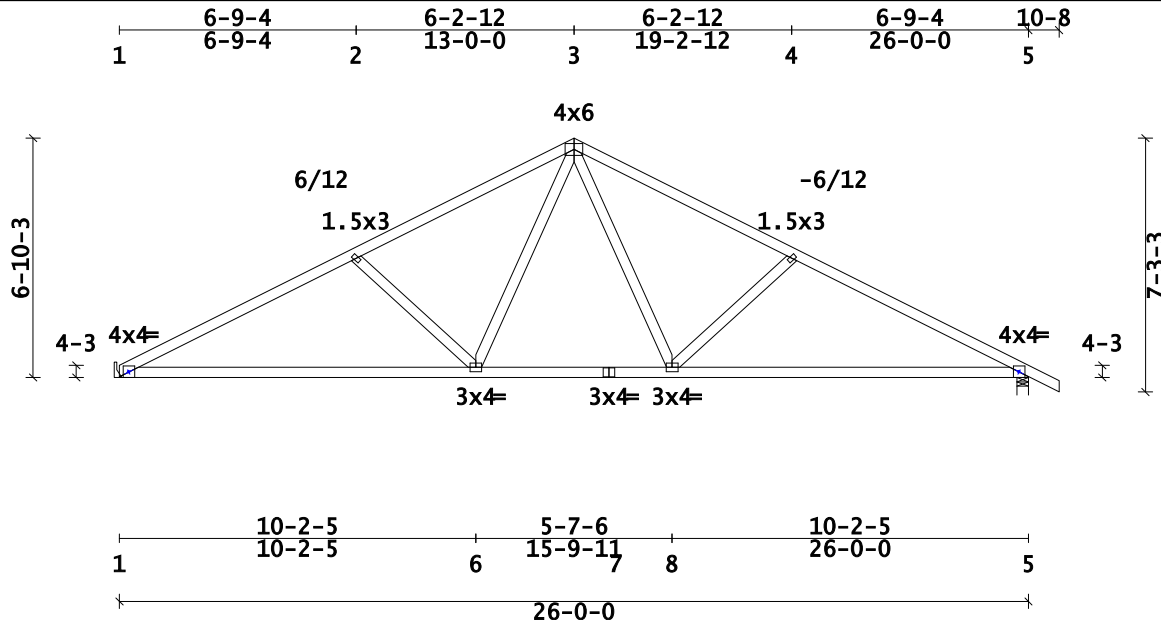

Truss Weight = 114.2 lb

Code/Design: IRC-2015/TPI-2014
PSF Live Dead Dur Factors
TC 20.0 10.0 Live Wind Snow
BC 0.0 10.0 Lum 1.15 1.60 1.15
Total 40.0 Plt 1.15 1.60 1.15
Spacing: 2-00-00 o.c. Plies: 1
Repetitive Member Increase: Yes
Green Lumber: No Wet Service: No
Fab Tolerance: 20% Creep (Kcr) = 2.0
OH Soffit Load: 2.0 psf

-----Snow Load Specs-----
ASCE7-10 Ground Snow (Pg) = 20.0 psf
Risk Cat: II Terrain Cat: C
Roof Exposure: Partially Exposed
Thermal Condition: Cold Ventilated(1.1)
Unobstructed Slippery Roof: No
Low-Slope Minimums(Pfmin): No
Unbalanced Snow Loads: Yes
Rain Surcharge: No Ice Dam Chk: No
Lu(max) = 20-00-00

-----Wind Load Specs-----
ASCE7-10 Wind Speed (V) = 115 mph
Risk Cat: II Exposure Cat: C
Bldg Dims: L = 36.0 ft B = 36.0 ft
M.R.H(h) = 25.0 ft Kzt = 1.0
Bldg Enclosure: Enclosed
Wind DL(psf): TC = 5.0 BC = 5.0
End Vertical Exposed: L = Yes R = Yes
Wind Uplift Reporting: ASCE7 MWFRS
C&C End Zone: 4-00-00

-----Additional Design Checks-----
10 psf Non-Concurrent BCLL: Yes
20 psf BC Limited Storage: Yes
200 lb BC Accessible Ceiling: No
300 lb TC Maintenance Load: No
2000 lb TC Safe Load: No
Unbalanced TCCLL: Yes

Material Summary

TC	2x4	SP (ALSC6-2013)	#2
BC	2x4	SP (ALSC6-2013)	#2
Webs	2x4	SP (ALSC6-2013)	#3/Stud

Member Forces Summary

Max CSI in TC PANEL	1 - 2	0.75
Max CSI in BC PANEL	1 - 6	0.91
Max CSI in Web	2 - 6	0.21

...	Mem...	Ten	Comp	.CSI.
TC	1- 2	793	1786	0.75
	2- 3	706	1477	0.75
	3- 4	679	1464	0.66
	4- 5	755	1768	0.66
	5-OH	26	0	0.06
BC	1- 6	1541	574	0.91
	5- 8	1520	571	0.88
	6- 7	1033	256	0.83
	7- 8	1033	256	0.79
Web	2- 6	346	430	0.21
	3- 6	512	185	0.21
	3- 8	485	166	0.20
	4- 8	341	415	0.20

Reaction Summary

-----Reaction Summary(Lbs)-----
Jnt --X-Loc- React -Up- --Width- -Reqd -Mat PSI
1 00-12 1035 174 01-08 HGR SPF 565
5 25-10-00 1101 193 04-00 01-08 SPF 531
Max Horiz = -137 / +121 at Joint 1

Loads Summary

This truss has been designed for the effects of an unbalanced top chord live load occurring at [13-00-00] using a 1.00 Full and 0.00 Reduced load factor.

See Loadcase Report for loading combinations and additional details.

Notes

Plates designed for Cq at 0.80 and Rotational Tolerance of 10.0 degrees
Plates located at TC pitch breaks meet the prescriptive minimum size requirement to transfer unblocked diaphragm loads across those joints.
Designed with hybrid plate values. See TD-SUB-0001 for info.
This truss is not symmetric - proper orientation is critical.

Deflection Summary

TrussSpan	Limit	Actual(in)	Location
Vert LL	L/360	L/999(-0.28)	1- 6
Vert DL	L/120	L/959(-0.32)	1- 6
Vert CR	L/240	L/513(-0.60)	1- 6
Horz LL	0.75in	(0.03)	@Jt 5
Horz CR	1.25in	(0.07)	@Jt 5
Ohng CR	2L/240	2L/999(0.00)	5- 5

Bracing Data Summary

-----Bracing Data-----
Chords; continuous except where shown
Web Bracing -- None


Plate offsets (X, Y):

(None unless indicated below)
Jnt1(0,00-02), Jnt5(0,00-02)

Customer: Stark Truss

SID:
TID: 2214224-08...
Date: 01 / 16 / 23
Page: 1 of 1

Truss Mfr. Contact: System Administrator

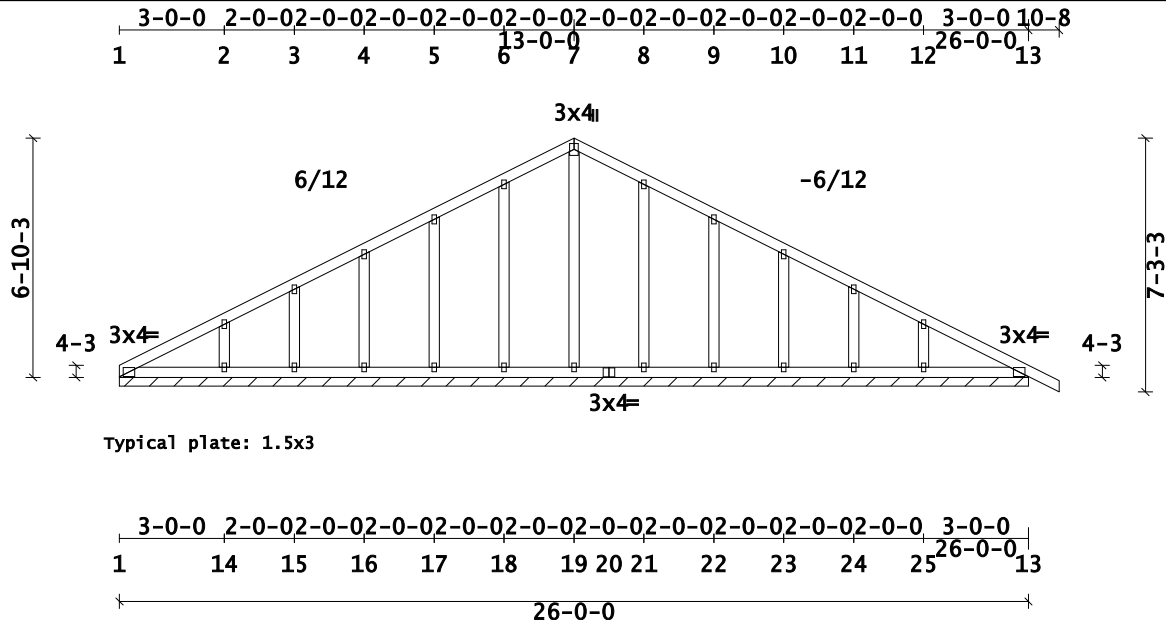

Truss Weight = 139.6 lb

Code/Design: IRC-2015/TPI-2014
PSF Live Dead Dur Factors
TC 20.0 10.0 Live Wind Snow
BC 0.0 10.0 Lum 1.15 1.60 1.15
Total 40.0 Plt 1.15 1.60 1.15
Spacing: 2'-00-00 o.c. Plies: 1
Repetitive Member Increase: Yes
Green Lumber: No Wet Service: No
Fab Tolerance: 20% Creep (Kcr) = 2.0
OH Soffit Load: 2.0 psf

-----Snow Load Specs-----
ASCE7-10 Ground Snow (Pg) = 20.0 psf
Risk Cat: II Terrain Cat: C
Roof Exposure: Partially Exposed
Thermal Condition: Cold Ventilated(1.1)
Unobstructed Slippery Roof: No
Low-Slope Minimums (Pfmin): No
Unbalanced Snow Loads: Yes
Rain Surcharge: No Ice Dam Chk: No
Lu(max) = 20'-00-00

-----Wind Load Specs-----
ASCE7-10 Wind Speed (V) = 115 mph
Risk Cat: II Exposure Cat: C
Bldg Dims: L = 36.0 ft B = 36.0 ft
M.R.H(h) = 25.0 ft Kzt = 1.0
Bldg Enclosure: Enclosed
Wind DL(psf): TC = 5.0 BC = 5.0
End Vertical Exposed: L = Yes R = Yes
Wind Uplift Reporting: ASCE7 MWFRS
C&C End Zone: 4'-00-00

-----Additional Design Checks-----
10 psf Non-Concurrent BCLL: Yes
20 psf BC Limited Storage: Yes
200 lb BC Accessible Ceiling: No
300 lb TC Maintenance Load: No
2000 lb TC Safe Load: No
Unbalanced TCLL: Yes

Material Summary

TC	2x4	SP (ALSC6-2013)	#2
BC	2x4	SP (ALSC6-2013)	#2
Webs	2x4	SP (ALSC6-2013)	#3/Stud

Member Forces Summary

Max CSI in TC PANEL	1 - 2	0.08
Max CSI in BC PANEL	1 - 14	0.06
Max CSI in Web	18 - 6	0.10

...	Mem...	Ten	Comp	.CSI.
TC	1-7	48	92	0.08
	7-13	233	106	0.07
BC	1-20	105	36	0.06
	13-20	137	35	0.04
Web	2-14	203	156	0.06
	3-15	85	109	0.02
	4-16	93	121	0.03
	5-17	122	146	0.06
	6-18	160	171	0.10
	7-19	8	86	0.07
	8-21	160	171	0.10
	9-22	126	146	0.06
	10-23	94	121	0.03
	11-24	86	113	0.02
	12-25	168	151	0.05

Reaction Summary

Reactions not shown: down < 400 and up < 150
---- Reaction Summary (plf) ----
Jnt-Jnt React -Up- --Width-
1- 13 82 14 26'-00-00
Max Horiz = -138 / +121 at Joint 19

Loads Summary

This truss has been designed for the effects of an unbalanced top chord live load occurring at [13'-00-00] using a 1.00 Full and 0.00 Reduced load factor.

See Loadcase Report for loading combinations and additional details.

Notes

Gable webs are attached with min. 1x3 20 ga. plates. The max. rake overhang = 1/2 the truss spacing. If this truss is exposed to wind loads perpendicular to the plane of the truss, it must be braced according to a standard detail matching the wind criteria shown, or according to the Construction Documents and/or BCSI - B3.
Plates designed for Cq at 0.80 and Rotational Tolerance of 10.0 degrees
Plates located at TC pitch breaks meet the prescriptive minimum size requirement to transfer unblocked diaphragm loads across those joints.
Designed with hybrid plate values. See TD-SUB-0001 for info.
This truss is not symmetric - proper orientation is critical.

Deflection Summary

TrussSpan	Limit	Actual(in)	Location
Vert LL	L/360	L/999(-0.00)	25-13
Vert DL	L/120	L/999(-0.00)	1-14
Vert CR	L/240	L/999(-0.00)	1-14
Horz LL	0.75in	(0.00)	@Jt 1
Horz CR	1.25in	(0.00)	@Jt 1
Ohng CR	2L/240	2L/999(0.00)	13-13

Bracing Data Summary

-----Bracing Data-----
Chords; continuous except where shown
Web Bracing -- None


Plate offsets (X, Y):

(None unless indicated below)

Customer: Stark Truss

SID:
TID: 2214224-08...
Date: 01 / 16 / 23
Page: 1 of 1

Truss Mfr. Contact: System Administrator

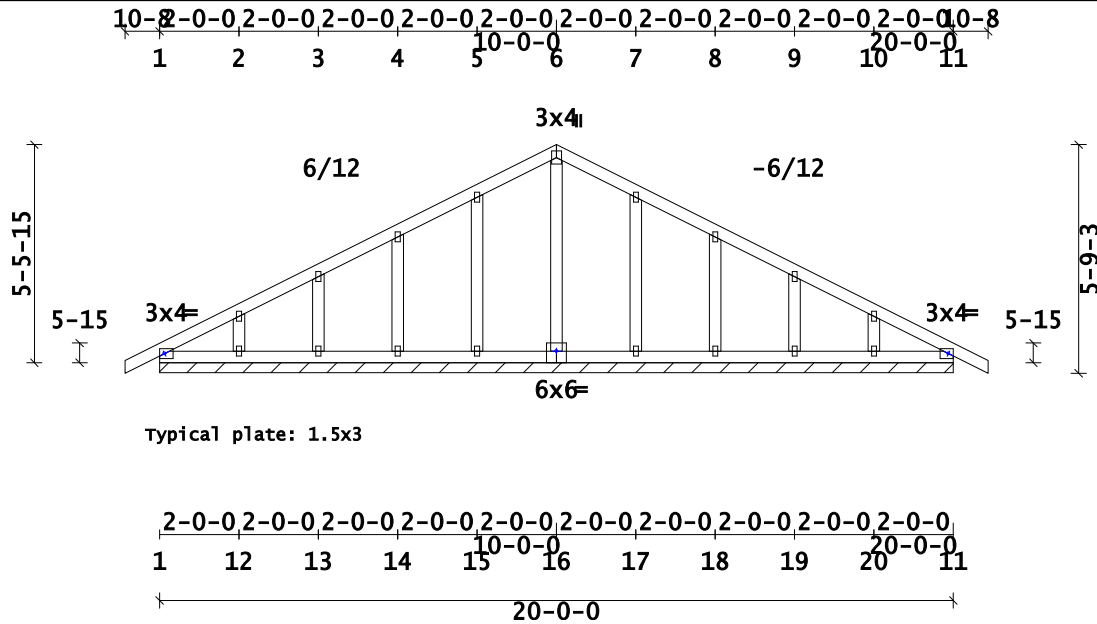

Typical plate: 1.5x3

Truss Weight = 104.3 lb

Code/Design: IRC-2015/TPI-2014
PSF Live Dead Dur Factors
TC 20.0 10.0 Live Wind Snow
BC 0.0 10.0 Lum 1.15 1.60 1.15
Total 40.0 Plt 1.15 1.60 1.15
Spacing: 2-00-00 o.c. Plies: 1
Repetitive Member Increase: Yes
Green Lumber: No Wet Service: No
Fab Tolerance: 20% Creep (Kcr) = 2.0
OH Soffit Load: 2.0 psf

-----Snow Load Specs-----
ASCE7-10 Ground Snow (Pg) = 20.0 psf
Risk Cat: II Terrain Cat: C
Roof Exposure: Partially Exposed
Thermal Condition: Cold Ventilated(1.1)
Unobstructed Slippery Roof: No
Low-Slope Minimums(Pfmin): No
Unbalanced Snow Loads: Yes
Rain Surcharge: No Ice Dam Chk: No
Lu(max) = 20-00-00

-----Wind Load Specs-----
ASCE7-10 Wind Speed (V) = 115 mph
Risk Cat: II Exposure Cat: C
Bldg Dims: L = 36.0 ft B = 36.0 ft
M.R.H(h) = 25.0 ft Kzt = 1.0
Bldg Enclosure: Enclosed
Wind DL(psf): TC = 5.0 BC = 5.0
End Vertical Exposed: L = Yes R = Yes
Wind Uplift Reporting: ASCE7 MWFRS
C&C End Zone: 4-00-00

-----Additional Design Checks-----
10 psf Non-Concurrent BCLL: Yes
20 psf BC Limited Storage: Yes
200 lb BC Accessible Ceiling: No
300 lb TC Maintenance Load: No
2000 lb TC Safe Load: No
Unbalanced TCLL: Yes

Material Summary

TC	2x4	SP (ALSC6-2013)	#2
BC	2x4	SP (ALSC6-2013)	#2
Webs	2x4	SP (ALSC6-2013)	#3/Stud

Member Forces Summary

Max CSI in TC PANEL	1 - 1	0.06
Max CSI in BC PANEL	1 - 12	0.03
Max CSI in Web	15 - 5	0.06

...	Mem...	Ten	Comp	.CSI.
TC	1-6	189	75	0.06
	6-11	189	75	0.06
BC	1-16	108	35	0.03
	11-16	108	35	0.03
Web	2-12	152	117	0.04
	3-13	102	122	0.03
	4-14	121	145	0.04
	5-15	163	172	0.06
	6-16	0	108	0.06
	7-17	163	172	0.06
	8-18	121	145	0.04
	9-19	102	122	0.03
	10-20	152	117	0.04

Reaction Summary

Reactions not shown: down < 400 and up < 150
---- Reaction Summary (plf) ----
Jnt-Jnt React -Up- --Width-
1- 11 85 15 20-00-00
Max Horiz = -99 / +99 at Joint 16

Loads Summary

This truss has been designed for the effects of an unbalanced top chord live load occurring at [10-00-00] using a 1.00 Full and 0.00 Reduced load factor.

See Loadcase Report for loading combinations and additional details.

Notes

Gable webs are attached with min. 1x3 20 ga. plates. The max. rake overhang = 1/2 the truss spacing. If this truss is exposed to wind loads perpendicular to the plane of the truss, it must be braced according to a standard detail matching the wind criteria shown, or according to the Construction Documents and/or BCSI - B3.
Plates designed for Cq at 0.80 and Rotational Tolerance of 10.0 degrees
Plates located at TC pitch breaks meet the prescriptive minimum size requirement to transfer unblocked diaphragm loads across those joints.
Designed with hybrid plate values. See TD-SUB-0001 for info.
Lumber and plating have been applied symmetrically.

Deflection Summary

TrussSpan	Limit	Actual(in)	Location
Vert LL	L/360	L/999(-0.00)	13-14
Vert DL	L/120	L/999(-0.00)	12-13
Vert CR	L/240	L/999(-0.00)	12-13
Horz LL	0.75in	(0.00)	@Jt 1
Horz CR	1.25in	(0.00)	@Jt 1
Ohng CR	2L/240	2L/999(0.00)	1- 1
Ohng CR	2L/240	2L/999(0.00)	11-11

Bracing Data Summary

-----Bracing Data-----
Chords; continuous except where shown
Web Bracing -- None

Plate offsets (X, Y):

(None unless indicated below)
Jnt1(00-08,0), Jnt11(-00-08,0),
Jnt16(0,-00-08)

Customer: Stark Truss


SID:

TID: 2214224-08...

Date: 01 / 16 / 23

Page: 1 of 1

Truss Mfr. Contact: System Administrator

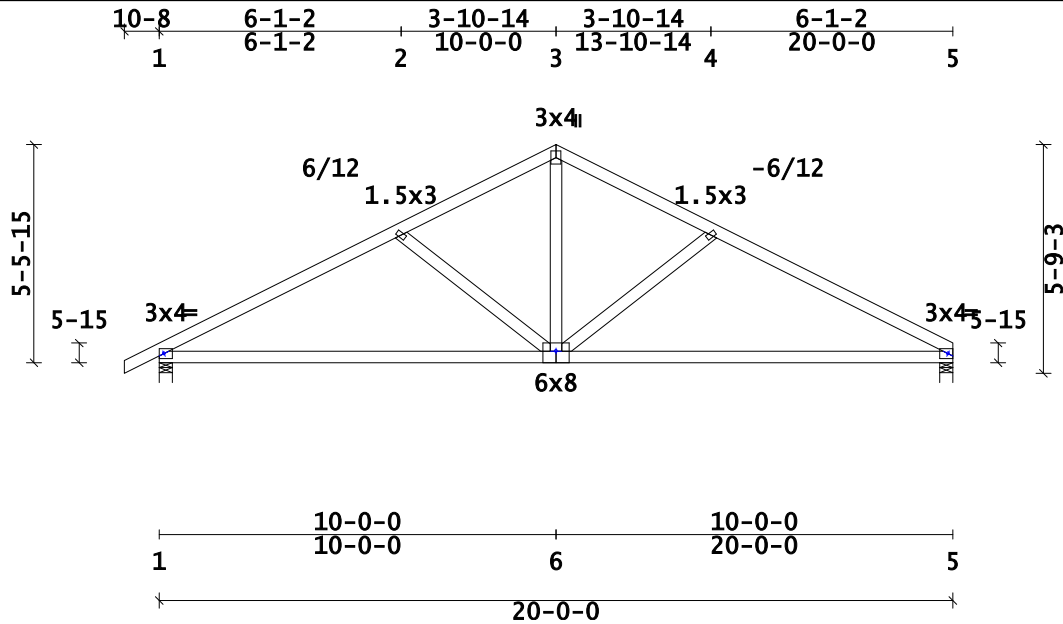

Truss Weight = 85.7 lb

Code/Design: IRC-2015/TPI-2014
PSF Live Dead Dur Factors
TC 20.0 10.0 Live Wind Snow
BC 0.0 10.0 Lum 1.15 1.60 1.15
Total 40.0 Plt 1.15 1.60 1.15
Spacing: 2-00-00 o.c. Plies: 1
Repetitive Member Increase: Yes
Green Lumber: No Wet Service: No
Fab Tolerance: 20% Creep (Kcr) = 2.0
OH Soffit Load: 2.0 psf

-----Snow Load Specs-----
ASCE7-10 Ground Snow (Pg) = 20.0 psf
Risk Cat: II Terrain Cat: C
Roof Exposure: Partially Exposed
Thermal Condition: Cold Ventilated(1.1)
Unobstructed Slippery Roof: No
Low-Slope Minimums(Pfmin): No
Unbalanced Snow Loads: Yes
Rain Surcharge: No Ice Dam Chk: No
Lu(max) = 20-00-00

-----Wind Load Specs-----
ASCE7-10 Wind Speed (V) = 115 mph
Risk Cat: II Exposure Cat: C
Bldg Dims: L = 36.0 ft B = 36.0 ft
M.R.H(h) = 25.0 ft Kzt = 1.0
Bldg Enclosure: Enclosed
Wind DL(psf): TC = 5.0 BC = 5.0
End Vertical Exposed: L = Yes R = Yes
Wind Uplift Reporting: ASCE7 MWFRS
C&C End Zone: 4-00-00

-----Additional Design Checks-----
10 psf Non-Concurrent BCLL: Yes
20 psf BC Limited Storage: Yes
200 lb BC Accessible Ceiling: No
300 lb TC Maintenance Load: No
2000 lb TC Safe Load: No
Unbalanced TCCLL: Yes

Material Summary

TC	2x4	SP (ALSC6-2013)	#2
BC	2x4	SP (ALSC6-2013)	#2
Webs	2x4	SP (ALSC6-2013)	#3/Stud

Member Forces Summary

Max CSI in TC PANEL	1 - 2	0.36
Max CSI in BC PANEL	1 - 6	0.91
Max CSI in Web	6 - 3	0.24

...Mem...	Ten	Comp	.CSI.
TC OH- 1	25	0	0.06
1- 2	569	1222	0.36
2- 3	471	936	0.29
3- 4	488	936	0.34
4- 5	592	1223	0.36
BC 1- 6	1021	421	0.91
5- 6	1023	418	0.91
Web 2- 6	296	338	0.17
3- 6	581	248	0.24
4- 6	299	343	0.17

Reaction Summary

-----Reaction Summary(Lbs)-----
Jnt --X-Loc- React -Up- --Width- -Reqd -Mat PSI
1 02-03 857 155 04-00 01-08 SPF 531
5 19-09-13 799 135 04-00 01-08 SPF 531
Max Horiz = -92 / +107 at Joint 1

Loads Summary

This truss has been designed for the effects of an unbalanced top chord live load occurring at [10-00-00] using a 1.00 Full and 0.00 Reduced load factor.

See Loadcase Report for loading combinations and additional details.

Notes

Plates designed for Cq at 0.80 and Rotational Tolerance of 10.0 degrees
Plates located at TC pitch breaks meet the prescriptive minimum size requirement to transfer unblocked diaphragm loads across those joints.
Designed with hybrid plate values. See TD-SUB-0001 for info.
This truss is not symmetric - proper orientation is critical.

Deflection Summary

TrussSpan	Limit	Actual(in)	Location
Vert LL	L/360	L/999(-0.17)	6- 5
Vert DL	L/120	L/999(-0.18)	6- 5
Vert CR	L/240	L/676(-0.35)	6- 5
Horz LL	0.75in	(0.02)	@Jt 5
Horz CR	1.25in	(0.03)	@Jt 5
Ohng CR	2L/240	2L/999(0.00)	1- 1

Bracing Data Summary

-----Bracing Data-----
Chords; continuous except where shown
Web Bracing -- None


Plate offsets (X, Y):

(None unless indicated below)
Jnt1(00-08,0), Jnt5(-00-08,0),
Jnt6(0,-00-08)

Customer: Stark Truss

SID:
TID: 2214224-08...
Date: 01 / 16 / 23
Page: 1 of 1

Truss Mfr. Contact: System Administrator

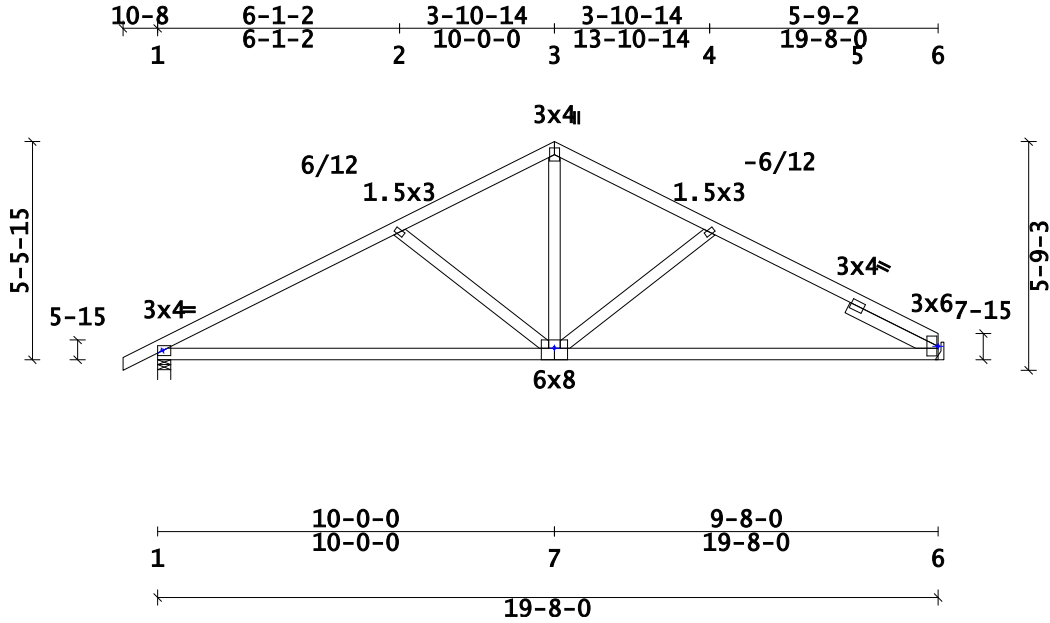

Truss Weight = 89.4 lb

Code/Design: IRC-2015/TPI-2014
PSF Live Dead Dur Factors
TC 20.0 10.0 Live Wind Snow
BC 0.0 10.0 Lum 1.15 1.60 1.15
Total 40.0 Plt 1.15 1.60 1.15
Spacing: 2-00-00 o.c. Plies: 1
Repetitive Member Increase: Yes
Green Lumber: No Wet Service: No
Fab Tolerance: 20% Creep (Kcr) = 2.0
OH Soffit Load: 2.0 psf

-----Snow Load Specs-----
ASCE7-10 Ground Snow (Pg) = 20.0 psf
Risk Cat: II Terrain Cat: C
Roof Exposure: Partially Exposed
Thermal Condition: Cold Ventilated(1.1)
Unobstructed Slippery Roof: No
Low-Slope Minimums (Pfmin): No
Unbalanced Snow Loads: Yes
Rain Surcharge: No Ice Dam Chk: No
Lu(max) = 20-00-00

-----Wind Load Specs-----
ASCE7-10 Wind Speed (V) = 115 mph
Risk Cat: II Exposure Cat: C
Bldg Dims: L = 36.0 ft B = 36.0 ft
M.R.H(h) = 25.0 ft Kzt = 1.0
Bldg Enclosure: Enclosed
Wind DL(psf): TC = 5.0 BC = 5.0
End Vertical Exposed: L = Yes R = Yes
Wind Uplift Reporting: ASCE7 MWFRS
C&C End Zone: 4-00-00

-----Additional Design Checks-----
10 psf Non-Concurrent BCLL: Yes
20 psf BC Limited Storage: Yes
200 lb BC Accessible Ceiling: No
300 lb TC Maintenance Load: No
2000 lb TC Safe Load: No
Unbalanced TCCLL: Yes

Material Summary

TC	2x4	SP (ALSC6-2013)	#2
BC	2x4	SP (ALSC6-2013)	#2
Webs	2x4	SP (ALSC6-2013)	#3/Stud
Slider	2x4	SP (ALSC6-2013)	#3/Stud

Member Forces Summary

Max CSI in TC PANEL	1 - 2	0.37
Max CSI in BC PANEL	1 - 7	0.86
Max CSI in Web	5 - 6	0.26

...Mem...	Ten	Comp	CSI.
TC OH- 1	25	0	0.06
1- 2	567	1203	0.37
2- 3	466	917	0.29
3- 4	483	914	0.29
4- 5	577	1128	0.31
5- 6	505	1080	0.21
BC 1- 7	1005	426	0.86
6- 7	980	401	0.83
Web 2- 7	294	339	0.17
3- 7	556	239	0.23
4- 7	273	313	0.16
5- 6	75	88	0.26

Reaction Summary

Jnt	--X-Loc	React	-Up-	--Width-	-Reqd	-Mat	PSI
1	02-03	849	153	04-00	01-08	SPF	531
6	19-07-04	781	132	01-08	HGR	SPF	565
Max Horiz = -88 / +107 at Joint 1							

Loads Summary

This truss has been designed for the effects of an unbalanced top chord live load occurring at [10-00-00] using a 1.00 Full and 0.00 Reduced load factor.

See Loadcase Report for loading combinations and additional details.

Notes

Plates designed for Cq at 0.80 and Rotational Tolerance of 10.0 degrees
Plates located at TC pitch breaks meet the prescriptive minimum size requirement to transfer unblocked diaphragm loads across those joints.
Designed with hybrid plate values. See TD-SUB-0001 for info.

Deflection Summary

TrussSpan	Limit	Actual(in)	Location
Vert LL	L/360	L/999(-0.18)	1- 7
Vert DL	L/120	L/999(-0.18)	1- 7
Vert CR	L/240	L/646(-0.36)	1- 7
Horz LL	0.75in	(0.02)	@Jt 6
Horz CR	1.25in	(0.03)	@Jt 6
Ohng CR	2L/240	2L/999(0.00)	1- 1

Bracing Data Summary

-----Bracing Data-----
Chords; continuous except where shown
Web Bracing -- None


Plate offsets (X, Y):

(None unless indicated below)
Jnt1(00-08,0), Jnt7(0,-00-08),
Jnt6(-01-14,00-01)

Customer: Stark Truss

SID:
TID: 2214224-08...
Date: 01 / 16 / 23
Page: 1 of 1

Truss Mfr. Contact: System Administrator

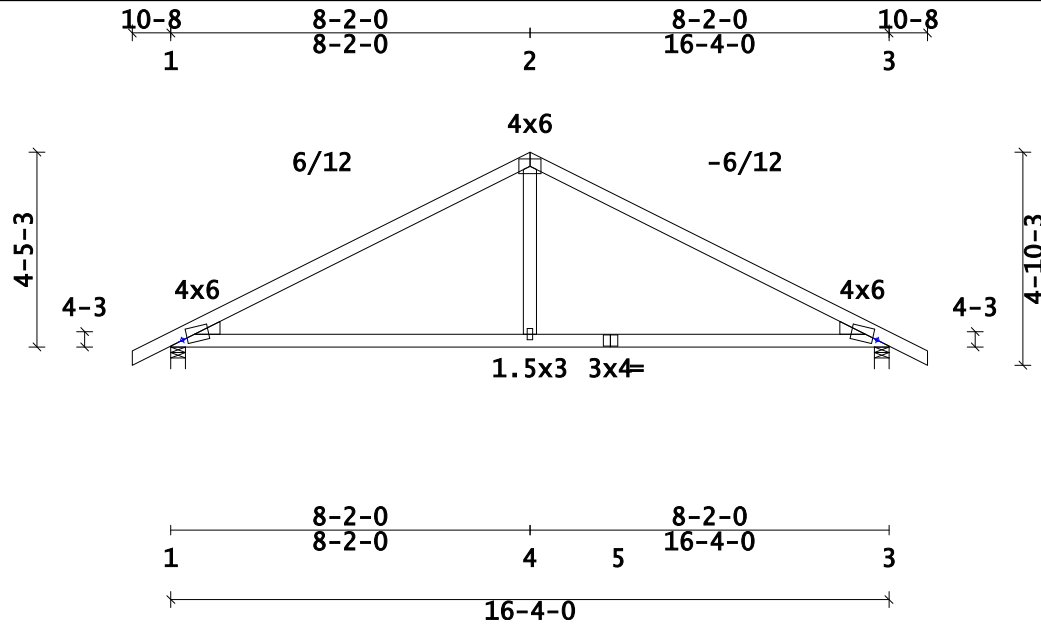

Truss Weight = 62.2 lb

Code/Design: IRC-2015/TPI-2014
PSF Live Dead Dur Factors
TC 20.0 10.0 Live Wind Snow
BC 0.0 10.0 Lum 1.15 1.60 1.15
Total 40.0 Plt 1.15 1.60 1.15
Spacing: 2-00-00 o.c. Plies: 1
Repetitive Member Increase: Yes
Green Lumber: No Wet Service: No
Fab Tolerance: 20% Creep (Kcr) = 2.0
OH Soffit Load: 2.0 psf

-----Snow Load Specs-----
ASCE7-10 Ground Snow (Pg) = 20.0 psf
Risk Cat: II Terrain Cat: C
Roof Exposure: Partially Exposed
Thermal Condition: Cold Ventilated(1.1)
Unobstructed Slippery Roof: No
Low-Slope Minimums (Pfmin): No
Unbalanced Snow Loads: Yes
Rain Surcharge: No Ice Dam Chk: No
Lu(max) = 20-00-00

-----Wind Load Specs-----
ASCE7-10 Wind Speed (V) = 115 mph
Risk Cat: II Exposure Cat: C
Bldg Dims: L = 36.0 ft B = 36.0 ft
M.R.H(h) = 25.0 ft Kzt = 1.0
Bldg Enclosure: Enclosed
Wind DL(psf): TC = 5.0 BC = 5.0
End Vertical Exposed: L = Yes R = Yes
Wind Uplift Reporting: ASCE7 MWFRS
C&C End Zone: 4-00-00

-----Additional Design Checks-----
10 psf Non-Concurrent BCLL: Yes
20 psf BC Limited Storage: Yes
200 lb BC Accessible Ceiling: No
300 lb TC Maintenance Load: No
2000 lb TC Safe Load: No
Unbalanced TCLL: Yes

Material Summary

TC	2x4	SP (ALSC6-2013)	#2
BC	2x4	SP (ALSC6-2013)	#2
Webs	2x4	SP (ALSC6-2013)	#3/Stud
Wedge	2x4	SP (ALSC6-2013)	#3/Stud

Member Forces Summary

Max CSI in TC PANEL	1 - 2	0.97
Max CSI in BC PANEL	1 - 4	0.73
Max CSI in Web	4 - 2	0.14

...Mem...	Ten	Comp	.CSI.
TC OH- 1	26	0	0.06
1- 2	432	899	0.97
2- 3	432	899	0.97
3-OH	26	0	0.06
BC 1- 4	728	217	0.73
3- 5	728	217	0.73
4- 5	728	217	0.70
Web 2- 4	368	0	0.14

Reaction Summary

-----Reaction Summary(Lbs)-----
Jnt --X-Loc- React -Up- --Width- -Regd -Mat PSI
1 02-00 709 129 04-00 01-08 SPF 531
3 16-02-00 709 129 04-00 01-08 SPF 531
Max Horiz = -79 / +79 at Joint 1

Loads Summary

This truss has been designed for the effects of an unbalanced top chord live load occurring at [8-02-00] using a 1.00 Full and 0.00 Reduced load factor.

See Loadcase Report for loading combinations and additional details.

Notes

Plates designed for Cq at 0.80 and Rotational Tolerance of 10.0 degrees
Plates located at TC pitch breaks meet the prescriptive minimum size requirement to transfer unblocked diaphragm loads across those joints.
Designed with hybrid plate values. See TD-SUB-0001 for info.
This truss is not symmetric - proper orientation is critical.

Deflection Summary

TrussSpan	Limit	Actual(in)	Location
Vert LL	L/360	L/999(-0.15)	1- 4
Vert DL	L/120	L/999(-0.11)	1- 4
Vert CR	L/240	L/742(-0.26)	1- 4
Horz LL	0.75in	(0.05) @Jt 1	
Horz CR	1.25in	(0.07) @Jt 1	
Ohng CR	2L/240	2L/999(0.00)	1- 1
Ohng CR	2L/240	2L/999(0.00)	3- 3

Bracing Data Summary


-----Bracing Data-----
Chords; continuous except where shown
Web Bracing -- None

Plate offsets (X, Y):

(None unless indicated below)
Jnt1(04-01,01-11), Jnt3(-04-01,01-11)

SID:
TID: 2214224-08...
Date: 01 / 16 / 23
Page: 1 of 1

Truss Mfr. Contact: System Administrator

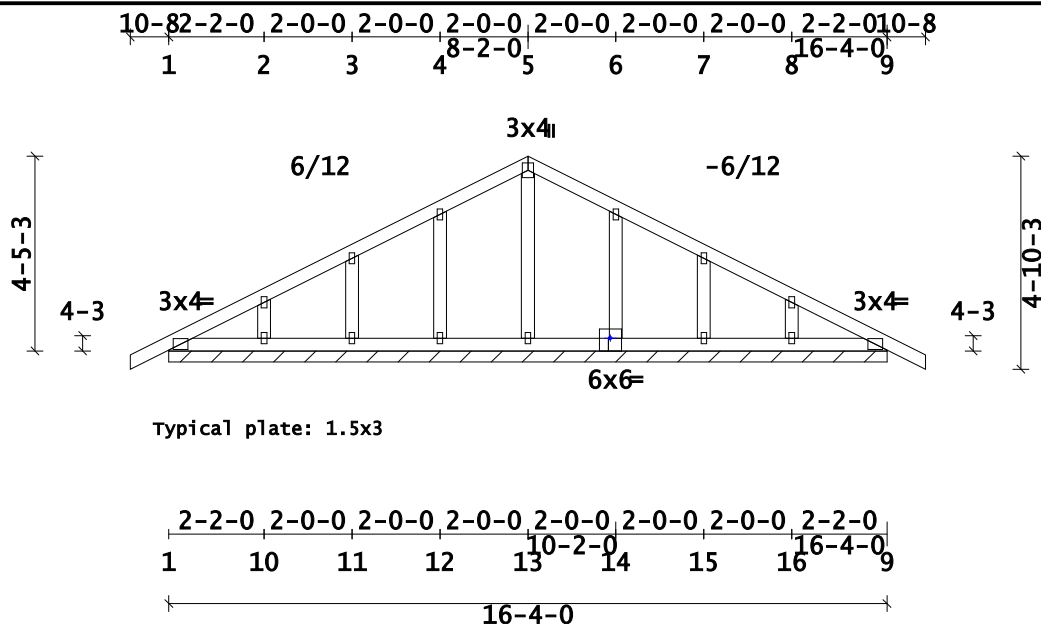

Truss Weight = 79.3 lb

Code/Design: IRC-2015/TFP-2014										-----Snow Load Specs-----										-----Wind Load Specs-----										-----Additional Design Checks-----									
PSF Live Dead					Dur Factors					ASCE7-10 Ground Snow (Pg) = 20.0 psf					ASCE7-10 Wind Speed (V) = 115 mph					10 psf Non-Concurrent BCLL: Yes																			
TC 20.0 10.0					Live Wind Snow					Risk Cat: II Terrain Cat: C					Risk Cat: II Exposure Cat: C					20 psf BC Limited Storage: Yes																			
BC 0.0 10.0 Lum 1.15 1.60 1.15					Roof Exposure: Partially Exposed					Bldg Dims: L = 36.0 ft B = 36.0 ft					M.R.R.(h) = 25.0 ft Kzt = 1.0					200 lb TC Accessible Ceiling: No																			
Total 40.0 Plt 1.15 1.60 1.15					Thermal Condition: Cold Ventilated(1.1)					Bldg Enclosure: Enclosed					Wind DL(psf): TC = 5.0 BC = 5.0					300 lb TC Maintenance Load: No																			
Spacing: 2-00-00 o.c. Plies: 1					Unobstructed Slippery Roof: No					End Vertical Exposed: L = Yes R = Yes					Wind Uplift Reporting: ASCE7 MWFRS					2000 lb TC Safe Load: No																			
Repetitive Member Increase: Yes					Low-Slope Minimums (Pfmin): No					Unbalanced Snow Loads: Yes					C&C End Zone: 4-00-00					Unbalanced TCLL: Yes																			
Green Lumber: No Wet Service: No					Rain Surcharge: No Ice Dam Chk: No																																		
Fib Tolerance: 20% Creep (Kcr) = 2.0					Lu(max) = 20-00-00																																		
OH Soffit Load: 2.0 psf																																							

TC	2x4	SP	(ALSC6-2013)	#2
BC	2x4	SP	(ALSC6-2013)	#2
Webs	2x4	SP	(ALSC6-2013)	#3/Stud

Max CSI in TC PANEL	1 - 1	0.06
Max CSI in BC PANEL	1 - 10	0.03
Max CSI in Web	12 - 4	0.05

...	Mem...	Ten	Comp	...	CSI...
TC	1- 5	145	50		0.06
	5- 9	146	48		0.06
BC	1-14	108	30		0.03
	9-14	102	25		0.03
Web	2-10	143	117		0.04
	3-11	120	148		0.03
	4-12	165	172		0.05
	5-13	0	102		0.03
	6-14	162	167		0.05
	7-15	124	148		0.03
	8-16	143	116		0.04

Loads Summary

See Loadcase Report for loading combinations and additional details.

Gable webs are attached with min. 1x3 20 ga. plates. The max. rake overhang = 1/2 the truss spacing. If this truss is exposed to wind loads perpendicular to the plane of the truss, it must be braced according to a standard detail matching the wind criteria shown, or according to the Construction Documents and/or BCSI - B3.

Plates designed for Cq at 0.80 and Rotational Tolerance of 10.0 degrees

Plates located at TC pitch breaks meet the prescriptive minimum size requirement to transfer unblocked diaphragm loads across those joints.

Designed with hybrid plate values. See TD-SUB-0001 for info.

This truss is not symmetric - proper orientation is critical.


TrussSpan	Limit	Actual (in)	Location
Vert LL	L/360	L/999 (-0.00)	14-15
Vert DL	L/120	L/999 (-0.00)	14-15
Vert CR	L/240	L/999 (-0.00)	14-15
Horz LL	0.75in	(0.00)	@Jt 1
Horz CR	1.25in	(0.00)	@Jt 1
Ohng CR	2L/240	2L/999 (0.00)	1- 1
Ohng CR	2L/240	2L/999 (0.00)	9- 9

```
-----Bracing Data-----
Chords; continuous except where shown
Web Bracing -- None
```

(None unless indicated below)
Jnt14(0,-00-08)

SID:
TID: 2214224-08...
Date: 01 / 16 / 23
Page: 1 of 1

Truss Mfr. Contact: System Administrator

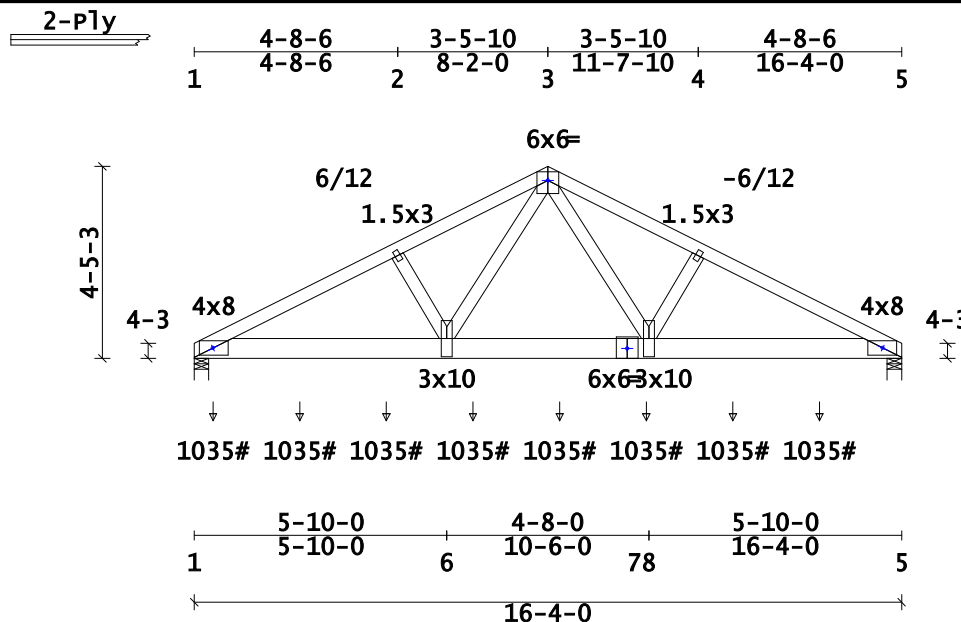

Truss Weight = 185.6 lb

Code/Design: IRC-2015/TFP-2014										-----Snow Load Specs-----										-----Wind Load Specs-----										-----Additional Design Checks-----									
FSF		Live		Dead				Dur Factors		ASCE7-10 Ground Snow (Pg) = 20.0 psf										ASCE7-10 Wind Speed(V) = 115 mph										10 psf Non-Concurrent BCLL: Yes									
TC		0.0		10.0				Live Wind Snow		Risk Cat: II Terrain Cat: C										Risk Cat: II Exposure Cat: C										20 psf BC Limited Storage: Yes									
BC		2.0		10.0		Lum		1.15 1.60 1.15		Roof Exposure: Partially Exposed										Bldg Dims: L = 36.0 ft B = 36.0 ft										200 lb BC Accessible Ceiling: No									
Total		40.0		0.0		Plt		1.15 1.60 1.15		Thermal Condition: Cold Ventilated(1.1)										M.R.R.(h) = 25.0 ft Kzt = 1.0										300 lb TC Maintenance Load: No									
Spacing: 2-00-00 o.c. Plies: 2										Unobstructed Slippery Roof: No										Bldg Enclosure: Enclosed										2000 lb TC Safe Load: No									
Repetitive Member Increase: No										Low-Slope Minimums(Pfmin): No										Wind DL(psf): TC = 5.0 BC = 5.0										Unbalanced TCLL: Yes									
Green Lumber: No Wet Service: No										Unbalanced Snow Loads: Yes										End Vertical Exposed: L = Yes R = Yes																			
Fib Tolerance: 20% Creep (Kcr) = 2.0										Rain Surcharge: No Ice Dam Chk: No										Wind Uplift Reporting: ASCE7 MWFRS																			
OH Soffit Load: 2.0 psf										Lu(max) = 20-00-00										C&C End Zone: 4-00-00																			

TC	2x4	SP	(ALSC6-2013)	#2
BC	2x6	SP	2400/2.0	
Webs	2x4	SP	(ALSC6-2013)	#3/Stud

Max CSI in TC PANEL	1 - 2	0.58
Max CSI in BC PANEL	1 - 6	0.63
Max CSI in Web	3 - 8	0.75

...	Mem...	Ten	Comp	.CSI..
TC	1- 2	1264	7304	0.58
	2- 3	1276	7196	0.31
	3- 4	1277	7205	0.33
	4- 5	1265	7314	0.57
BC	1- 6	6512	1088	0.63
	5- 8	6518	1089	0.57
	6- 7	4526	711	0.42
	7- 8	4526	711	0.36
Web	2- 6	239	273	0.03
	3- 6	3596	613	0.74
	3- 8	3647	616	0.75
	4- 8	241	263	0.03

Reaction Summary (Lbs)								
Jnt	--X-Loc-	React	-Up-	--Width-	-Reqd	-Mat	PSI	
1	02-00	5166	876	04-00	03-10	SPF	478	
5	16-02-00	4420	750	04-00	03-01	SPF	478	
Max Horiz =		-78 /	+78	at Joint		1		

This truss has been designed for the effects of an unbalanced top chord live load occurring at [8-02-00] using a 1.00 Full and 0.00 Reduced load factor.

See Loadcase Report for loading combinations and additional details.

Loads based on maximum and minimum reactions from tie-in spans

Mbr	Max	Min	Location	Dir	Description
Transfer loads:					
BC	1035	-175	05-04	Vert	T02 @ -90 Deg
BC	1035	-175	2-05-04	Vert	T02 @ -90 Deg
BC	1035	-175	4-05-04	Vert	T02 @ -90 Deg
BC	1035	-175	6-05-04	Vert	T02 @ -90 Deg
BC	1035	-175	8-05-04	Vert	T02 @ -90 Deg
BC	1035	-175	10-05-04	Vert	T02 @ -90 Deg
BC	1035	-175	12-05-04	Vert	T02 @ -90 Deg
BC	1035	-175	14-05-04	Vert	T02 @ -90 Deg

Fasten each ply to the adjacent ply as follows (rows staggered):

TC 2x4, 1-row(s) of 0.131" dia. x 3.0" Nails @ 12.0" o.c.

BC 2x6, 2-row(s) of 0.131" dia. x 3.0" Nails @ 12.0" o.c.

WB 2x4, 1-row(s) of 0.131" dia. x 3.0" Nails @ 9.0" o.c.

Notes

Notes

Plates designed for Cq at 0.80 and Rotational Tolerance of 10.0 degrees

Plates located at TC pitch breaks meet the prescriptive minimum size


plates located at tie pitch breaks meet the prescriptive minimum size requirement to transfer unblocked diaphragm loads across those joints.

Designed with hybrid plate values. See TD-SUB-0001 for info.

TrussSpan	Limit	Actual (in)	Location
Vert LL	L/360	L/999 (-0.11)	8- 5
Vert DL	L/120	L/999 (-0.11)	8- 5
Vert CR	L/240	L/884 (-0.22)	8- 5
Horz LL	0.75in	(0.02)	@Jt 5
Horz CR	1.25in	(0.05)	@Jt 5

```
-----Bracing Data-----
Chords; continuous except where shown
Web Bracing -- None
```

(None unless indicated below)
Jnt1(00-03,0), Jnt3(0,-00-09),
Jnt5(-00-03,0), Jnt7(0,00-04)

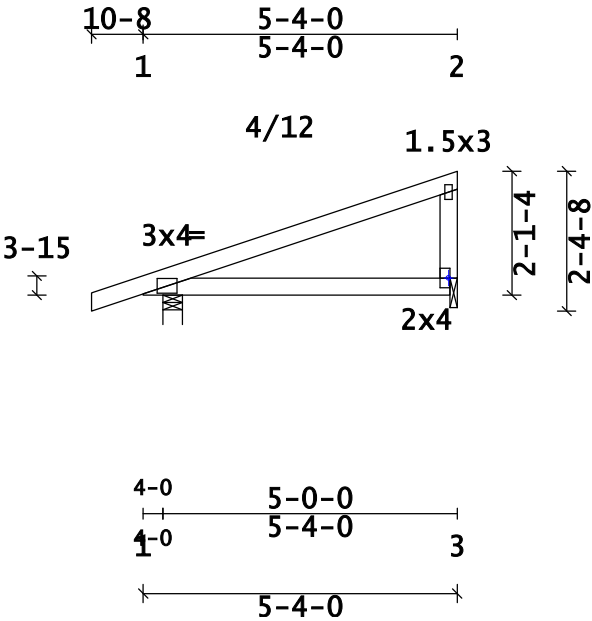

Truss Weight = 19.5 lb

Code/Design: IRC-2015/TPI-2014	-----Snow Load Specs-----	-----Wind Load Specs-----	-----Additional Design Checks-----
PSF Live Dead Dur Factors	ASCE7-10 Ground Snow(Pg) = 20.0 psf	ASCE7-10 Wind Speed(V) = 115 mph	10 psf Non-Concurrent BCLL: Yes
TC 20.0 10.0 Live Wind Snow	Risk Cat: II Terrain Cat: C	Risk Cat: II Exposure Cat: C	20 psf BC Limited Storage: Yes
BC 0.0 10.0 Lum 1.15 1.60 1.15	Roof Exposure: Partially Exposed	Bldg Dims: L = 36.0 ft B = 36.0 ft	200 lb BC Accessible Ceiling: No
Total 40.0 Plt 1.15 1.60 1.15	Thermal Condition: Cold Ventilated(1.1)	M.R.H(h) = 25.0 ft Kzt = 1.0	300 lb TC Maintenance Load: No
Spacing: 2-00-00 o.c. Plies: 1	Unobstructed Slippery Roof: No	Bldg Enclosure: Enclosed	2000 lb TC Safe Load: No
Repetitive Member Increase: Yes	Low-Slope Minimums(Pfmin): No	Wind DL(psf): TC = 5.0 BC = 5.0	Unbalanced TCCLL: Yes
Green Lumber: No Wet Service: No	Unbalanced Snow Loads: Yes	End Vertical Exposed: L = Yes R = Yes	
Fab Tolerance: 20% Creep (Kcr) = 2.0	Rain Surcharge: No Ice Dam Chk: No	Wind Uplift Reporting: ASCE7 MWFRS	
OH Soffit Load: 2.0 psf		C&C End Zone: 4-00-00	

Material Summary				
TC	2x4	SP (ALSC6-2013)	#2	
BC	2x4	SP (ALSC6-2013)	#2	
Webs	2x4	SP (ALSC6-2013)	#3/Stud	

Member Forces Summary				
Max CSI in TC PANEL	1 - 2	0.33		
Max CSI in BC PANEL	1 - 3	0.22		
Max CSI in Web	3 - 2	0.10		

...Mem...	Ten	Comp	CSI.
TC OH- 1	20	0	0.08
1- 2	39	96	0.33
2-OH	0	2	0.00
BC 1- 3	177	43	0.22
Web 2- 3	197	134	0.10

Reaction Summary									
-----Reaction Summary(Lbs)-----									
Jnt	--X-Loc-	React	-Up-	--Width-	-Reqd	-Mat	PSI		
1	06-00	296	60	04-00	01-08	SPF	531		
3	5-02-04	190	40	01-08	01-08	SPF	425		
Max Horiz	=		-6 /	+67	at Joint	1			
Max Horiz	=		-6 /	+67	at Joint	3			

Loads Summary

This truss has been designed for the effects of an unbalanced top chord live load occurring at [5-04-00] using a 1.00 Full and 0.00 Reduced load factor.

See Loadcase Report for loading combinations and additional details.

Notes

Plates designed for Cq at 0.80 and Rotational Tolerance of 10.0 degrees

Plates located at TC pitch breaks meet the prescriptive minimum size requirement to transfer unblocked diaphragm loads across those joints.

Designed with hybrid plate values. See TD-SUB-0001 for info.

Deflection Summary				
TrussSpan	Limit	Actual(in)	Location	
Vert LL	L/360	L/999(-0.02)	1- 3	
Vert DL	L/120	L/999(-0.03)	1- 3	
Vert CR	L/240	L/999(-0.05)	1- 3	
Horz LL	0.75in	(0.01)	@Jt 1	
Horz CR	1.25in	(0.01)	@Jt 1	
Ohng CR	2L/240	2L/999(0.00)	1- 1	

Bracing Data Summary

-----Bracing Data-----

Chords; continuous except where shown

Web Bracing -- None

Plate offsets (X, Y):


(None unless indicated below)

Jnt3(-00-12,0)

Customer: Stark Truss

SID:
TID: 2214224-08...
Date: 01 / 16 / 23
Page: 1 of 1

Truss Mfr. Contact: System Administrator

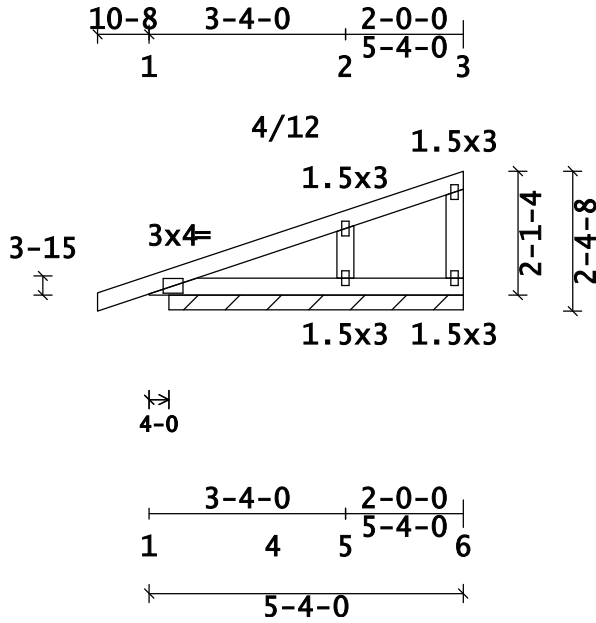

Truss Weight = 21.2 lb

Code/Design: IRC-2015/TPI-2014
PSF Live Dead Dur Factors
TC 20.0 10.0 Live Wind Snow
BC 0.0 10.0 Lum 1.15 1.60 1.15
Total 40.0 Plt 1.15 1.60 1.15
Spacing: 2-00-00 o.c. Plies: 1
Repetitive Member Increase: Yes
Green Lumber: No Wet Service: No
Fab Tolerance: 20% Creep (Kcr) = 2.0
OH Soffit Load: 2.0 psf

-----Snow Load Specs-----
ASCE7-10 Ground Snow (Pg) = 20.0 psf
Risk Cat: II Terrain Cat: C
Roof Exposure: Partially Exposed
Thermal Condition: Cold Ventilated(1.1)
Unobstructed Slippery Roof: No
Low-Slope Minimums(Pfmin): No
Unbalanced Snow Loads: Yes
Rain Surcharge: No Ice Dam Chk: No

-----Wind Load Specs-----
ASCE7-10 Wind Speed (V) = 115 mph
Risk Cat: II Exposure Cat: C
Bldg Dims: L = 36.0 ft B = 36.0 ft
M.R.H(h) = 25.0 ft Kzt = 1.0
Bldg Enclosure: Enclosed
Wind DL(psf): TC = 5.0 BC = 5.0
End Vertical Exposed: L = Yes R = Yes
Wind Uplift Reporting: ASCE7 MWFRS
C&C End Zone: 4-00-00

-----Additional Design Checks-----
10 psf Non-Concurrent BCLL: Yes
20 psf BC Limited Storage: Yes
200 lb BC Accessible Ceiling: No
300 lb TC Maintenance Load: No
2000 lb TC Safe Load: No
Unbalanced TCCLL: Yes

Material Summary

TC	2x4	SP (ALSC6-2013)	#2
BC	2x4	SP (ALSC6-2013)	#2
Webs	2x4	SP (ALSC6-2013)	#3/Stud

Member Forces Summary

Max CSI in TC PANEL	1 - 1	0.08
Max CSI in BC PANEL	1 - 4	0.06
Max CSI in Web	6 - 3	0.08

...Mem...	Ten	Comp	.CSI.
TC 1- 3	25	130	0.08
BC 1- 6	177	43	0.06
Web 2- 5	231	153	0.07
3- 6	75	49	0.08

Reaction Summary

Reactions not shown: down < 400 and up < 150
---- Reaction Summary (plf) ----
Jnt-Jnt React -Up- --Width-
1- 6 96 19 5-00-00
Max Horiz = -6 / +67 at Joint 5

Loads Summary

This truss has been designed for the effects of an unbalanced top chord live load occurring at [5-04-00] using a 1.00 Full and 0.00 Reduced load factor.

See Loadcase Report for loading combinations and additional details.

Notes

Gable webs are attached with min. 1x3 20 ga. plates. The max. rake overhang = 1/2 the truss spacing. If this truss is exposed to wind loads perpendicular to the plane of the truss, it must be braced according to a standard detail matching the wind criteria shown, or according to the Construction Documents and/or BCSI - B3.
Plates designed for Cq at 0.80 and Rotational Tolerance of 10.0 degrees
Plates located at TC pitch breaks meet the prescriptive minimum size requirement to transfer unblocked diaphragm loads across those joints.
Designed with hybrid plate values. See TD-SUB-0001 for info.

Deflection Summary

TrussSpan	Limit	Actual(in)	Location
Vert LL	L/360	L/999(-0.00)	5- 6
Vert DL	L/120	L/999(-0.00)	5- 6
Vert CR	L/240	L/999(-0.00)	5- 6
Horz LL	0.75in	(0.00)	@Jt 1
Horz CR	1.25in	(0.00)	@Jt 1
Ohng CR	2L/240	2L/999(0.00)	1- 1

Bracing Data Summary

-----Bracing Data-----
Chords; continuous except where shown
Web Bracing -- None

Plate offsets (X, Y):

(None unless indicated below)


Customer: Stark Truss

TID: 2214224-08...

Truss Mfr. Contact: System Administrator

Date: 01 / 16 / 23

Page: 1 of 1

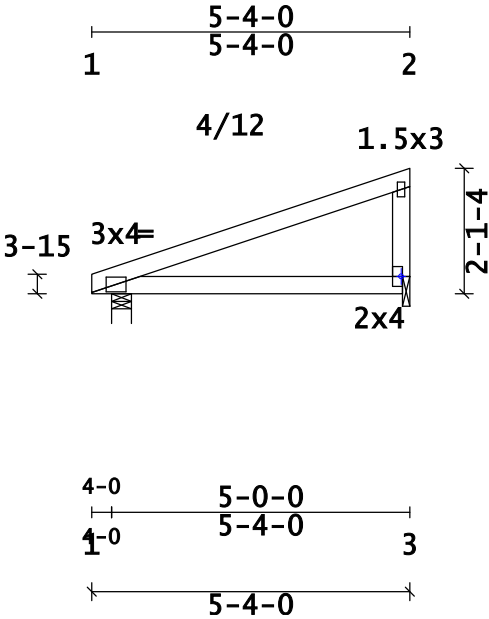

Truss Weight = 18.2 lb

Code/Design: IRC-2015/TPI-2014										-----Snow Load Specs-----										-----Wind Load Specs-----										-----Additional Design Checks-----									
PSF	Live	Dead					Dur Factors	ASCE7-10	Ground Snow (Pg) =	20.0	psf	ASCE7-10	Wind Speed (V) =	115	mph	10	psf	Non-Concurrent	BCLL:	Yes																			
TC	20.0	10.0					Live Wind Snow	Risk Cat:	II	Terrain Cat:	C	Risk Cat:	II	Exposure Cat:	C		20	psf	BC	Limited Storage:	Yes																		
BC	0.0	10.0	Lum	1.15	1.60	1.15	Roof Exposure: Partially Exposed					Bldg Dims:	L =	36.0	ft	B =	36.0	ft	200	lb	BC	Accessible Ceiling:	No																
Total	40.0	Plt	1.15	1.60	1.15	Thermal Condition: Cold Ventilated(1.1)					M.R.H(h) =	25.0	ft	Kzt =	1.0		300	lb	TC	Maintenance Load:	No																		
Spacing:	2-00-00	o.c.				Plies:	1	Unobstructed Slippery Roof: No					Bldg Enclosure:	Enclosed						2000	lb	TC	Safe Load:	No															
Repetitive Member Increase: Yes										Low-Slope Minimums (Pfmin):					No	Wind DL(psf):					TC =	5.0	BC =	5.0	Unbalanced					TCLL:	Yes								
Green Lumber: No Wet Service: No										Unbalanced Snow Loads:					Yes	End Vertical Exposed:					L =	Yes	R =	Yes															
Fab Tolerance: 20% Creep (Kcr) = 2.0										Rain Surcharge: No Ice Dam Chk:					No	Wind Uplift Reporting:					ASCE7 MWFRS																		
OH Soffit Load: 2.0 psf																				C&C End Zone: 4-00-00																			

Material Summary					Reaction Summary					Deflection Summary						
TC	2x4	SP (ALSC6-2013)	#2		-----Reaction Summary(Lbs)-----					TrussSpan	Limit	Actual(in)	Location			
BC	2x4	SP (ALSC6-2013)	#2		Jnt	--X-Loc-	React	-Up-	--Width-	-Reqd	-Mat	PSI				
Webs	2x4	SP (ALSC6-2013)	#3/Stud		1	06-00	229	37	04-00	01-08	SPF	531	Vert LL	L/360	L/999(-0.02)	1- 3
					3	5-02-04	194	43	01-08	01-08	SPF	425	Vert DL	L/120	L/999(-0.03)	1- 3
					Max Horiz	=	-15	/	+62	at Joint	1		Vert CR	L/240	L/999(-0.05)	1- 3
					Max Horiz	=	-15	/	+62	at Joint	3		Horz LL	0.75in	(0.01)	@Jt 1
													Horz CR	1.25in	(0.01)	@Jt 1
Member Forces Summary					Loads Summary					Bracing Data Summary						
Max CSI in TC PANEL	1	-	2	0.35	This truss has been designed for the effects of an unbalanced top chord					-----Bracing Data-----						
Max CSI in BC PANEL	1	-	3	0.24	live load occurring at [5-04-00] using a 1.00 Full and 0.00 Reduced load					Chords; continuous except where shown						
Max CSI in Web	3	-	2	0.11	factor.					Web Bracing -- None						
					See Loadcase Report for loading combinations and additional details.					Plate offsets (X, Y):						
					Notes					(None unless indicated below)						
					Plates designed for Cq at 0.80 and Rotational Tolerance of 10.0 degrees					Jnt3(-00-12,0)						
					Plates located at TC pitch breaks meet the prescriptive minimum size											
					requirement to transfer unblocked diaphragm loads across those joints.											
					Designed with hybrid plate values. See TD-SUB-0001 for info.											