


Per-substrate signs are unanimous but the test is structurally underpowered

Raw-arm per-substrate Cliff's δ . Eligible (≥ 4 analyzable phantoms) substrates in indigo.
v0.22 (hatched) has one analyzable phantom — pooled-only, non-inferential. Sign test runs on the four eligible substrates.

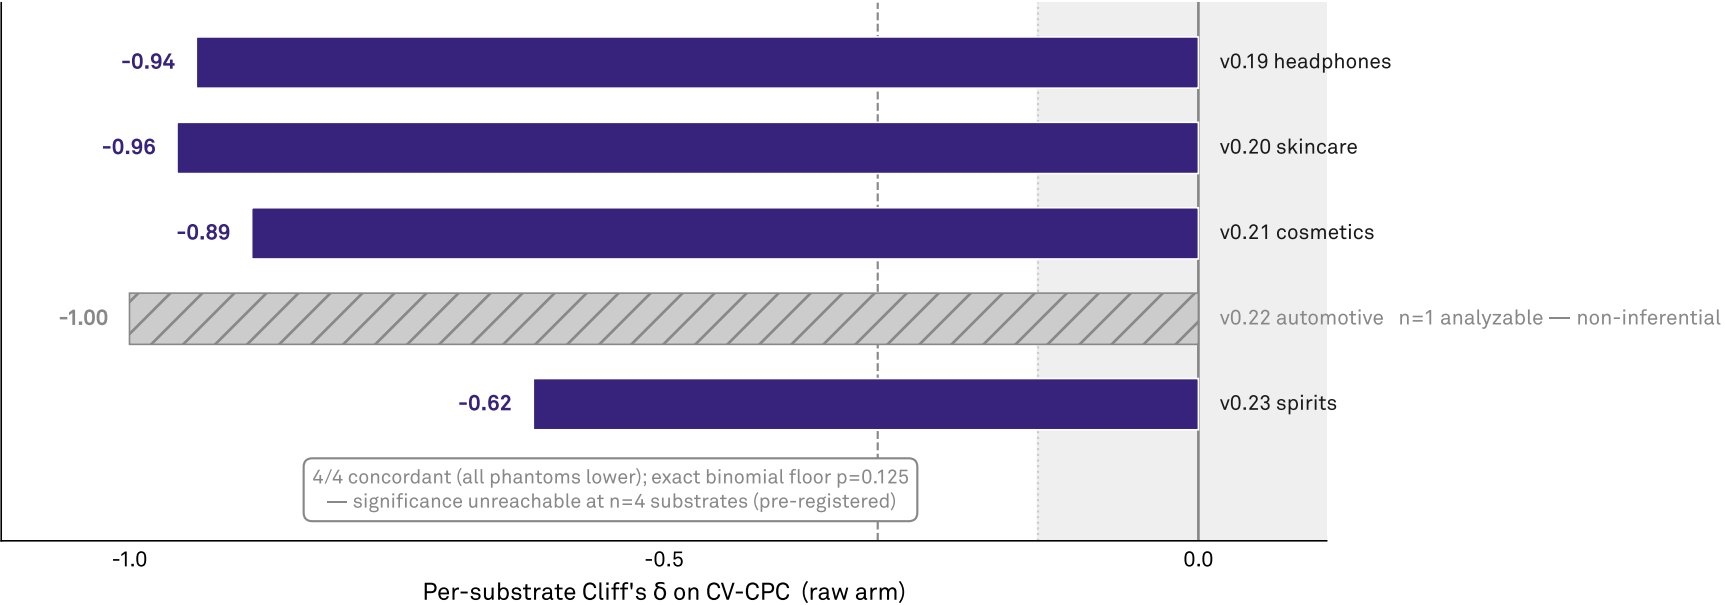

Per-substrate δ 4/4 concordant negative; binomial floor $p=0.125$ (underpowered at $n=4$).
Source: AIAS™ v0.35 (Naive-Phantom $\times$ CPC) | Protocol v0.35-prereg-r1 | Third System™