


Roster and attrition by substrate

57 phantom-flagged of 112 units; 28 excluded (all-zero recall, undefined CV); analysis set 29 analyzable vs 55 non-phantom.

Per-substrate test requires >=4 analyzable phantoms; v0.22 (one) enters pooled analysis only.

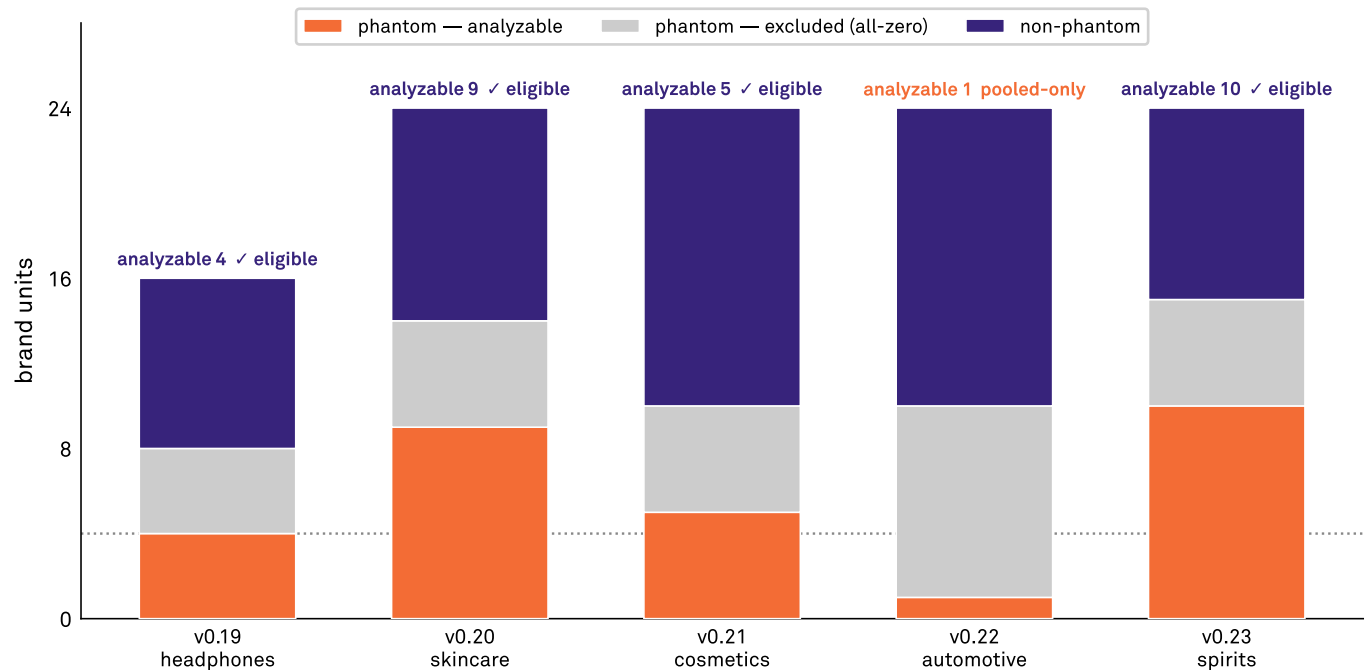

57 flagged, 29 analyzable, 28 all-zero excluded; v0.22 pooled-only. (Report figure; paper renders as §2 table.)

Source: AIAS™ v0.35 (Naive-Phantom × CPC) | Protocol v0.35-prereg-r1 | Third System™