


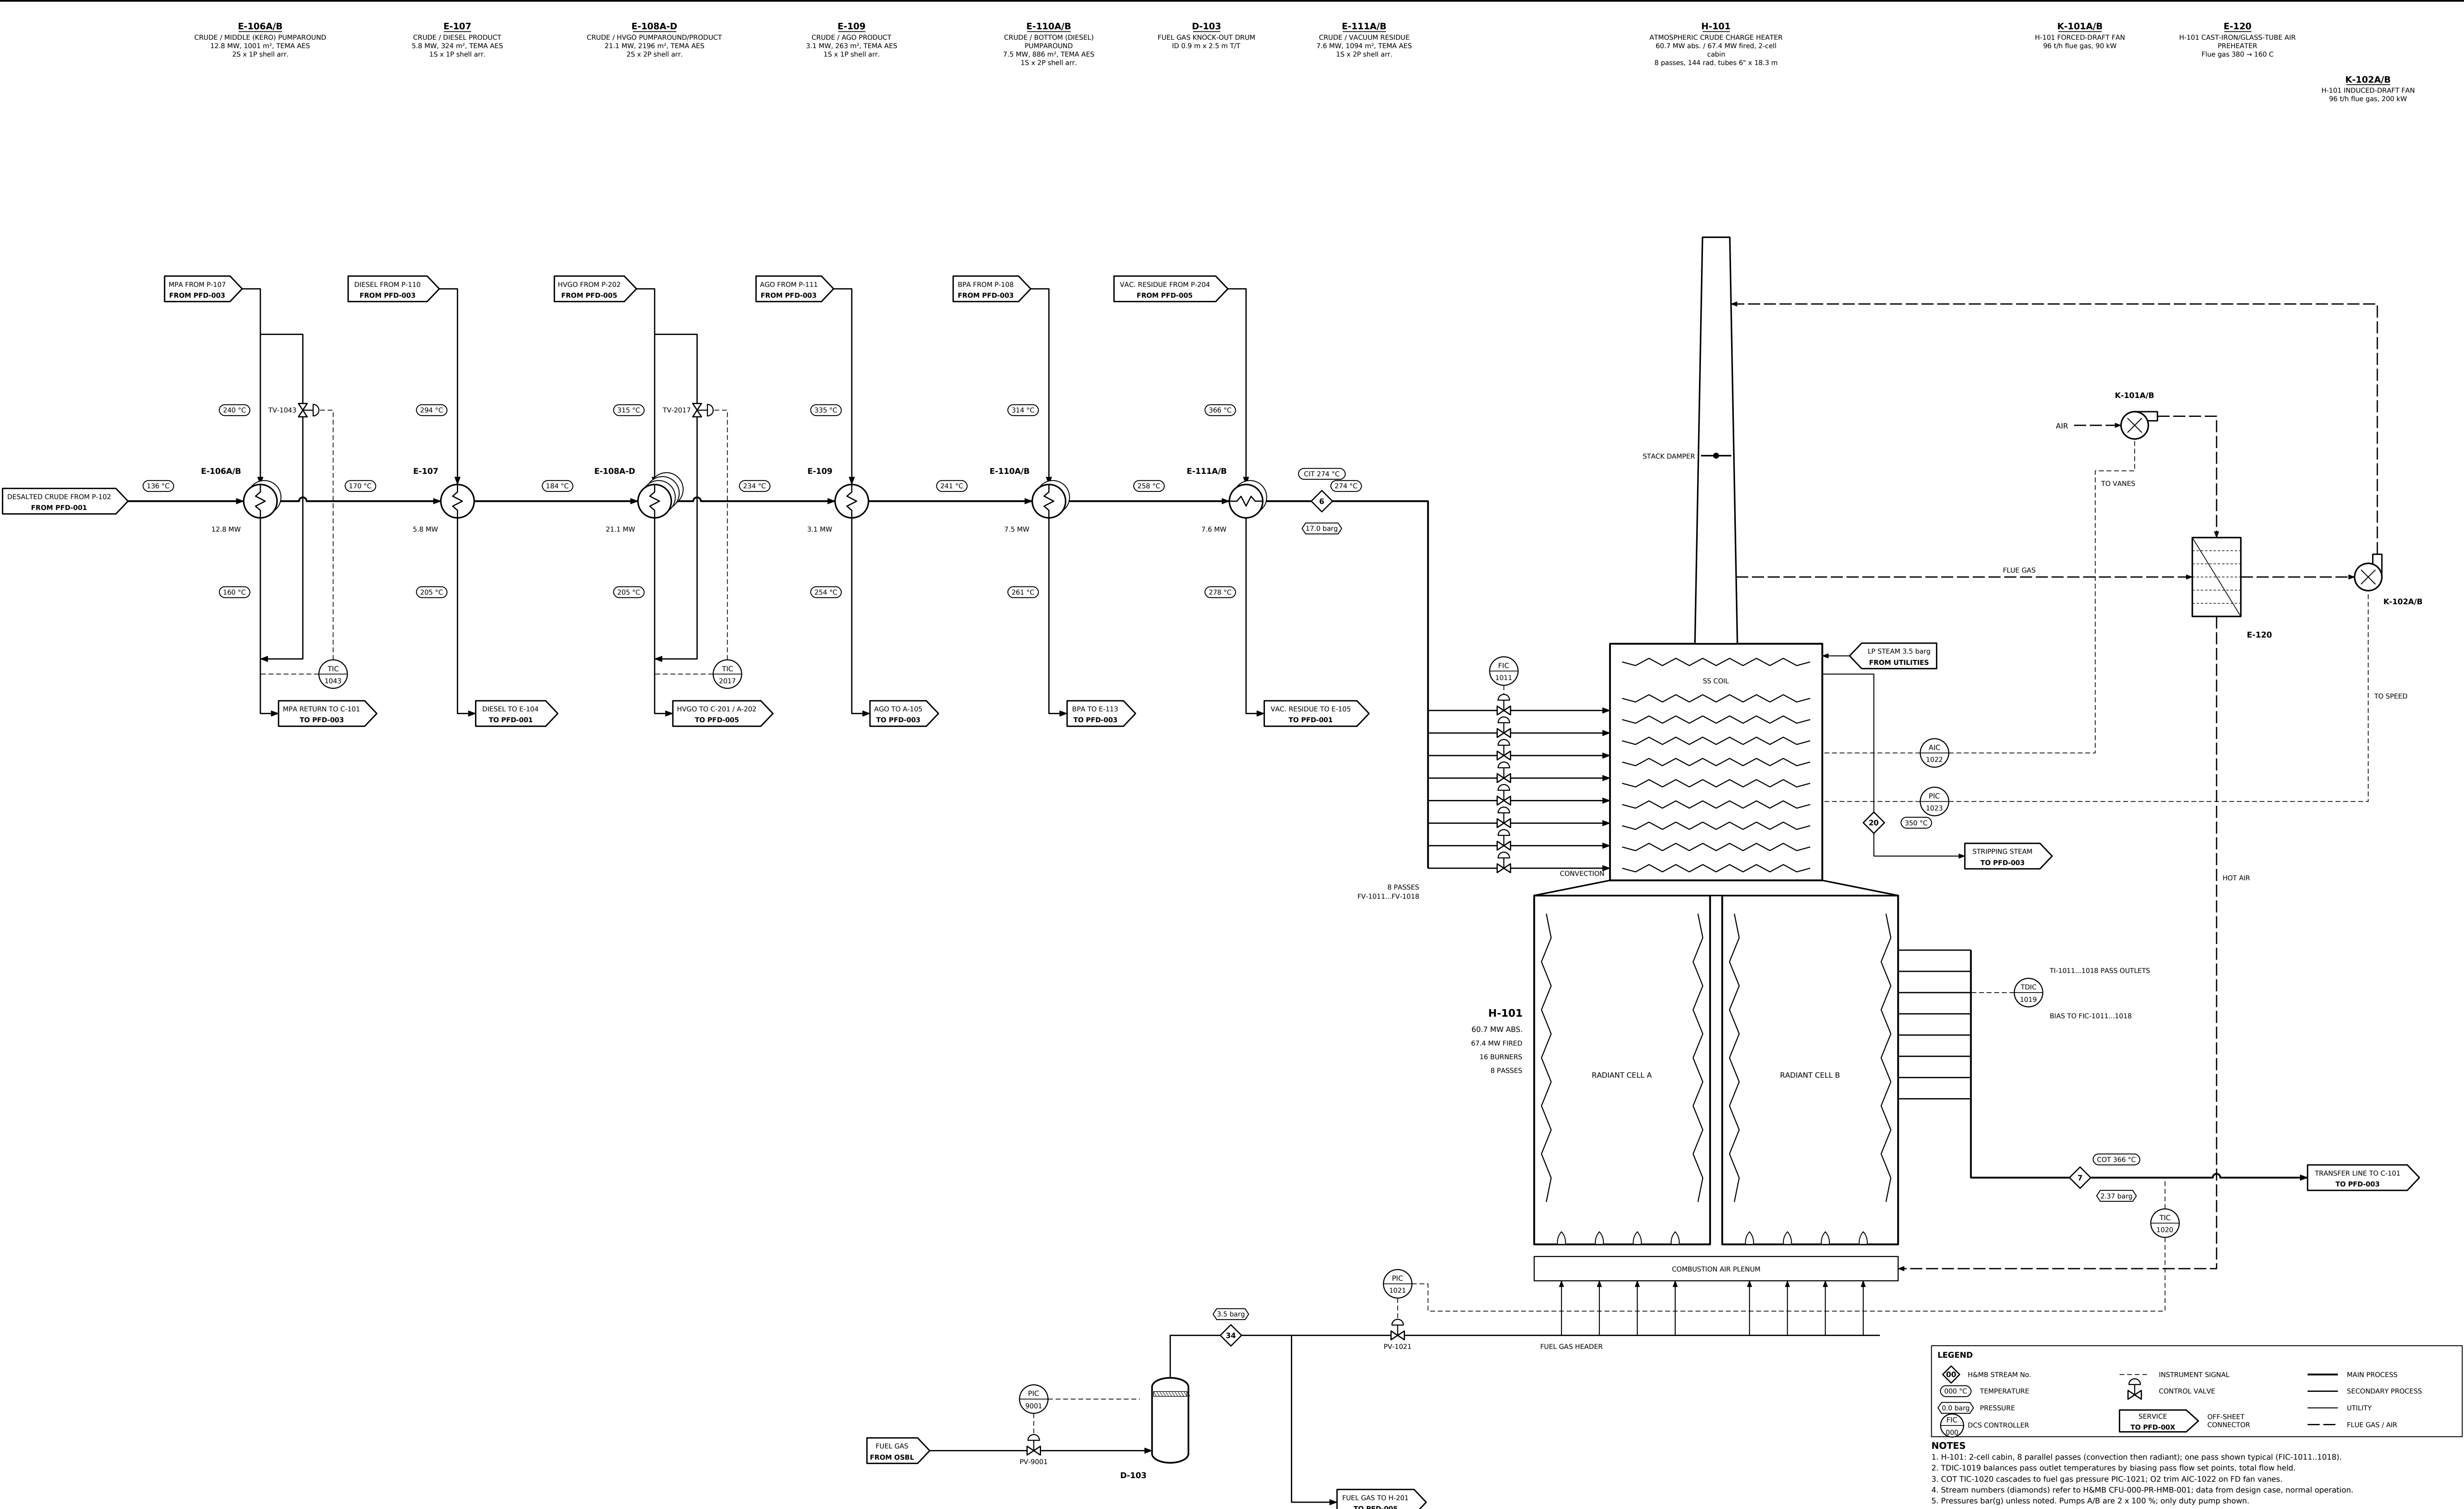

STREAM No.	6	7	20	44
DESCRIPTION	Crude to heater (CIT)	Heater outlet / transfer line	Atm stripping steam (total)	Fuel gas to heaters
PHASE	MIXED	MIXED	VAPOUR	VAPOUR
TOTAL FLOW kg/h	569,197	569,197	11,681	6,504
TEMPERATURE °C	274	366	350	30
PRESSURE barg	17.0	2.4	3.5	3.5
STD LIQ. FLOW BPSD	100,000	100,000	-	-
VAPOUR FRACTION (mass)	0.032	0.533	1	1
MOLECULAR WEIGHT	215.7	215.7	-	-

H&MB STREAM No.

TEMPERATURE

PRESSURE

DCS CONTROLLER

INSTRUMENT SIGNAL

CONTROL VALVE

SERVICE

MAIN PROCESS

SECONDARY PROCESS

UTILITY

FLUE GAS / AIR

TO PFD-00X
CONNECTOR

NOTES

1. H-101: 2-cell cabin, 8 parallel passes (convection then radiant); one pass shown typical (FIC-1011..1018).

2. TDIC-1019 balances pass outlet temperatures by biasing pass flow set points, total flow held.

3. COT TIC-1020 cascades to fuel gas pressure PIC-1021; O2 trim AIC-1022 on FD fan vanes.

4. Stream numbers (diamonds) refer to H&MB CFU-000-PR-HMB-001; data from design case, normal operation.

5. Pressures bar(g) unless noted. Pumps A/B are 2 x 100 %; only duty pump shown.

REV	DATE	DESCRIPTION	
A	2026-10-02	Issued for review (FEED)	
GENERIC REFINERY - GULF COAST			
100 KBPSD CRUDE & VACUUM DISTILLATION UNIT			
PROCESS FLOW DIAGRAM			
HOT PREHEAT TRAIN & ATMOSPHERIC HEATER H-101			
DISCIPLINE	STAGE	SCALE	SHEET
PROCESS	FEED	NTS	2 OF 6
DRAWN	CHECKED	APPROVED	DATE
CLAUDE CODE	-	-	2026-10-02
DRAWING NUMBER			REV
CFU-100-PR-PFD-002			A