


C-101
Atmospheric crude fractionator
ID 6.9 m (top/main) / 4.1 m (stripping) x 36.0 m T/T
DESIGN 3.5 barg / 390 C, CA 3 mm
41 valve trays (2/4-pass), 4105; Monel-lined top 5 trays
MATL CS + 4105 clad below tray 10; Monel 400 lined top head & trays 1-5

P-112A/B
Atm. residue / vacuum heater charge
RATED 398 m3/h @ 172 m, dP 12 bar
MOTOR 250 kW, API 602 Plan 538
DES. T 380 C; MATL A-8 (316)

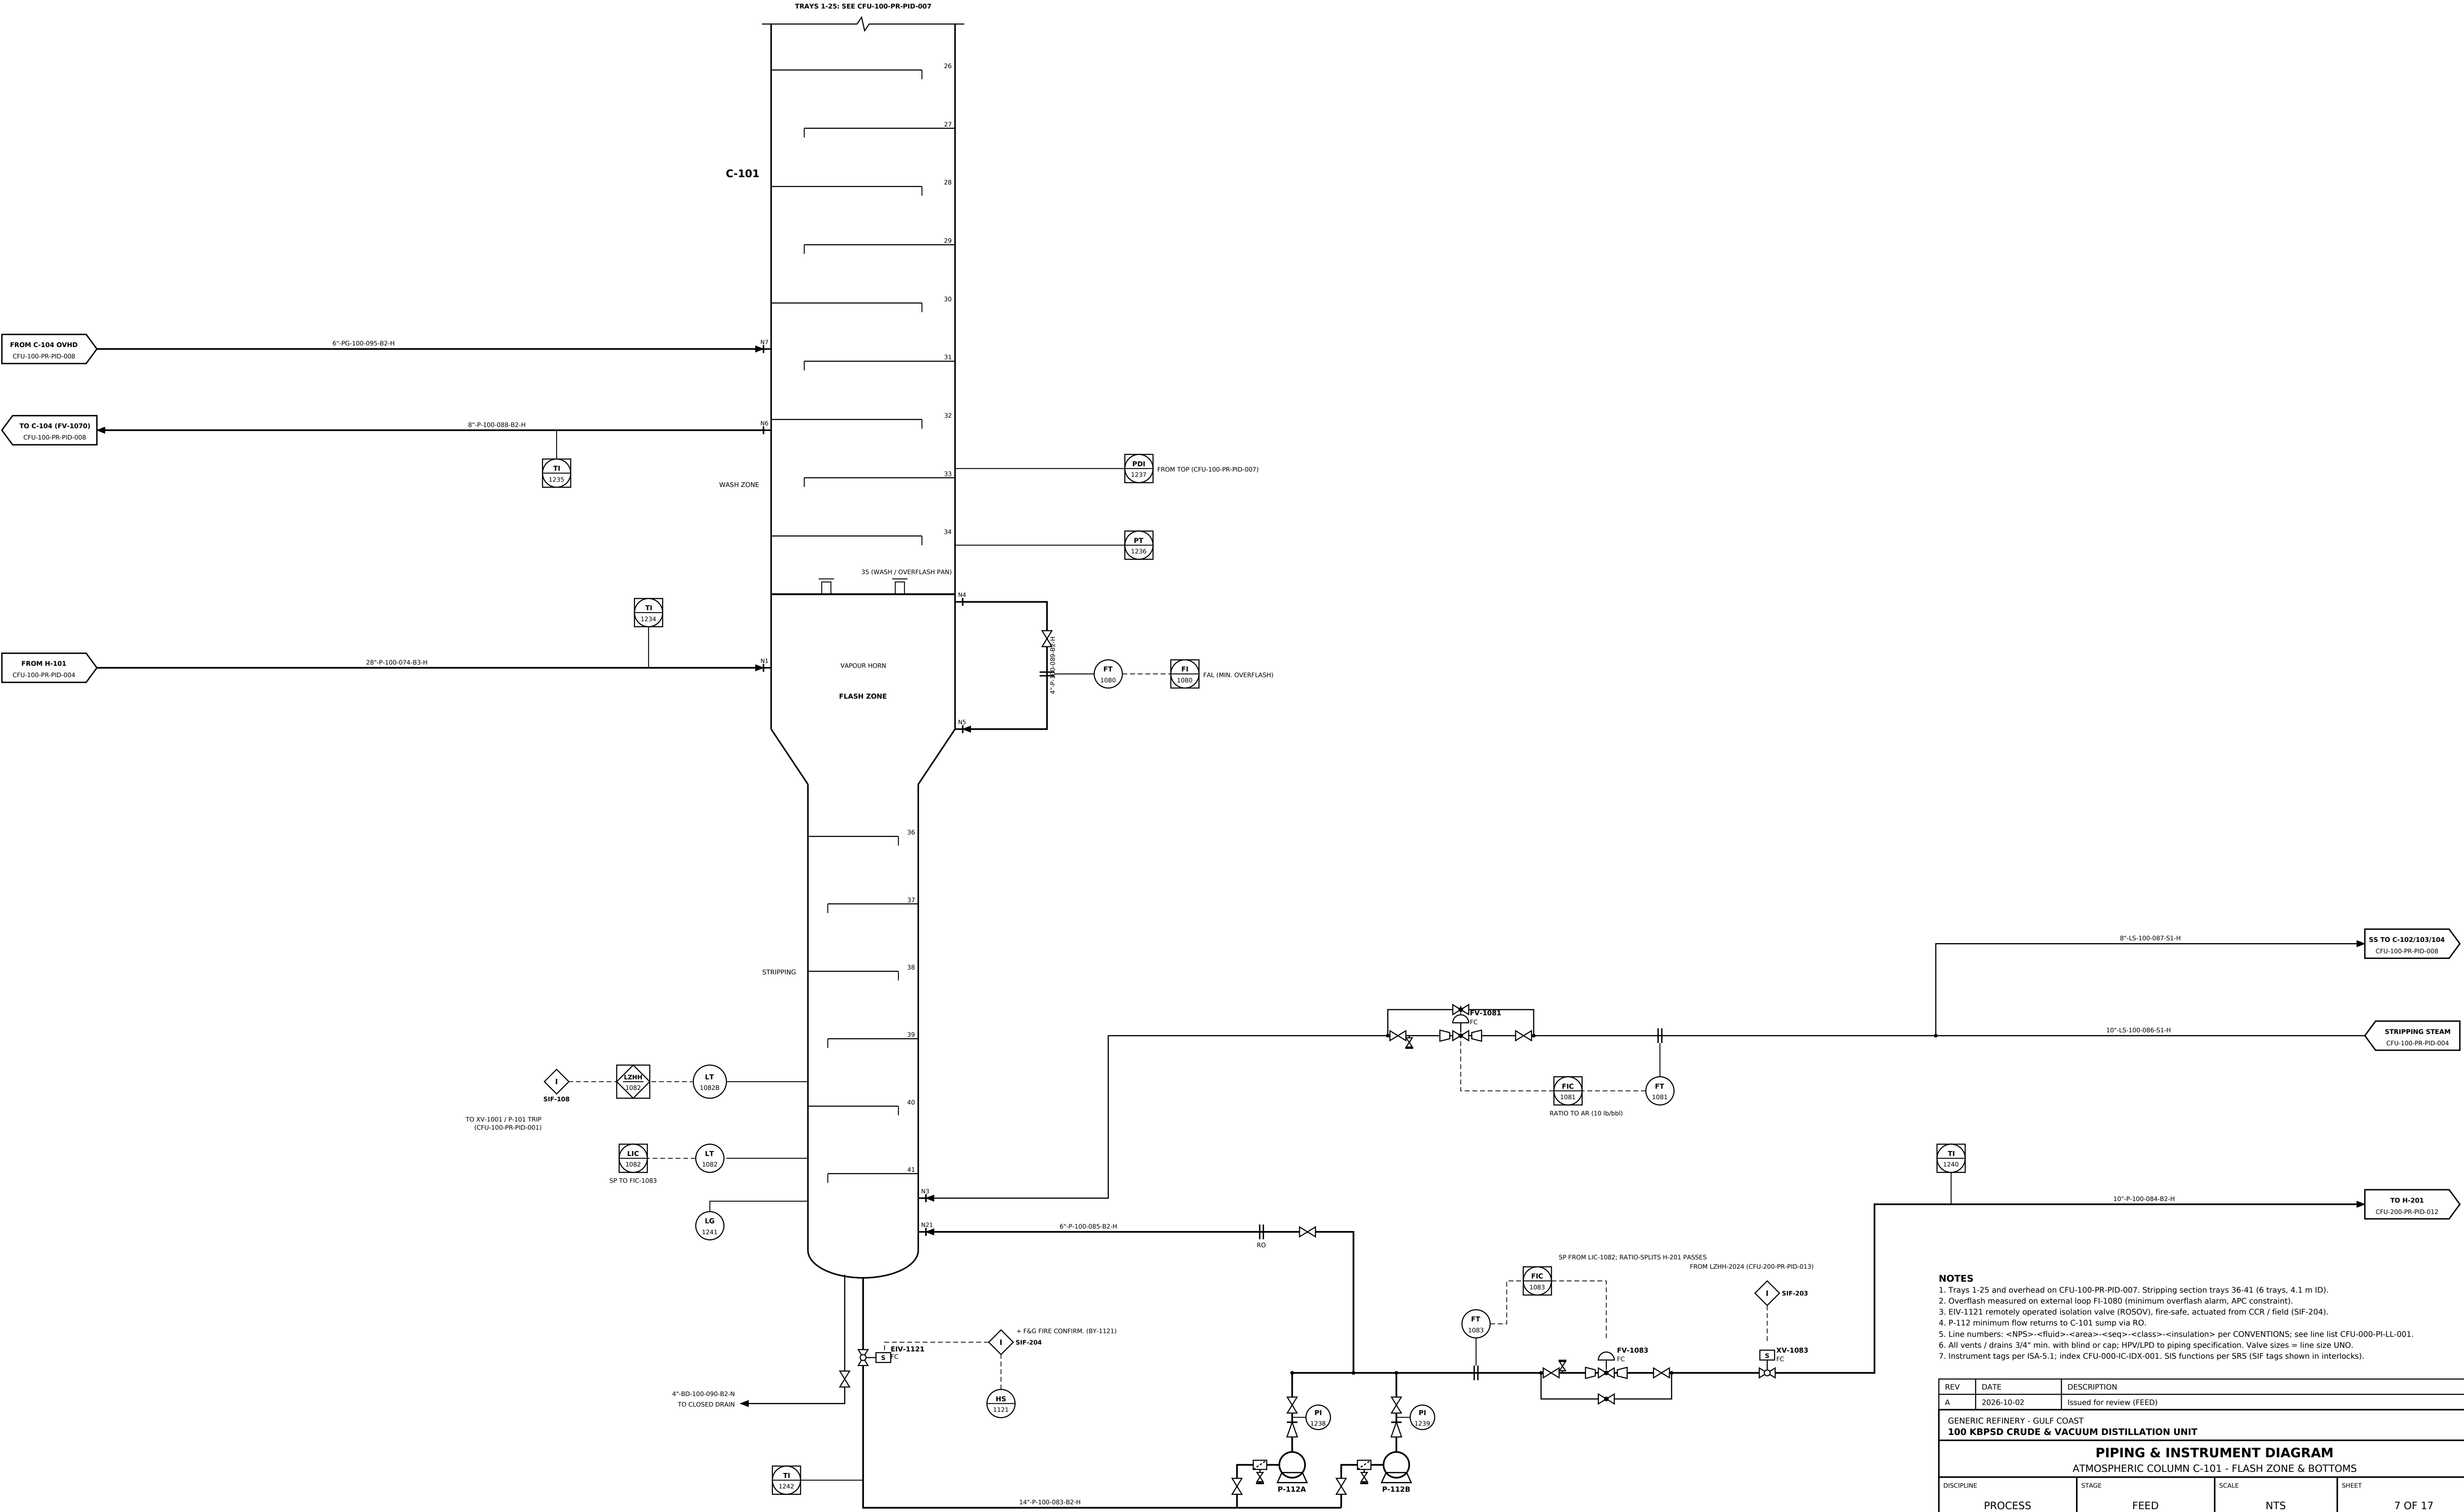

- NOTES**
- 1. Trays 1-25 and overhead on CFU-100-PR-PID-007. Stripping section trays 36-41 (6 trays, 4.1 m ID).
 - 2. Overflash measured on external loop FI-1080 (minimum overflash alarm, APC constraint).
 - 3. EVV-1121, remotely operated isolation valve (ROSOV), fire-safe, actuated from CCR / field (SIF-204).
 - 4. P-112 minimum flow returns to C-101 sump via RO.
 - 5. Line numbers: <NPS>-<fluid>-<area>-<seq>-<class>-<insulation> per CONVENTIONS; see line list CFU-000-PI-LL-001.
 - 6. All vents / drains 3/4" min. with blind or cap; HPV/LPD to piping specification. Valve sizes = line size UNO.
 - 7. Instrument tags per ISA-5.1; index CFU-000-IC-IDX-001. SIS functions per SRS (SIF tags shown in interlocks).

REV	DATE	DESCRIPTION		
A	2026-10-02	Issued for review (FEED)		
GENERIC REFINERY - GULF COAST				
100 KBPSD CRUDE & VACUUM DISTILLATION UNIT				
PIPING & INSTRUMENT DIAGRAM				
ATMOSPHERIC COLUMN C-101 - FLASH ZONE & BOTTOMS				
DISCIPLINE		STAGE	SCALE	SHEET
PROCESS		FEED	NTS	7 OF 17
DRAWN		CHECKED	APPROVED	DATE
CLAUDE CODE		-	-	2026-10-02
DRAWING NUMBER				REV
CFU-100-PR-PID-006				A