


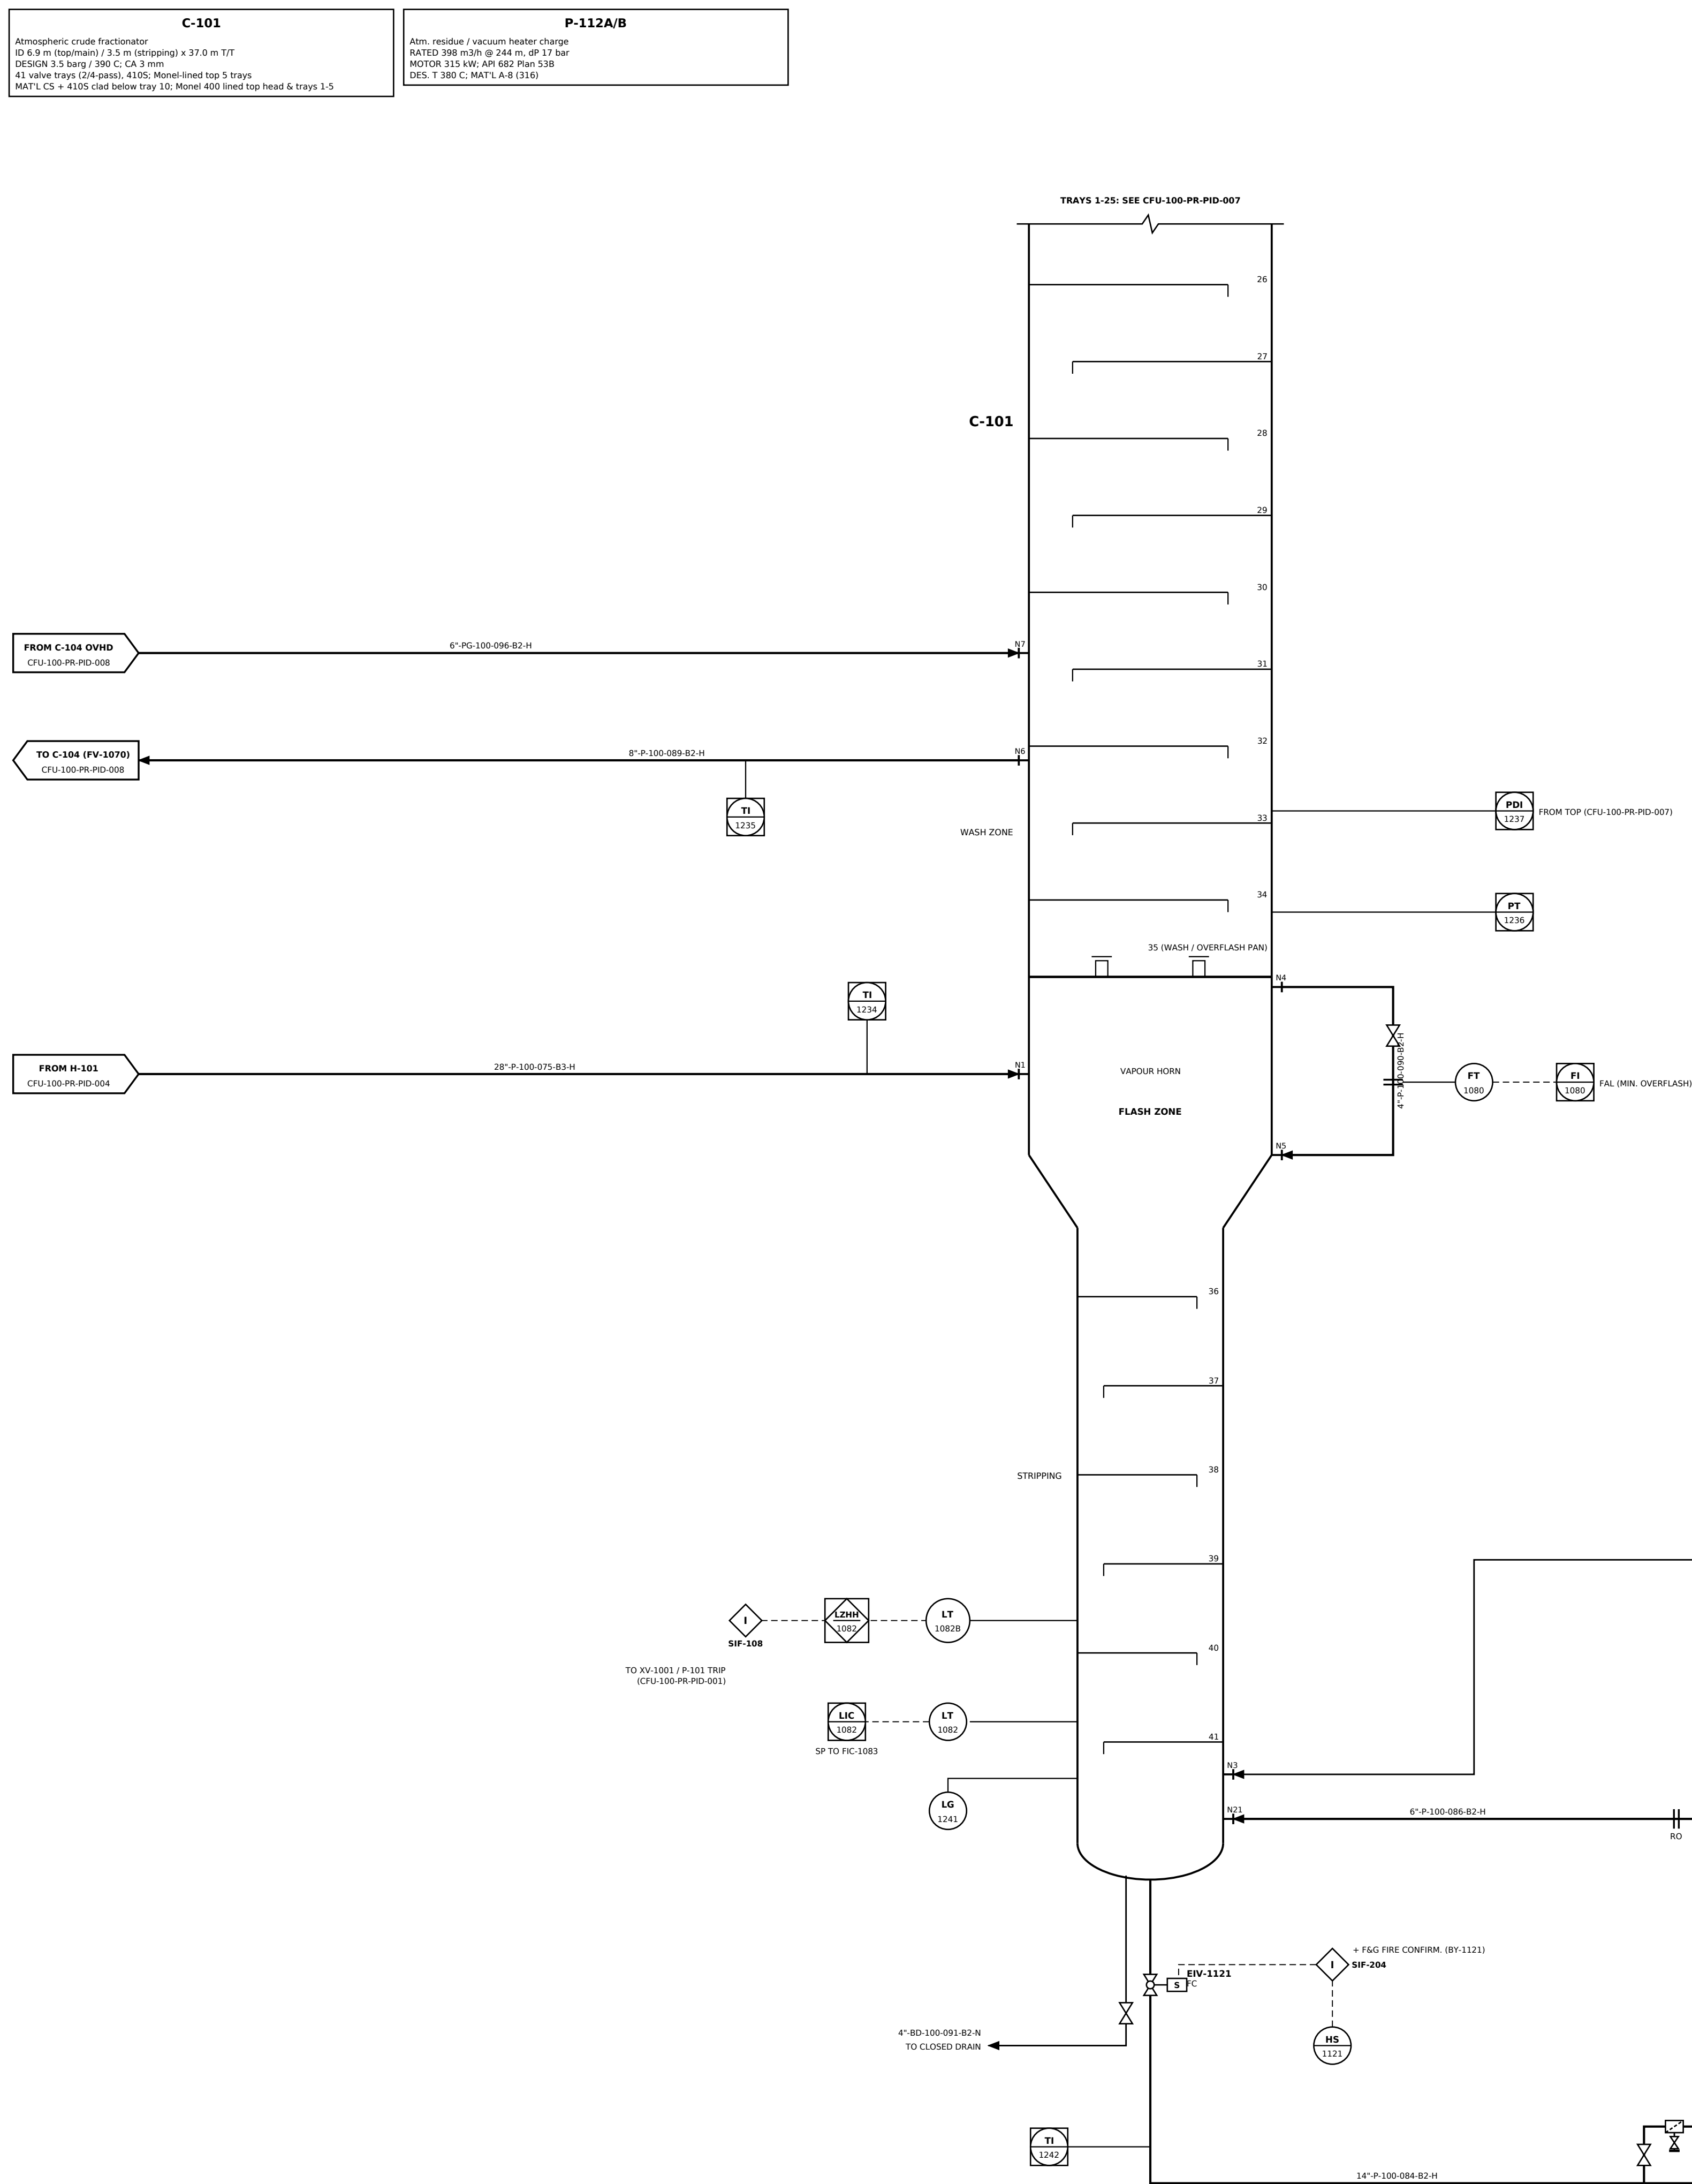

- ## NOTES
- 1. Trays 1-25 and overhead on CFU-100-PR-PID-007. Striping section trays 36-41 (6 trays, 4.1 m ID).
 - 2. Overflash measured on external loop FI-1080 (minimum overflow alarm, APC controlled).
 - 3. EIV-1121 remotely operated isolation valve (ROSOV), fire-safe, actuated from CCR / SIF (SF-204).
 - 4. P-112 minimum flow returns to C-101 pump via RO.
 - 5. Line numbers: <P>-><F>-><C>-><S>-><D>-><C>-><I>-><M>-><P> CONVENTIONS; see line list CFU-000-PI-L-001.
 - 6. All vents / drains 3/4" min. with blind or cap; HPV/PID to piping specification. Valsize = line size UNO.
 - 7. Instrument tags per ISA-S.1; include CFU-000-CIX-IDX-001. SIFs specified per SRS [SIF tags shown in interlocks].

REV	DATE	DESCRIPTION		
A	2026-10-02	Issued for review (FEED)		
GENERIC REFINERY - GULF COAST 100 KBPSD CRUDE & VACUUM DISTILLATION UNIT				
PIPING & INSTRUMENT DIAGRAM ATMOSPHERIC COLUMN C-101 - FLASH ZONE & BOTTOMS				
DISCIPLINE	STAGE	FEED	SCALE	SHEET
PROCESS			NTS	7 OF 17
DRAWN	CHECKED	APPROVED	DATE	
CLAUDE CODE	-	-	2026-10-02	
DRAWING NUMBER				REV
CFU-100-PR-PID-006				A