


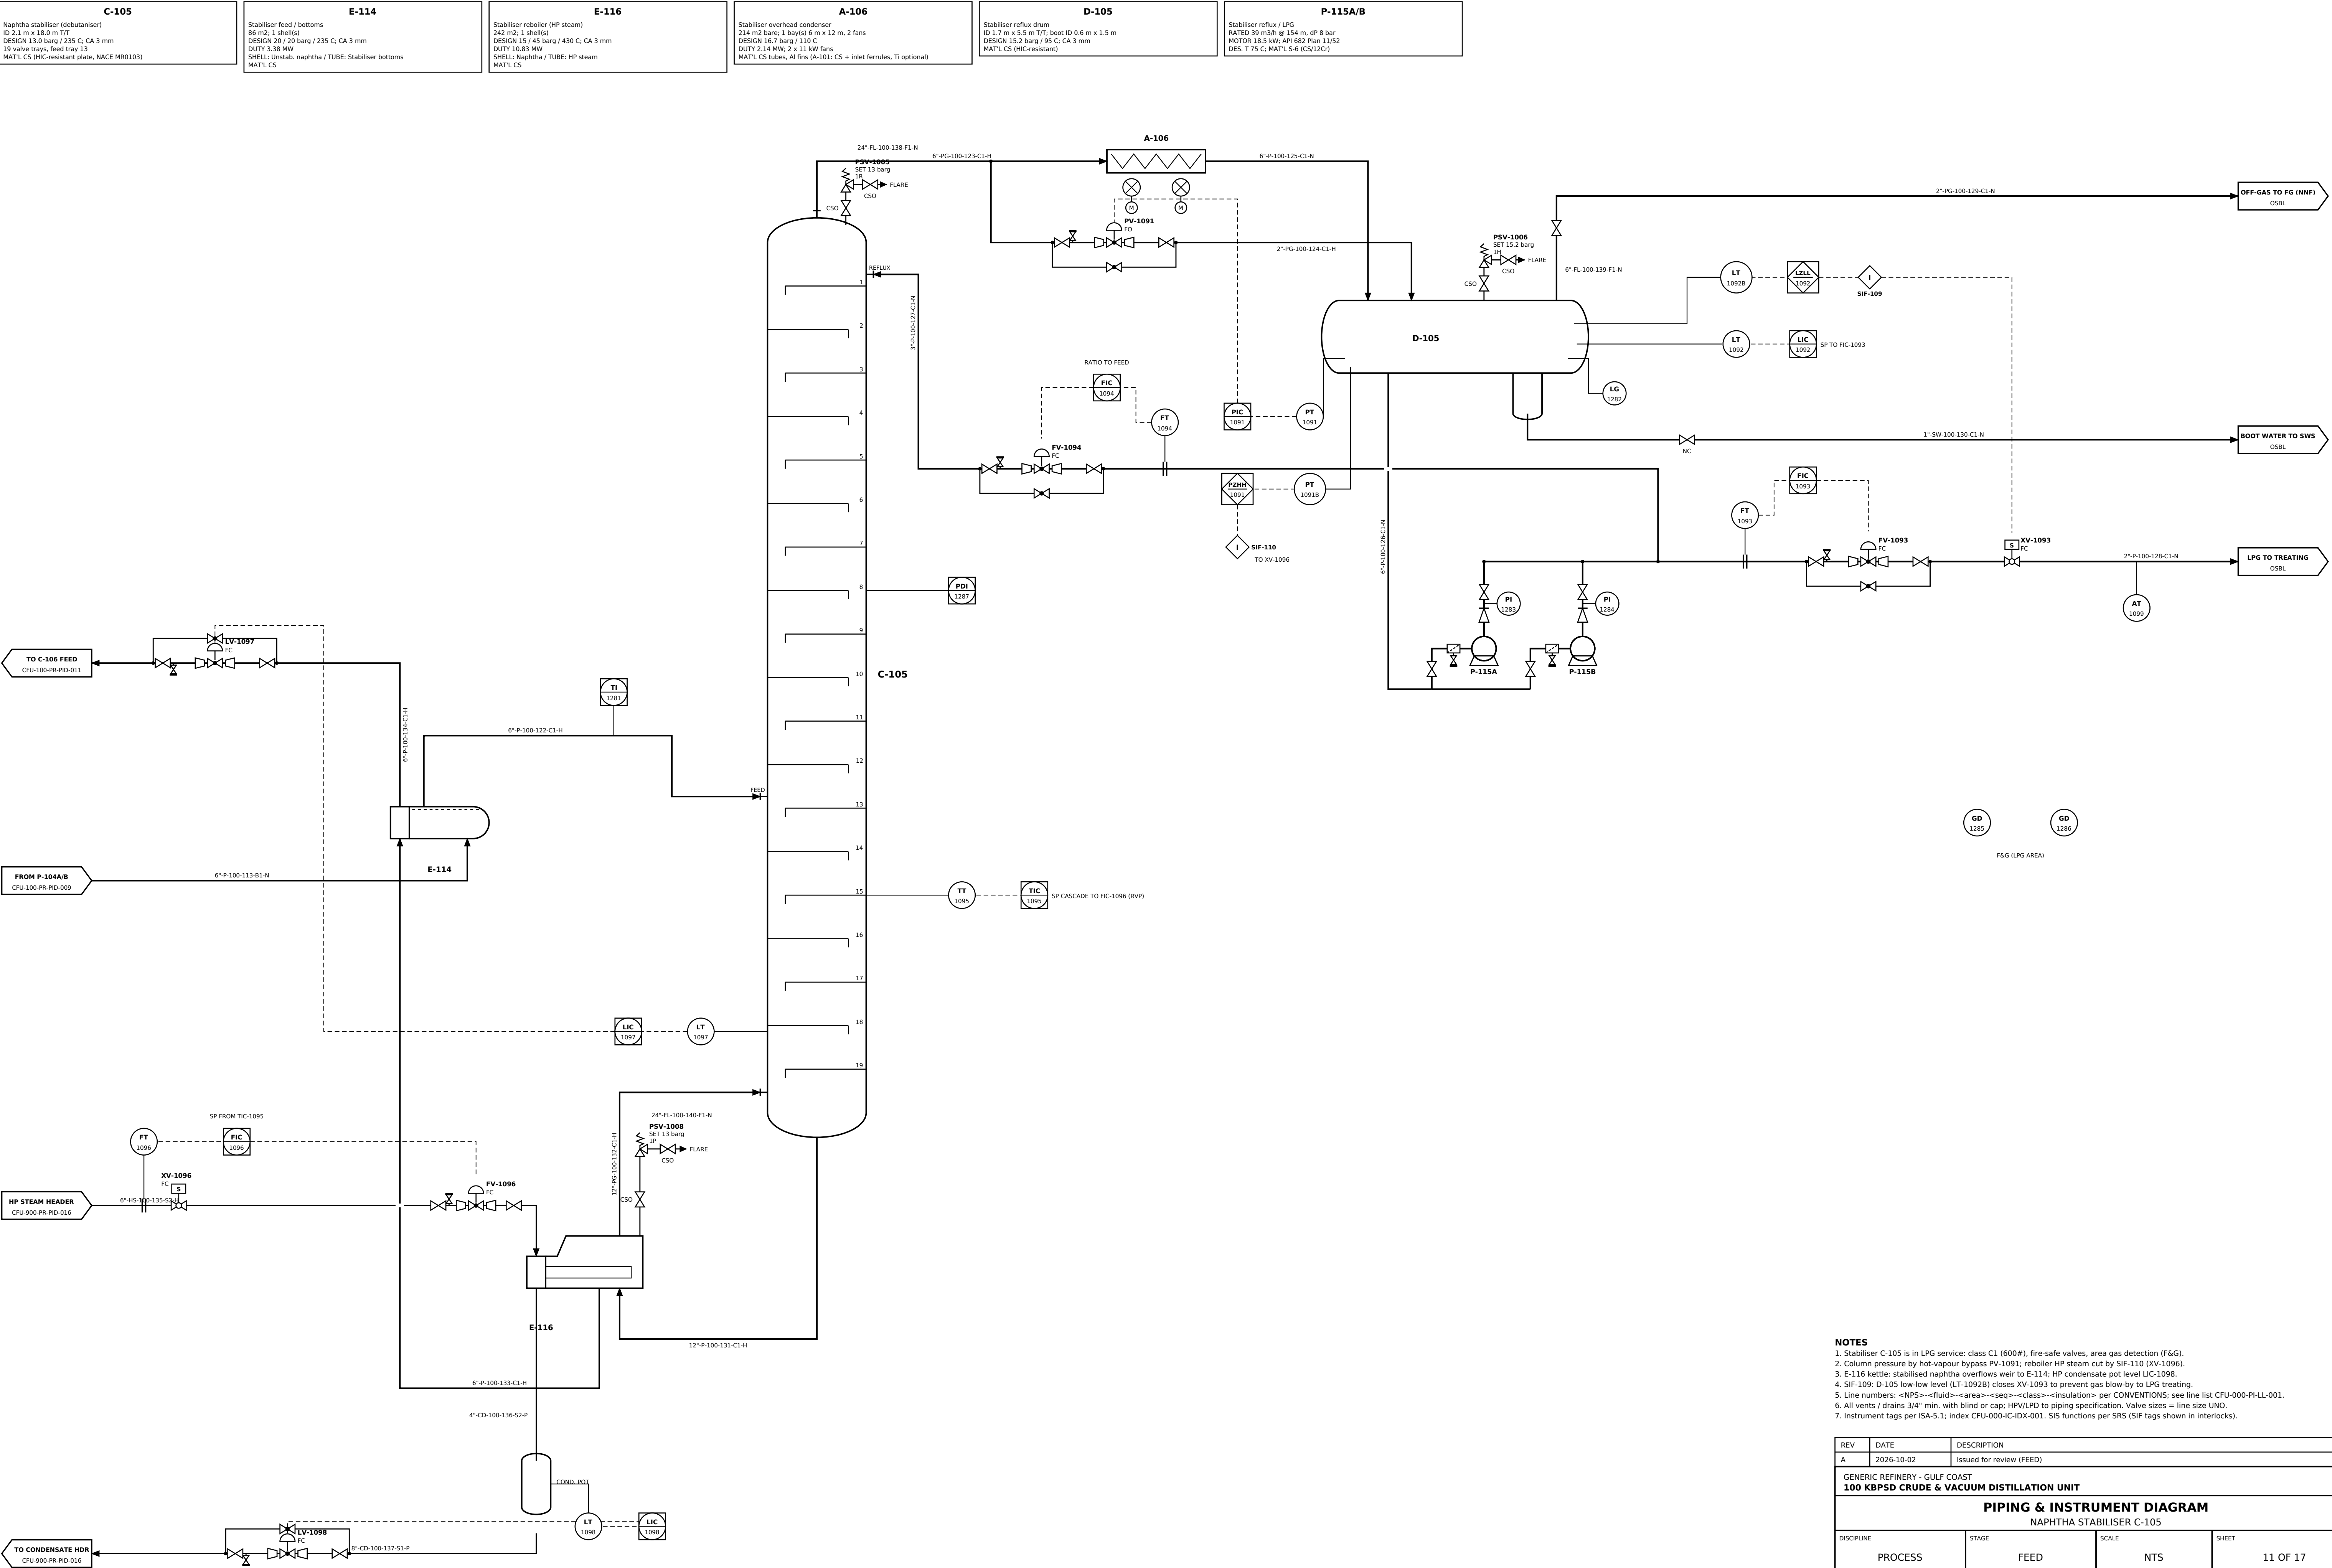

- NOTES**
1. Stabiliser C-105 is in LPG service: class C1 (600#), fire-safe valves, area gas detection (F&G).
 2. Column pressure by hot-vapour bypass PV-1091; reboiler HP steam cut by SIF-110 (XV-1096).
 3. E-116 kettle: stabilised naphtha overflows weir to E-114; HP condensate pot level LIC-1098.
 4. SIF-109: D-105 low-low level (LT-1092B) closes XV-1093 to prevent gas blow-by to LPG treating.
 5. Line numbers: <NPS>-<fluid>-<area>-<seq>-<class>-<insulation> per CONVENTIONS; see line list CFU-000-PI-LL-001.
 6. All vents / drains 3/4" min. with blind or cap; HPV/LPD to piping specification. Valve sizes = line size UNO.
 7. Instrument tags per ISA-5.1; index CFU-000-IC-IDX-001. SIS functions per SRS (SIF tags shown in interlocks).

REV	DATE	DESCRIPTION	
A	2026-10-02	Issued for review (FEED)	
GENERIC REFINERY - GULF COAST 100 KBPSD CRUDE & VACUUM DISTILLATION UNIT			
PIPING & INSTRUMENT DIAGRAM NAPHTHA STABILISER C-105			
DISCIPLINE	STAGE	SCALE	SHEET
PROCESS	FEED	NTS	11 OF 17
DRAWN	CHECKED	APPROVED	DATE
CLAUDE CODE	-	-	2026-10-02
DRAWING NUMBER			REV
CFU-100-PR-PID-010			A