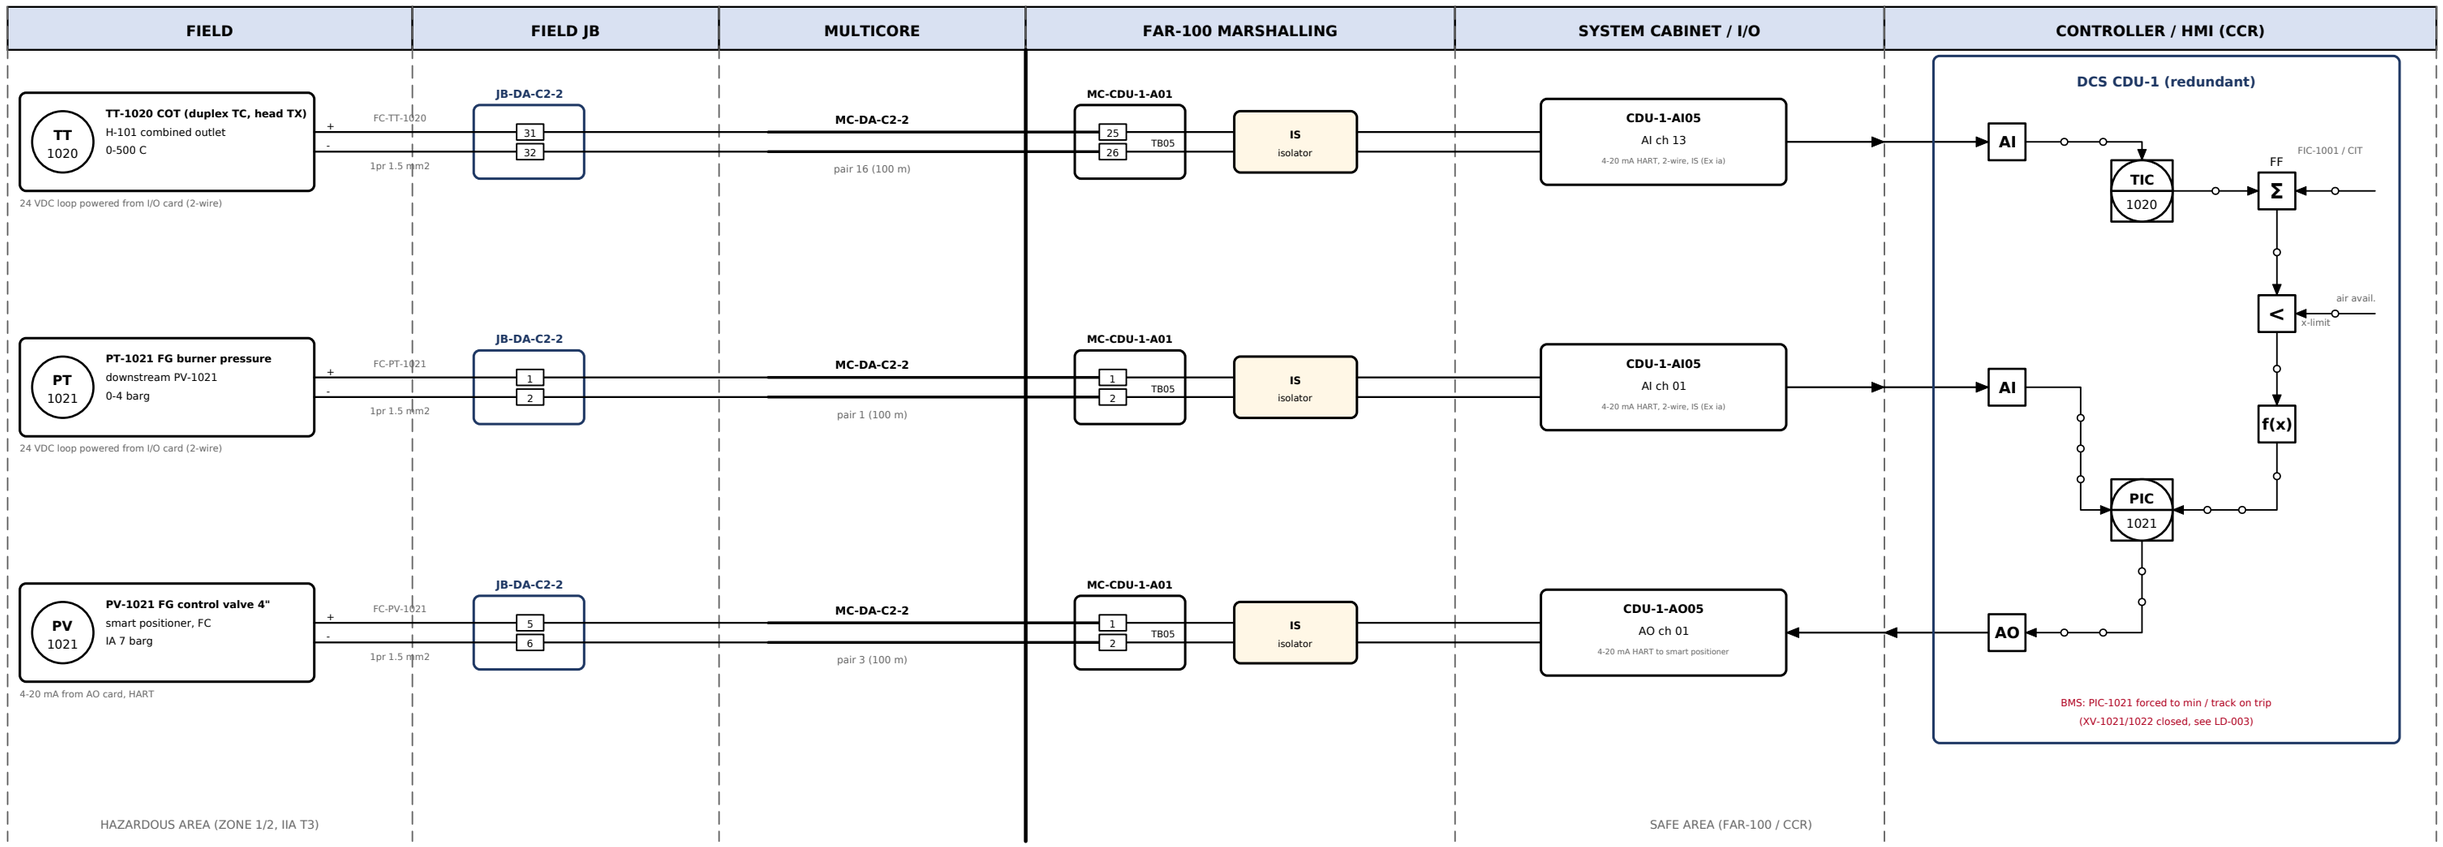


NOTES

1. TT-1020 (BPCS) is independent of the SIS transmitters TT-1020A/B/C (SIF-106); separate thermowells.
2. Cascade: TIC-1020 output + feed-forward (charge x dT, lead-lag) -> fuel demand -> low select with air available (cross-limiting) -> burner curve f(x) -> PIC-1021 SP. See CFU-100-IC-CSD-001.
3. PV-1021 fail-closed (FC) on air failure; min-fire mechanical stop not used (min-fire in DCS logic).
4. Terminal / cable data from CFU-000-IC-IOL-001 (data/io_list.json).

REV	DATE	DESCRIPTION
A	2026-10-02	Issued for review (FEED)

GENERIC REFINERY - GULF COAST

100 KBPSD CRUDE & VACUUM DISTILLATION UNIT

LOOP DIAGRAM

TIC-1020 / PIC-1021 H-101 COT -> FUEL GAS PRESSURE CASCADE

DISCIPLINE	STAGE	SCALE	SHEET
INSTRUMENTATION	FEED	NTS	2 OF 3

DRAWN	CHECKED	APPROVED	DATE
CLAUDE CODE	-	-	2026-10-02

DRAWING NUMBER	REV
CFU-100-IC-LD-002	**A**