


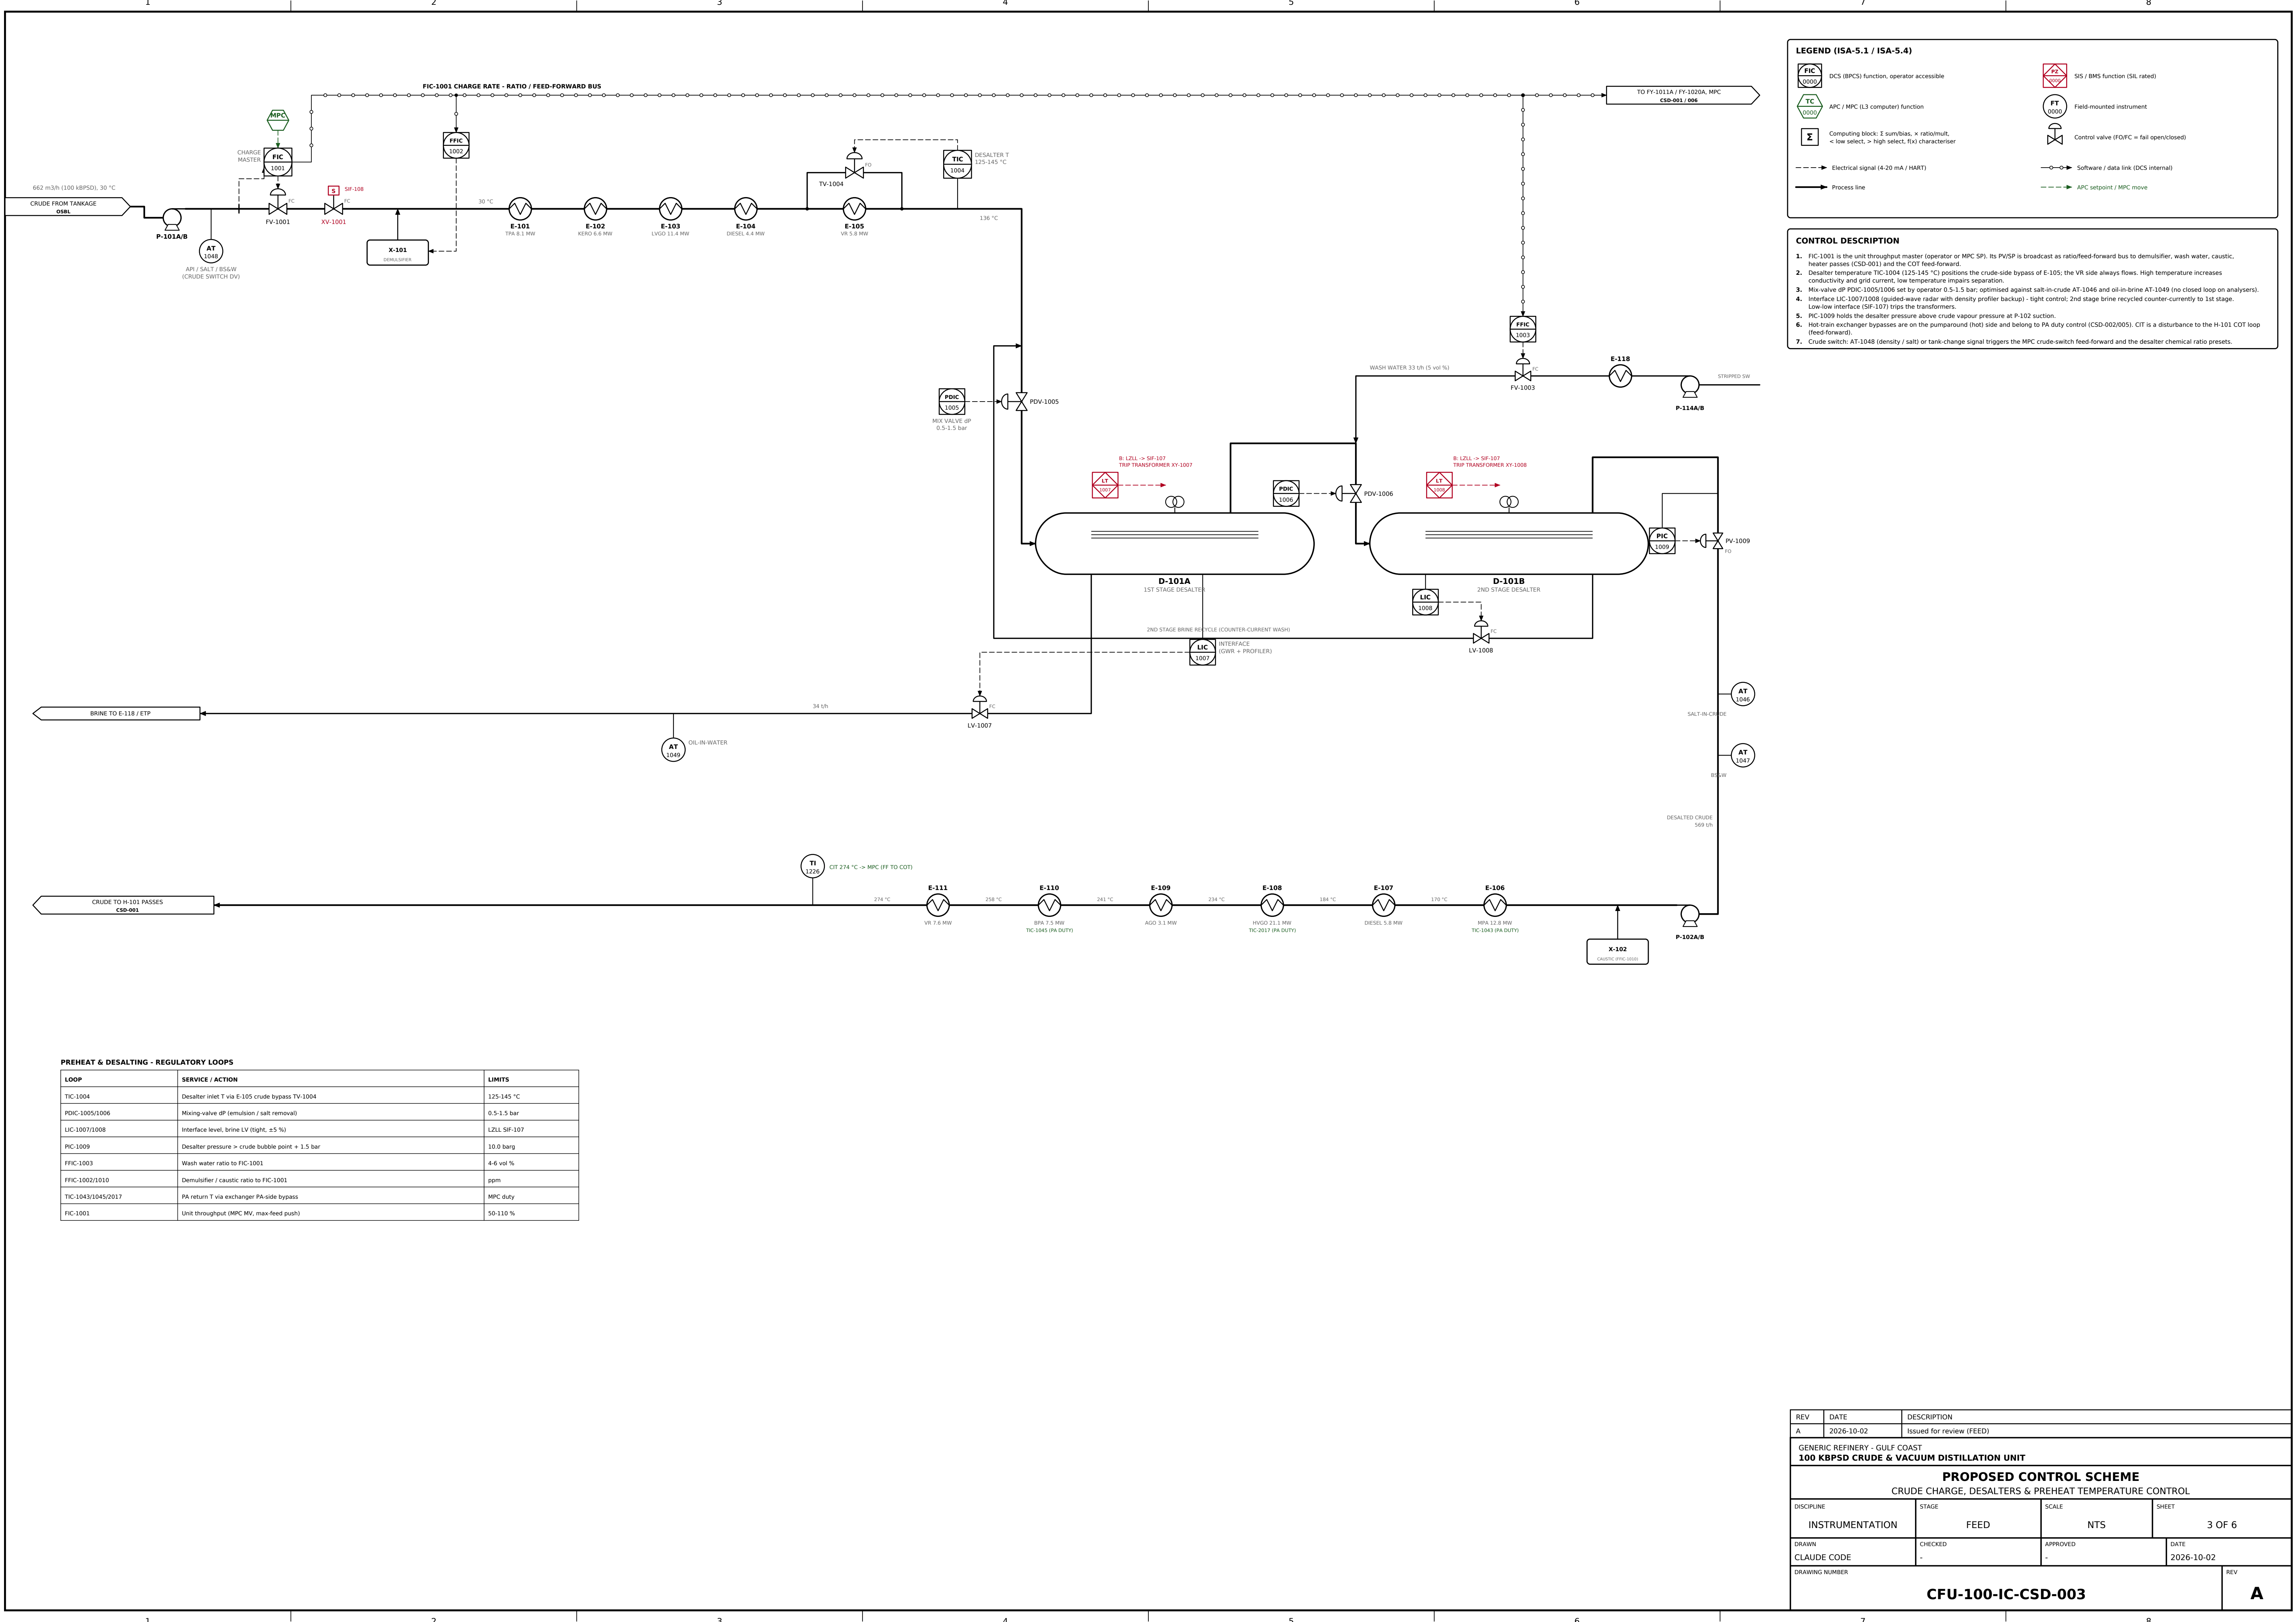

PREHEAT & DESALTING - REGULATORY LOOPS		
LOOP	SERVICE / ACTION	LIMITS
TIC-1004	Desalter inlet T via E-105 crude bypass TV-1004	125-145 °C
PDIC-1005/1006	Mixing-valve dP (emulsion / salt removal)	0.5-1.5 bar
LIC-1007/1008	Interface level, brine LV (tight, ±5 %)	LZLL SIF-107
PIC-1009	Desalter pressure > crude bubble point + 1.5 bar	10.0 barg
FFIC-1003	Wash water ratio to FIC-1001	4-6 vol %
FFIC-1002/1010	Demulsifier / caustic ratio to FIC-1001	ppm
TIC-1043/1045/2017	PA return T via exchanger PA-side bypass	MPC duty
FIC-1001	Unit throughput (MPC MV, max-feed push)	50-110 %

REV	DATE	DESCRIPTION	
A	2026-10-02	Issued for review (FEED)	
GENERIC REFINERY - GULF COAST			
100 KBPSD CRUDE & VACUUM DISTILLATION UNIT			
PROPOSED CONTROL SCHEME			
CRUDE CHARGE, DESALTERS & PREHEAT TEMPERATURE CONTROL			
DISCIPLINE	STAGE	SCALE	SHEET
INSTRUMENTATION	FEED	NTS	3 OF 6
DRAWN	CHECKED	APPROVED	DATE
CLAUDE CODE	-	-	2026-10-02
DRAWING NUMBER			REV
CFU-100-IC-CSD-003			A