
FIELD	FIELD JB	MULTICORE	FAR-100 MARSHALLING	SYSTEM CABINET / I/O	CONTROLLER / HMI (CCR)

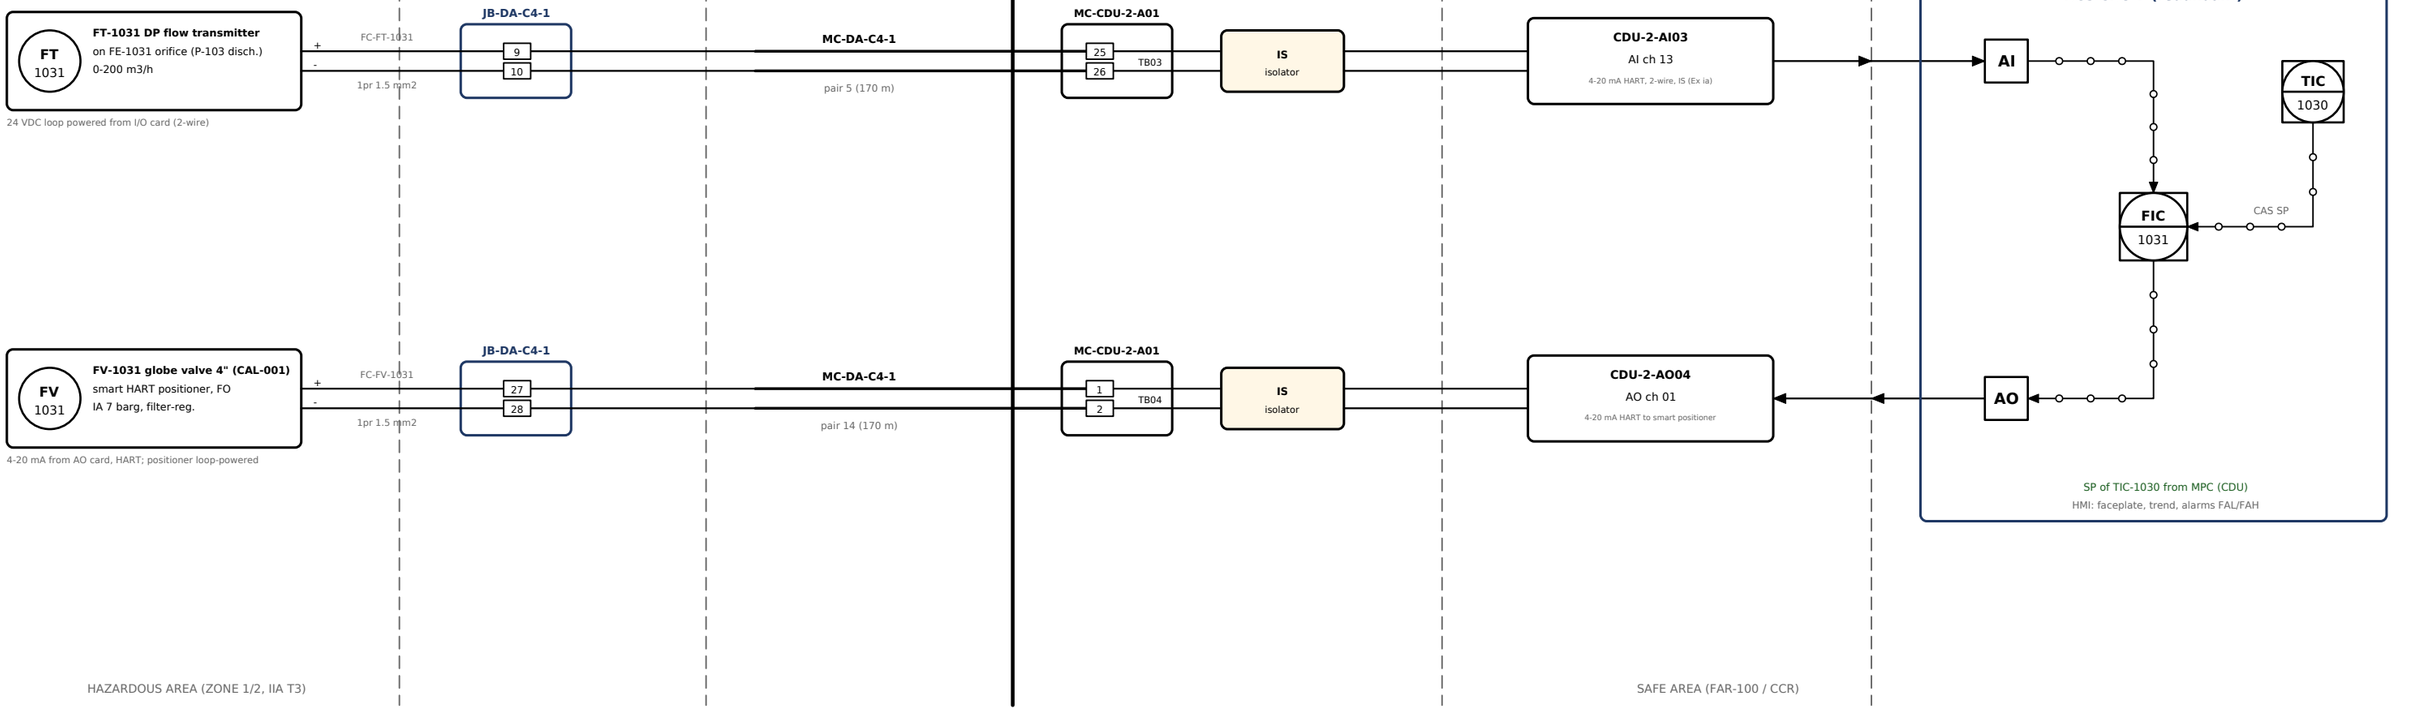

NOTES

1. Cable FC- = field (branch) cable 1 pair 1.5 mm2 screened, IS blue sheath; multicore 12/24 pair, armoured, overall + individual screens; screens earthed at FAR-100 IS earth bar only.
2. Terminal numbers, JB, multicore, cabinet and card/channel assignments from CFU-000-IC-IOL-001 (data/io_list.json) - final at detailed design.
3. Positioner fail action: air failure -> valve OPEN (FO, reflux to column top on air loss).
4. FIC-1031 in CAS from TIC-1030; on TIC bad PV the FIC sheds to AUTO at last SP (bumpless).
5. Power: AI/AO cards 24 VDC from redundant cabinet PSUs fed by UPS-101A/B (UDB-101A/B).

REV	DATE	DESCRIPTION
A	2026-10-02	Issued for review (FEED)

GENERIC REFINERY - GULF COAST

100 KBPSD CRUDE & VACUUM DISTILLATION UNIT

LOOP DIAGRAM

FIC-1031 C-101 REFLUX FLOW (CASCADE FROM TIC-1030)

DISCIPLINE	STAGE	SCALE	SHEET
INSTRUMENTATION	FEED	NTS	1 OF 3

DRAWN	CHECKED	APPROVED	DATE
CLAUDE CODE	-	-	2026-10-02

DRAWING NUMBER	REV
CFU-100-IC-LD-001	**A**