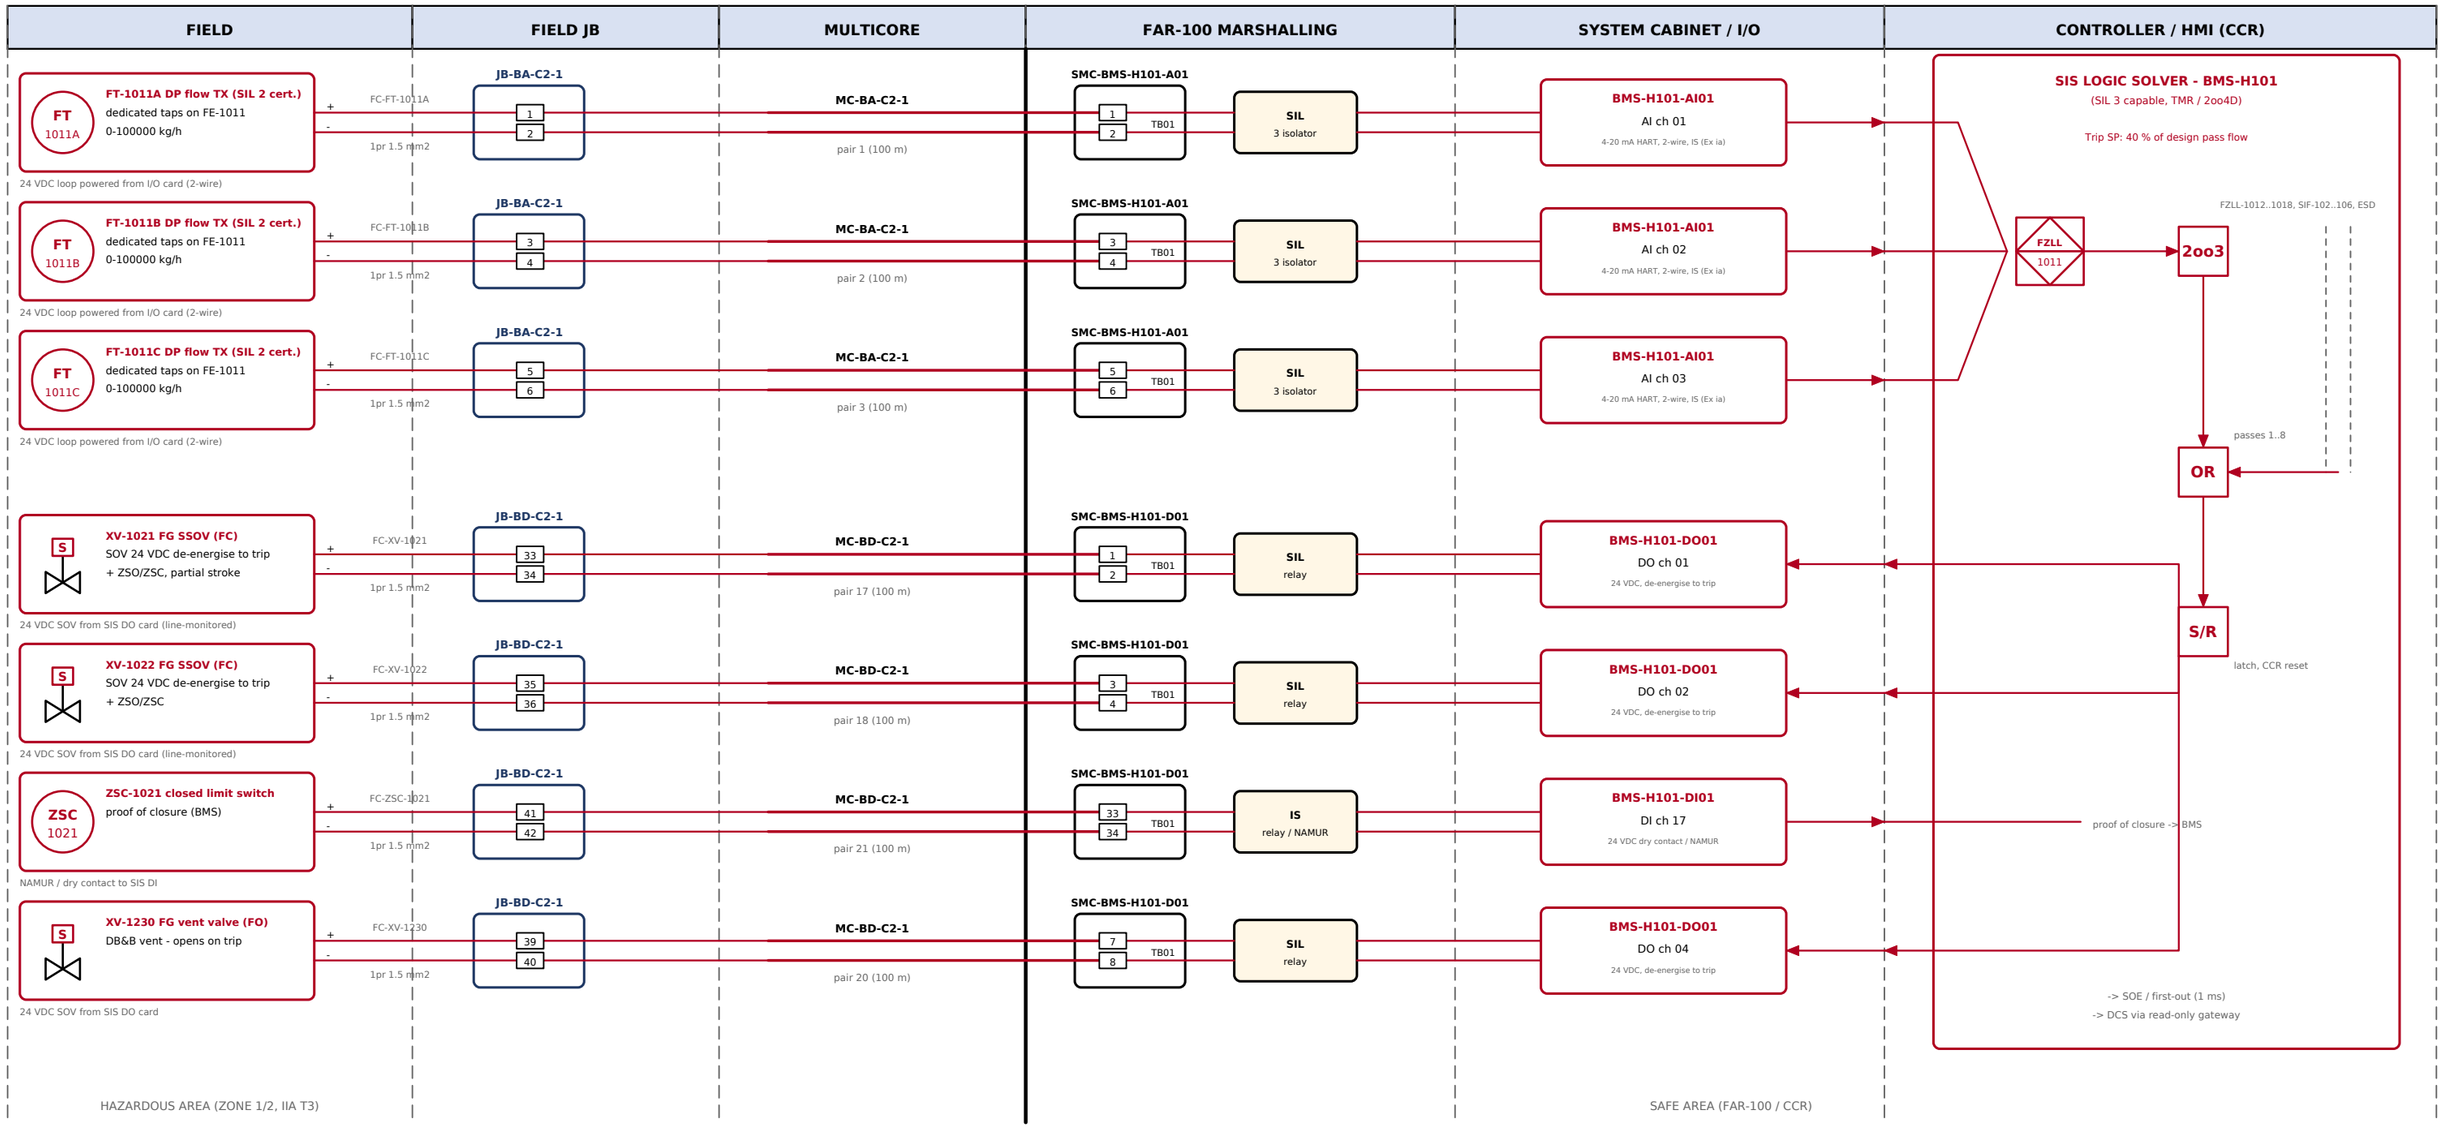


NOTES

1. SIL 2 per LOPA (CFU-000-IC-RPT-002). 2oo3 voting with 2oo2 on one transmitter in bypass / fault; deviation alarm between A/B/C (5 %).
2. Final elements: XV-1021 and XV-1022 in series (1oo2) with vent XV-1230 (double block & bleed); also pilot XV-1026 (SIF-101 / BMS). Proof-test interval 12 months (partial stroke 3 months).
3. Field cables and JBs for SIS are segregated (red sheath / labels); SIS multicores separate from DCS.
4. Terminal / cable data from CFU-000-IC-IOL-001 (data/io_list.json).

REV	DATE	DESCRIPTION
A	2026-10-02	Issued for review (FEED)

GENERIC REFINERY - GULF COAST

100 KBPSD CRUDE & VACUUM DISTILLATION UNIT

LOOP DIAGRAM

SIF-101 H-101 PASS 1 LOW-LOW FLOW (2OO3) -> FUEL SSOVS

DISCIPLINE	STAGE	SCALE	SHEET
INSTRUMENTATION	FEED	NTS	3 OF 3

DRAWN	CHECKED	APPROVED	DATE
CLAUDE CODE	-	-	2026-10-02

DRAWING NUMBER	REV
CFU-100-IC-LD-003	**A**