


C-106 Naphtha splitter ID 3.1 m x 29.5 m TTT DESIGN 3.5 barg / 185 C; CA 3 mm 38 valve trays, feed tray 21 MAT'L CS	E-117 Splitter reboiler (MP steam) 225 m2; 1 shell(s) DESIGN 5 / 13 barg / 280 C; CA 3 mm DUTY 6.83 MW SHELL: Naphtha / TUBE: MP steam MAT'L CS	A-107 Splitter overhead condenser BB1 m2 bare; 2 bay(s) 6 m x 12 m, 4 fans DESIGN 9.7 barg / 135 C DUTY 9.63 MW; 4 x 30 kW fans MAT'L CS tubes, Al fins (A-101; CS + inlet ferrules, Ti optional)	D-106 Splitter reflux drum ID 2.7 m x 8.5 m TTT DESIGN 3.5 barg / 120 C; CA 3 mm MAT'L CS	P-116A/B Splitter reflux / LN RATED 146 m3/h @ 111 m, dP 7 bar MOTOR 55 kW, API 682 Flan 11/52 DES. T 80 C; MAT'L S-6 (CS/12Cr)	P-117A/B Heavy naphtha product RATED 142 m3/h @ 98 m, dP 6 bar MOTOR 45 kW, API 682 Flan 11/52 DES. T 185 C; MAT'L S-6 (CS/12Cr)	A-108 Heavy naphtha product cooler 401 m2 bare; 1 bay(s) 6 m x 12 m, 2 fans DESIGN 9.7 barg / 185 C DUTY 5.81 MW; 2 x 30 kW fans MAT'L CS tubes, Al fins (A-101; CS + inlet ferrules, Ti optional)
---	--	---	--	--	---	--

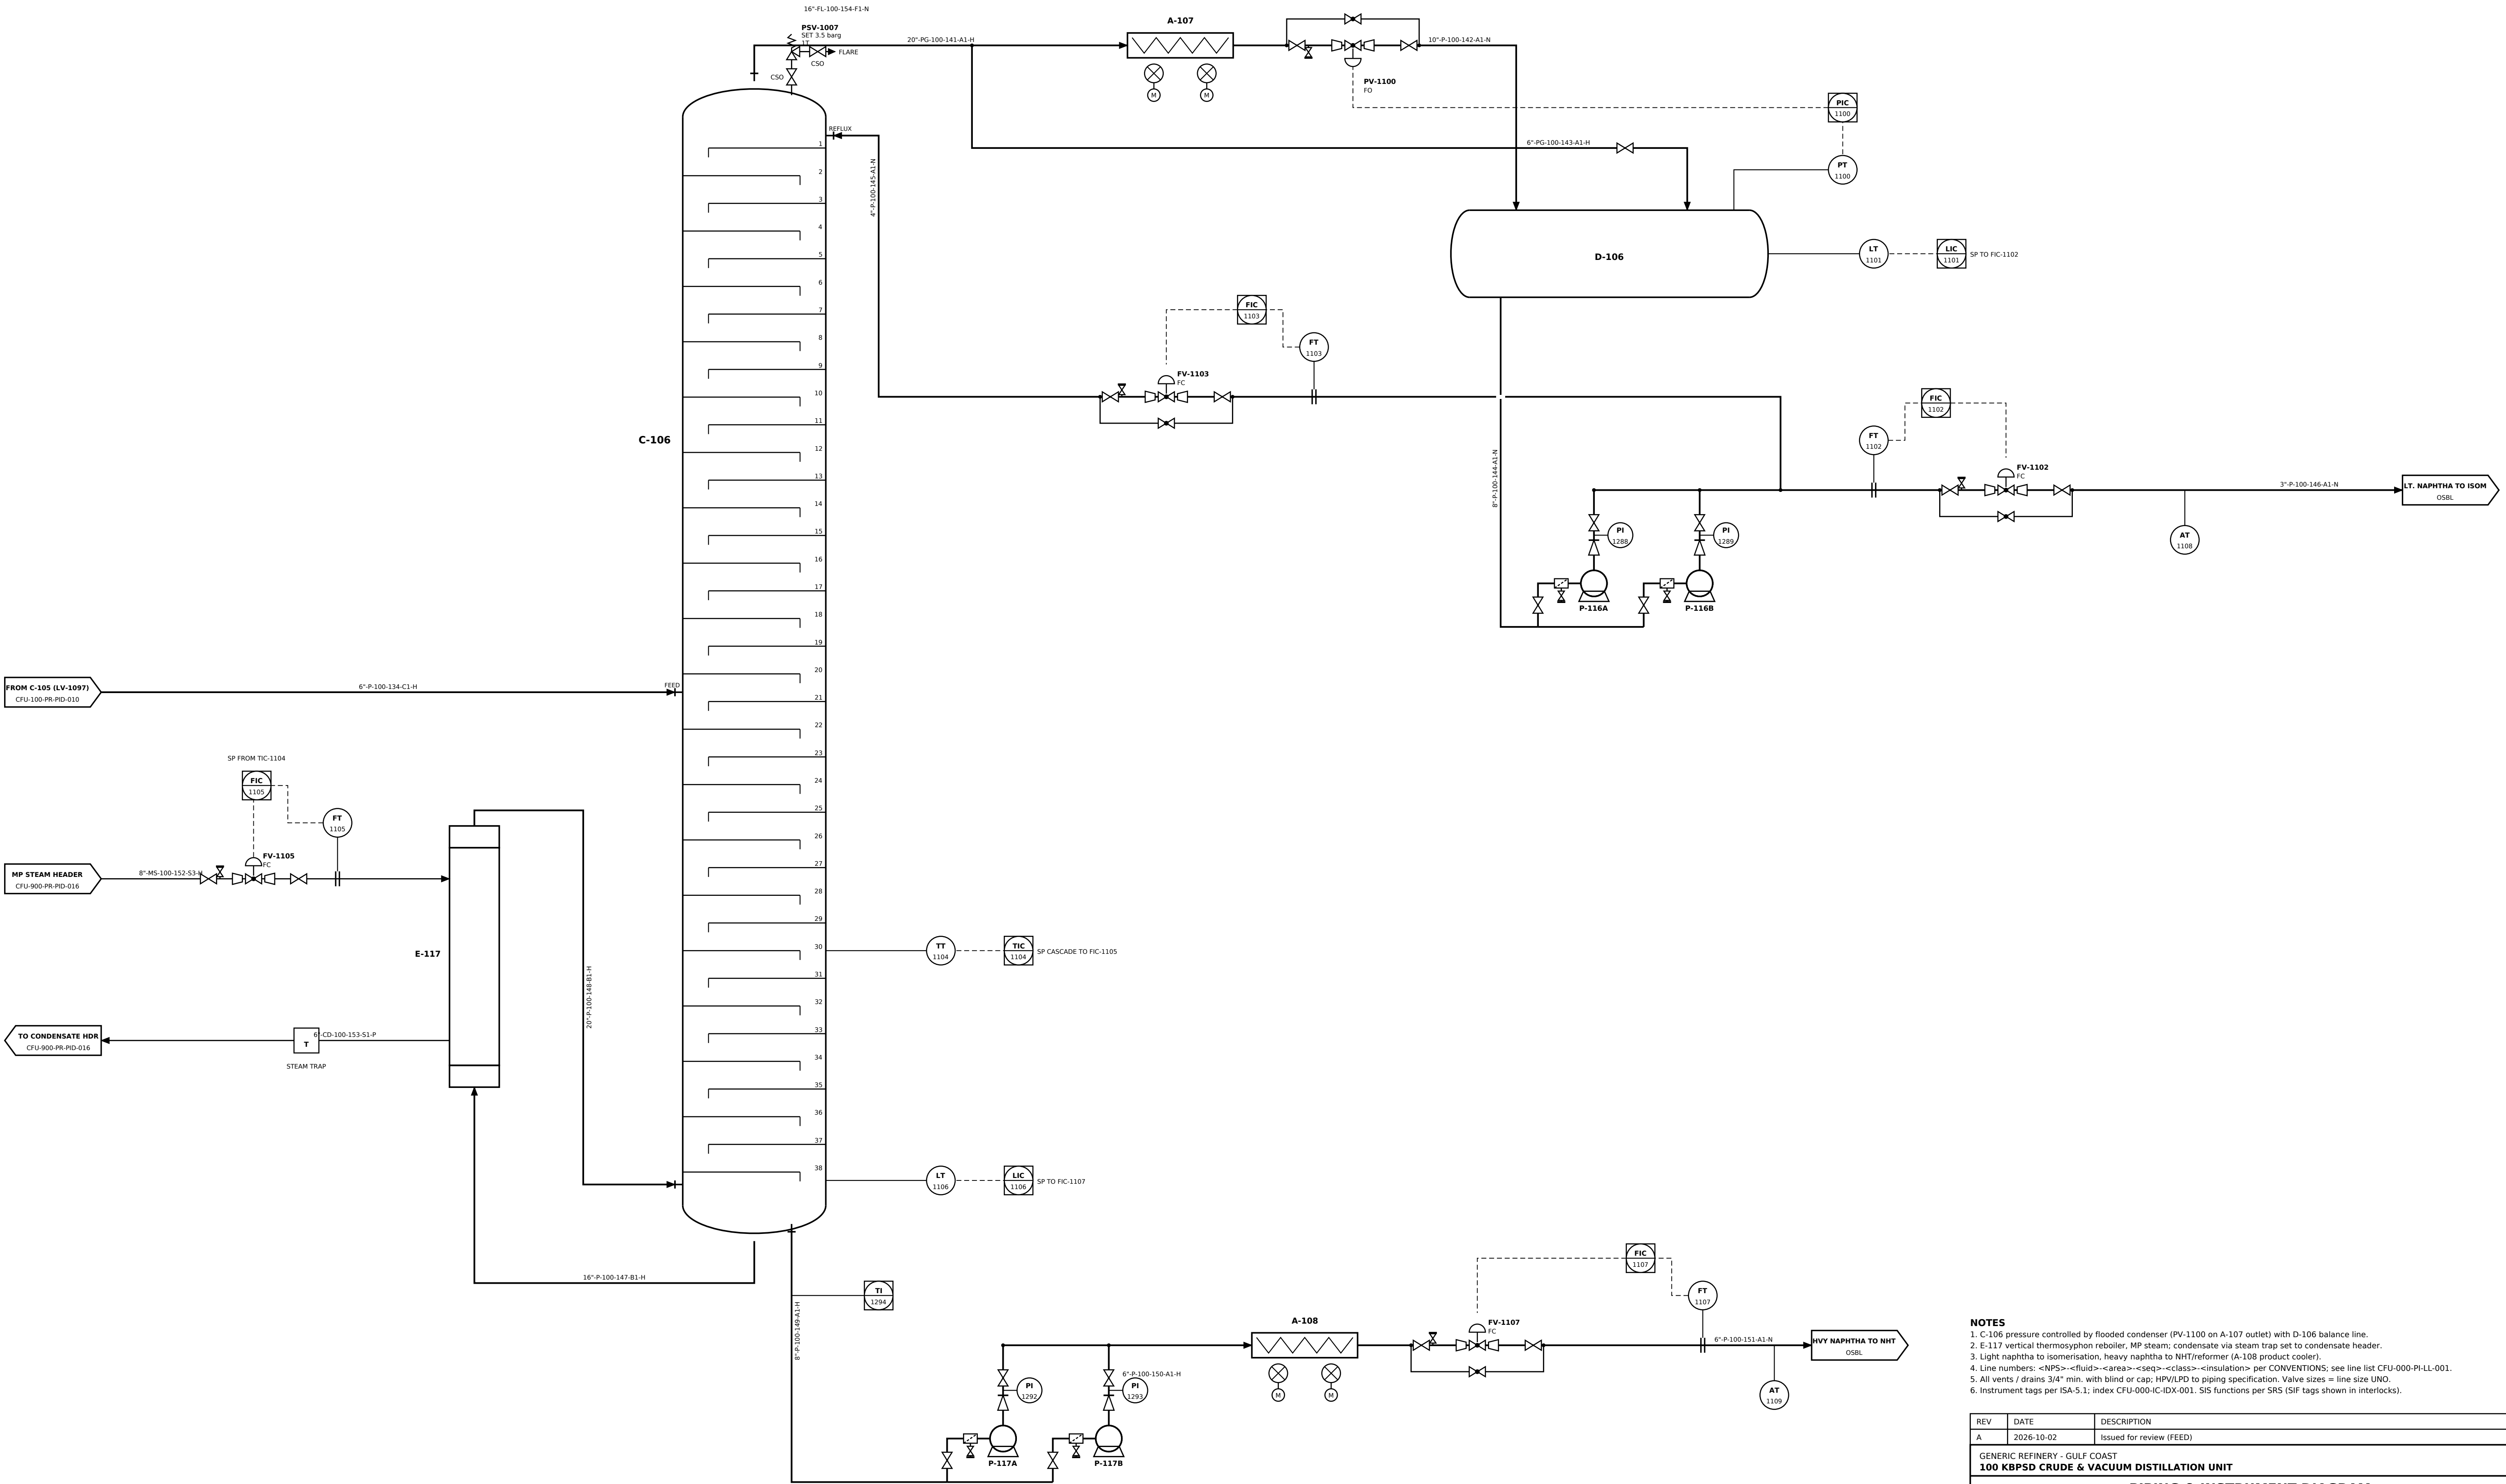

- NOTES**
- C-106 pressure controlled by flooded condenser (PV-1100 on A-107 outlet) with D-106 balance line.
 - E-117 vertical thermosyphon reboiler, MP steam; condensate via steam trap set to condensate header.
 - Light naphtha to isomerisation, heavy naphtha to NHT/reformer (A-108 product cooler).
 - Line numbers: <NPS>-<fluid>-<area>-<seq>-<class>-<insulation> per CONVENTIONS; see line list CFU-000-PI-LL-001.
 - All vents / drains 3/4" min. with blind or cap; HPV/LPD to piping specification. Valve sizes = line size UNO.
 - Instrument tags per ISA-5.1; index CFU-000-IC-IDX-001. SIS functions per SRS (SIF tags shown in interlocks).

REV	DATE	DESCRIPTION		
A	2026-10-02	Issued for review (FEED)		
GENERIC REFINERY - GULF COAST 100 KBPSD CRUDE & VACUUM DISTILLATION UNIT				
PIPING & INSTRUMENT DIAGRAM NAPHTHA SPLITTER C-106				
DISCIPLINE		STAGE	SCALE	SHEET
PROCESS		FEED	NTS	12 OF 17
DRAWN		CHECKED	APPROVED	DATE
CLAUDE CODE		-	-	2026-10-02
DRAWING NUMBER				REV
CFU-100-PR-PID-011				A