


H-201
Vacuum heater
14.7 MW abs. / 17.5 MW fired; 1-cell cabin, 4 passes, 44 rad. tubes 6" x 18.3 m
DESIGN 19.8 barg / 580 C; CA 3 mm
DUTY 14.69 MW
MAT'L Tubes A335 P9 (9Cr-1Mo); convection P5 / CS studded

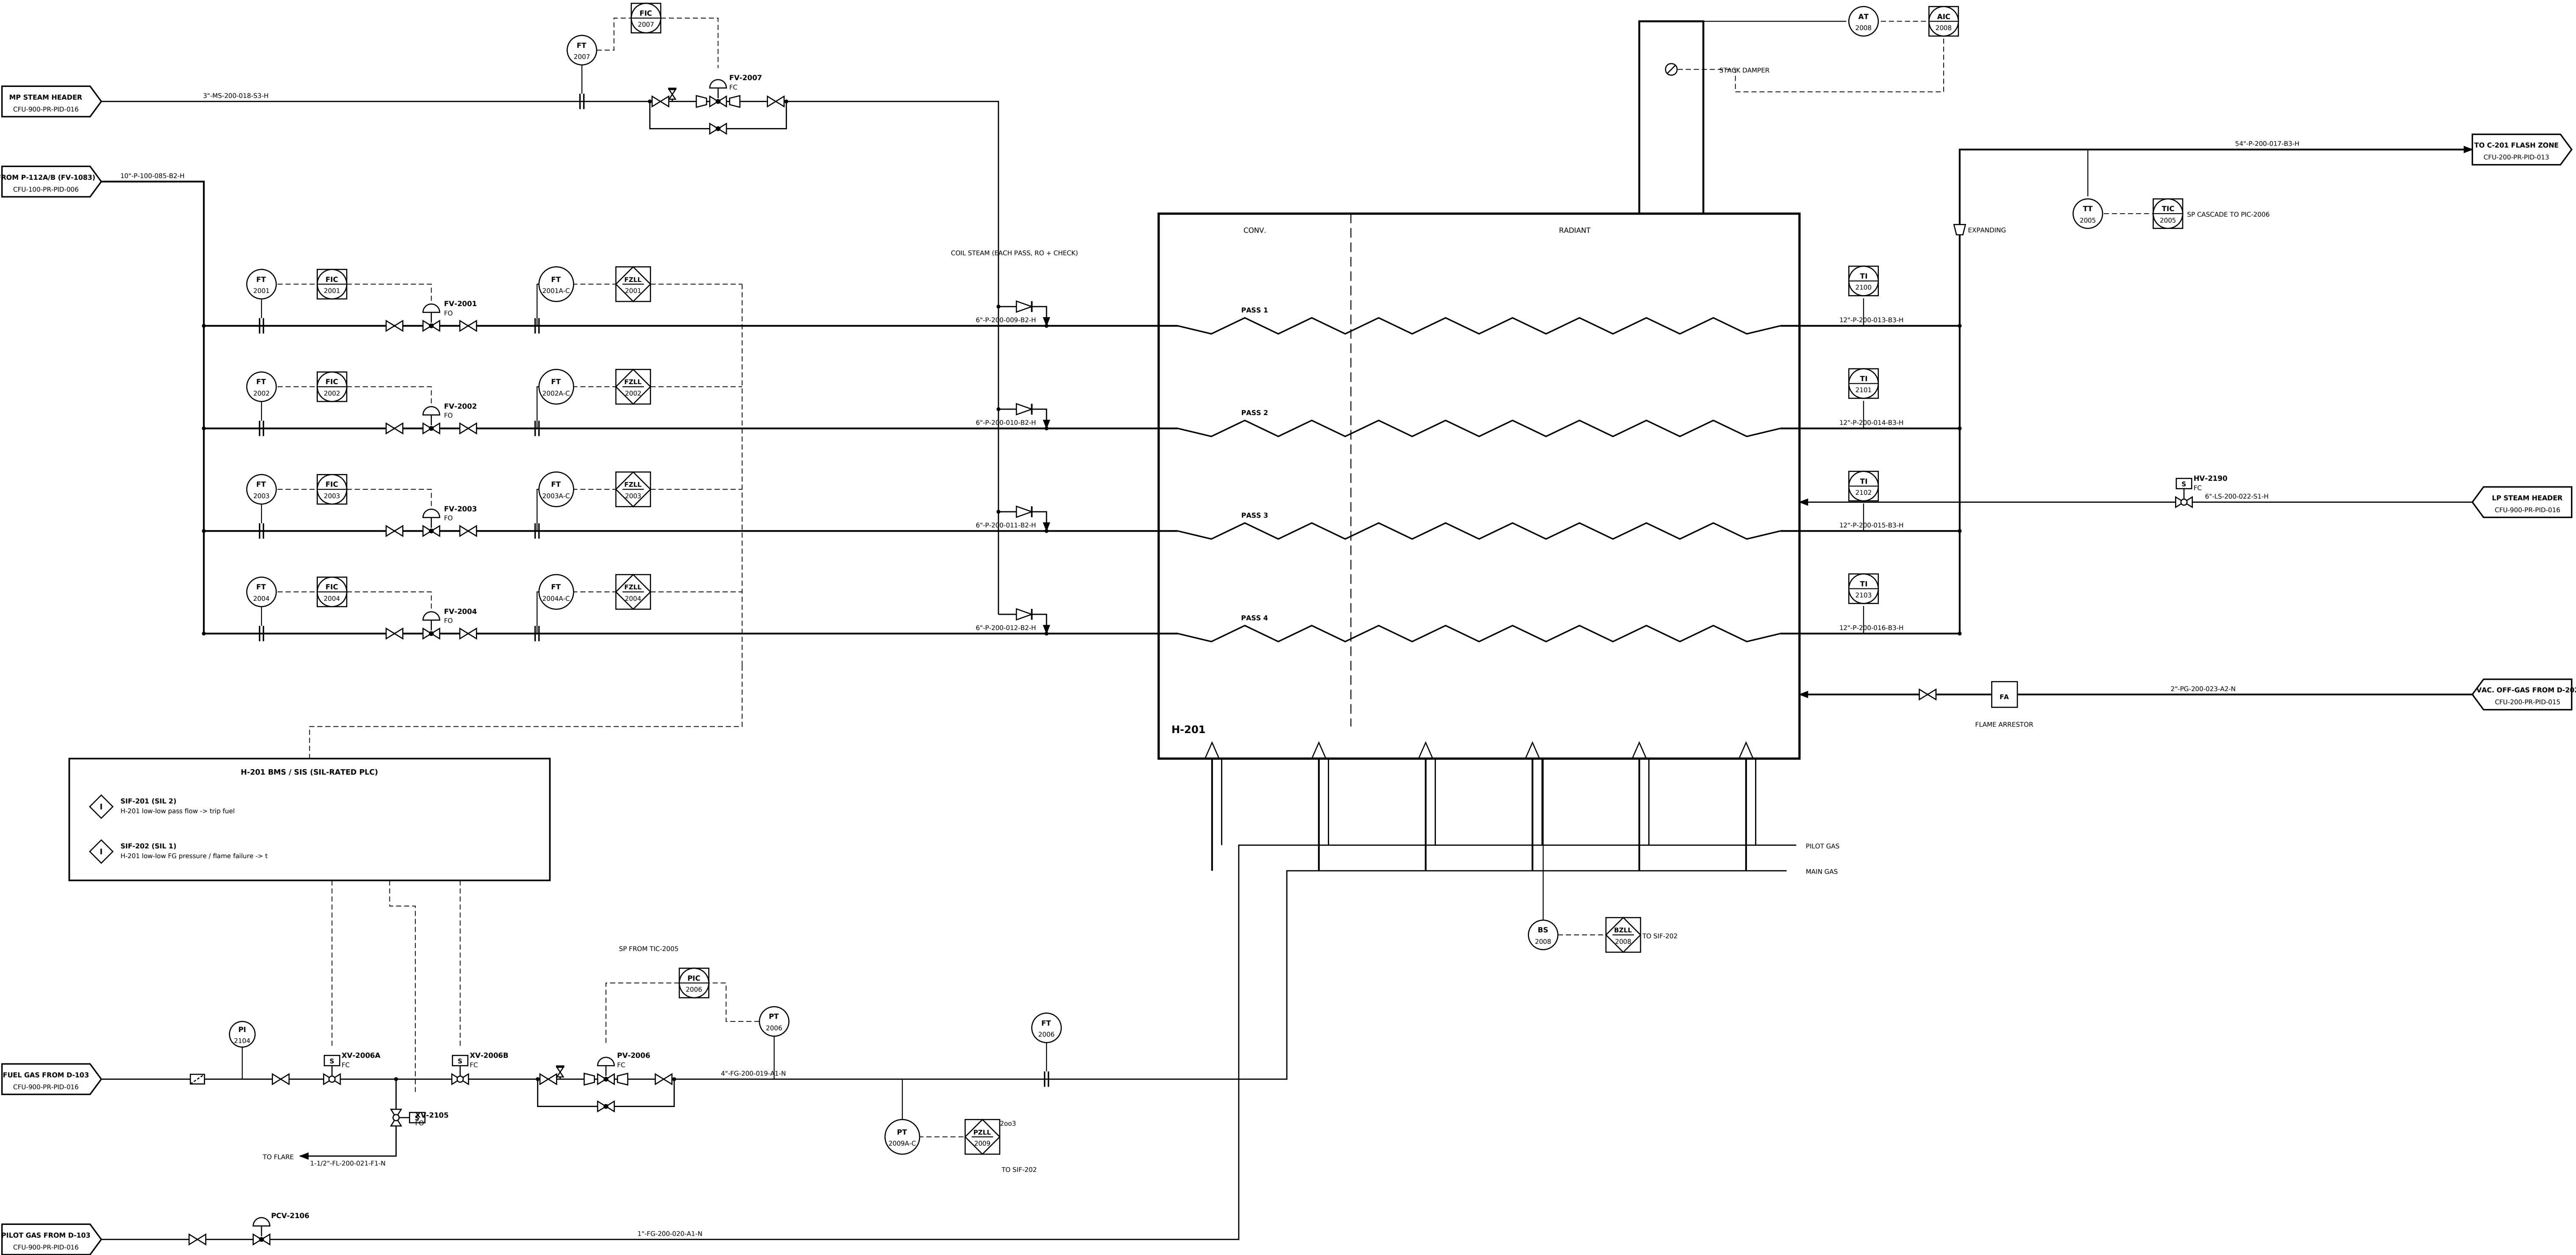

- NOTES**
1. Passes shown schematically (convection + radiant in series); 4 identical passes, coil steam per pass.
 2. Pass flow SIS transmitters FT-200xA/B/C (2003) independent of BPCS FT-200x (SIF-201).
 3. Vacuum off-gas burned in dedicated H-201 burners via flame arrestor (from D-202 / PV-2031).
 4. Natural draft heater: O2 trim AIC-2008 on stack damper.
 5. Line numbers: <NPS>-<fluid>-<area>-<seq>-<class>-<insulation> per CONVENTIONS; see line list CFU-000-PI-LL-001.
 6. All vents / drains 3/4" min. with blind or cap; HPV/LPD to piping specification. Valve sizes = line size UNO.
 7. Instrument tags per ISA-5.1; index CFU-000-IC-IDX-001. SIS functions per SRS (SIF tags shown in interlocks).

REV	DATE	DESCRIPTION	
A	2026-10-02	Issued for review (FEED)	
GENERIC REFINERY - GULF COAST			
100 KBPSD CRUDE & VACUUM DISTILLATION UNIT			
PIPING & INSTRUMENT DIAGRAM			
VACUUM HEATER H-201			
DISCIPLINE		STAGE	SCALE
PROCESS		FEED	NTS
		SHEET	
		13 OF 17	
DRAWN	CHECKED	APPROVED	DATE
CLAUDE CODE	-	-	2026-10-02
DRAWING NUMBER			REV
CFU-200-PR-PID-012			A