


ISOMETRIC VIEW - NOT TO SCALE - DIMENSIONS IN mm, ELEVATIONS / COORDINATES IN m (PLANT GRID)

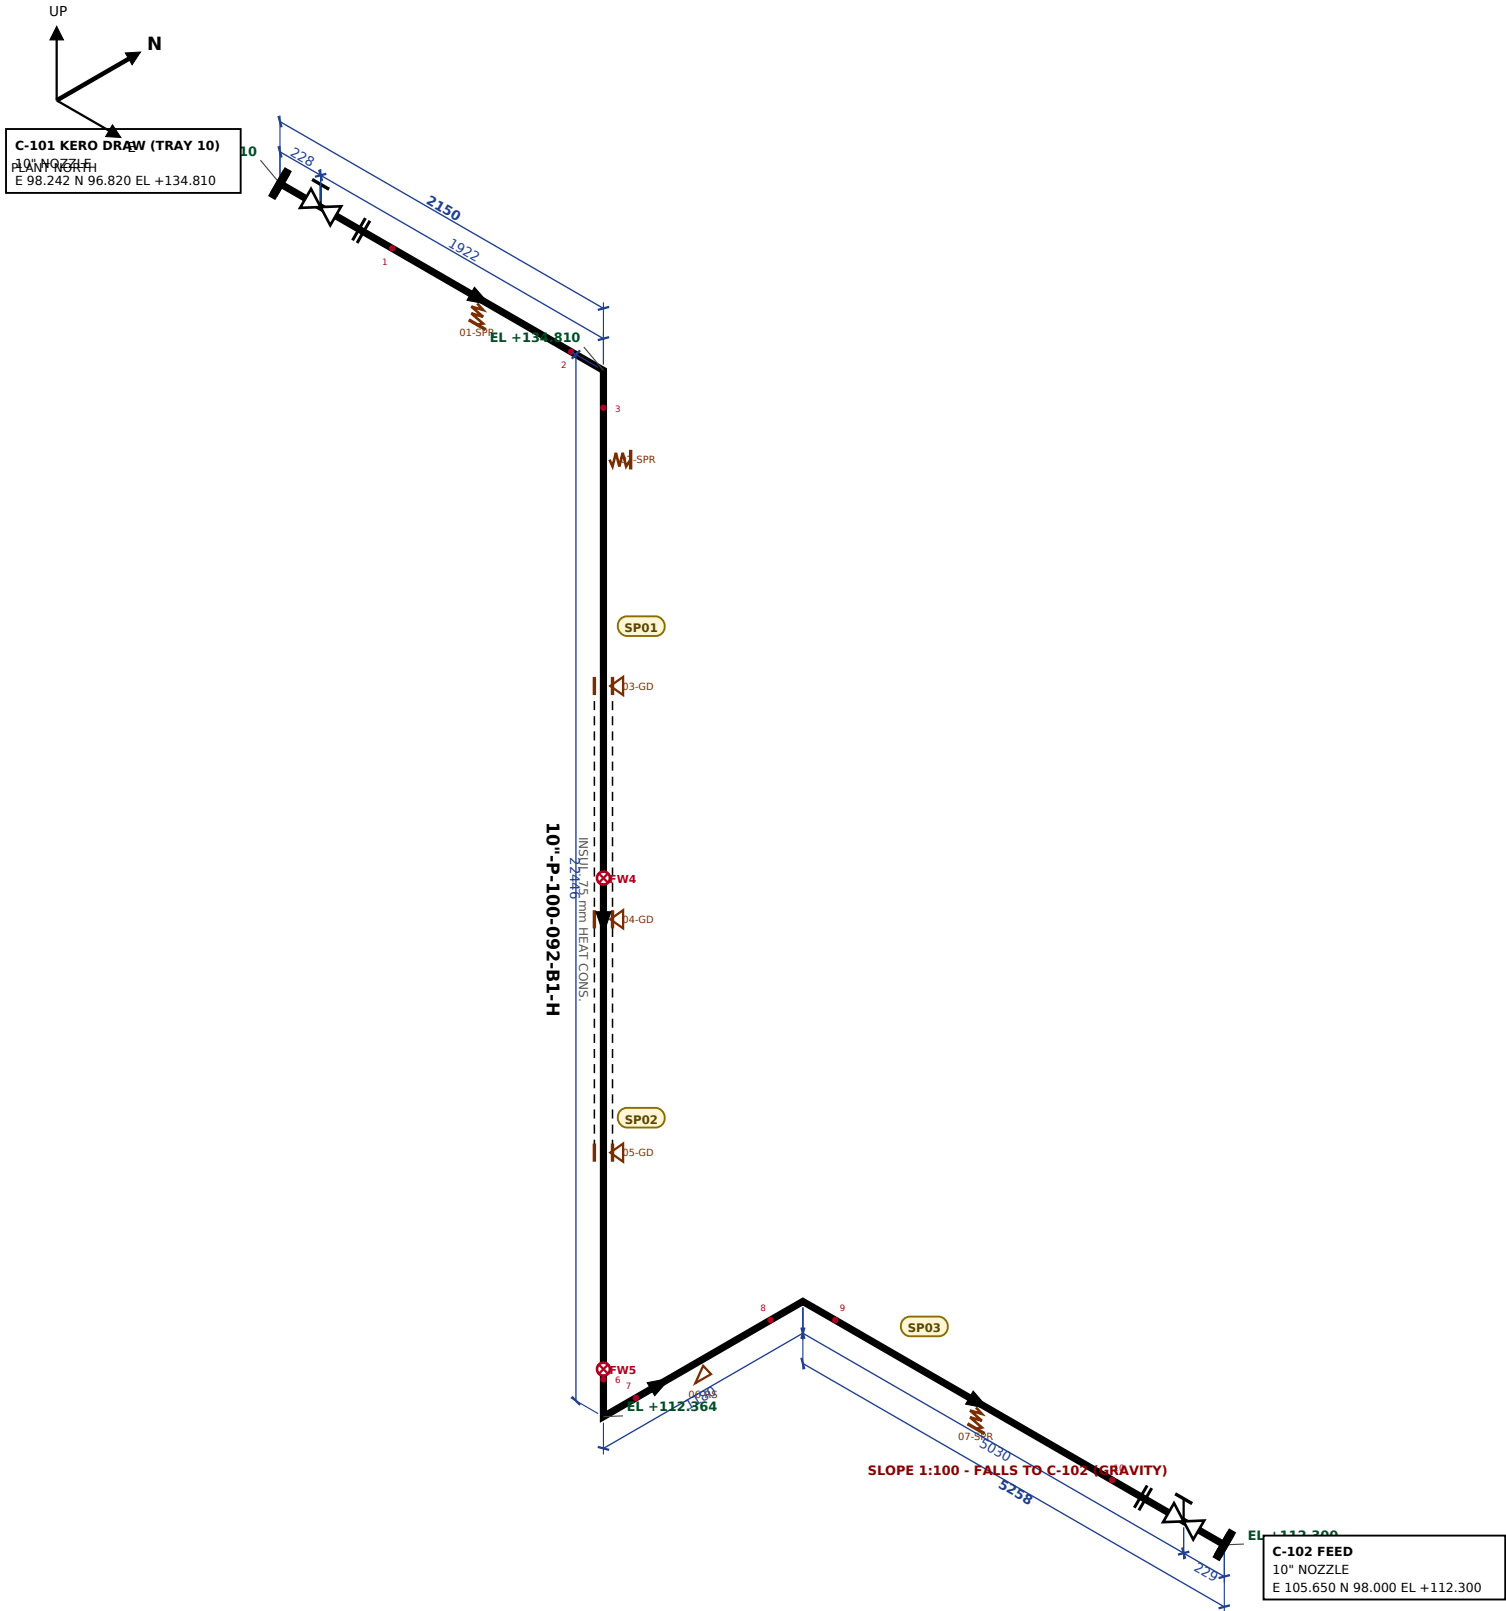

BILL OF MATERIALS (THIS SHEET)

PT	DESCRIPTION	NPS	QTY
1	FLANGE WN RF CL300 B16.5, bore SCH 40, ASTM A105	10"	2
2	PIPE SCH 40, BE, ASTM A106 Gr.B SMLS	10"	27.6 m
3	ELBOW 90 LR, BW, SCH 40, ASTM A234 WPB	10"	3
4	ERECTION: GATE VALVE OS&Y CL300 RF, A216 WCB, trim 8	10"	2
5	GASKET SPW 304/graphite, outer ring, CL300 B16.20	10"	4
6	STUD BOLT SET (nuts) A193 B7 / A194 2H, CL300	10"	4
7	PIPE SUPPORTS (std. dwgs): guide x3, rest x1, spring x3	-	7

CUT LENGTHS (mm, ex. weld gap) / SPOOLS

PIECE	NPS	L	PIECE	NPS	L	PIECE	NPS	L
SP01-1	10"	1196	SP01-2	10"	9850	SP02-1	10"	11600
SP03-1	10"	234	SP03-2	10"	418	SP03-3	10"	4304

SPOOL DEVELOPED LENGTHS (transport limit 12.0 x 3.0 x 3.0 m):

SP01=11.9m SP02=11.6m SP03=6.6m

NOTES

- Pipe/fittings/flanges per class B1 (CFU-000-PI-SPC-001); BW fittings ASME B16.9, flanges B16.5/B16.47A RF.
- Hydrotest 5.5 barg per ASME B31.3 345.4 (vents at high points, drains at low points).
- PWHT: NO. NDE: 10 % RT of BW.
- Supports: RS rest/shoe, GD guide, ANC anchor, SPR variable spring - tags PS-<area><seq>-nn.
- Welds: dot = shop weld, crossed circle FW = field weld; spools <= 12 m for transport.
- Gravity draw: vertical drop then continuous fall 1:100 to C-102 - no pockets, no rise.
- Drop leg 2.15 m east of draw nozzle clears diesel/AGO draw nozzles below (same orientation).
- Self-venting: line sized for <= 0.9 m/s; vapour vents back to C-101 via 8"-PG-100-093.

REV	DATE	DESCRIPTION
A	2026-10-02	Issued for review (FEED)

GENERIC REFINERY - GULF COAST

100 KBPSD CRUDE & VACUUM DISTILLATION UNIT

PIPING ISOMETRIC 10"-P-100-092-B1-H

C-101 KERO DRAW TO C-102 (GRAVITY)

DISCIPLINE	STAGE	SCALE	SHEET
PIPING	FEED	NTS	1 OF 1
DRAWN	CHECKED	APPROVED	DATE
CLAUDE CODE	-	-	2026-10-02
DRAWING NUMBER			
CFU-100-PI-ISO-009			
REV			
A			

LINE NUMBER	FROM	TO	PIPING CLASS
10"-P-100-092-B1-H	C-101 tray 10	C-102	B1 - 300# CS ASTM A106 Gr.B
DESIGN P / T	OPER. P / T	TEST P (HYDRO)	PIPE WALL
3.5 barg / 250 C	1.29 barg / 219.5 C	5.5 barg (1.5xPxST/S=1.05)	SCH 40 (9.27 mm)
INSULATION	PWHT	NDE	STRESS
H 75 mm	NO	10 % RT of BW	CAT 1 - fails simplified eq.(16)
P&ID	FLUID / PHASE	PAINT	SPOOLS / WELDS
CFU-100-PR-PID-007, CFU-100-PR-PID-008	P / L Kerosene draw to strippe	HT silicone/Al (insul.)	3 spools; 8 shop / 2 field