


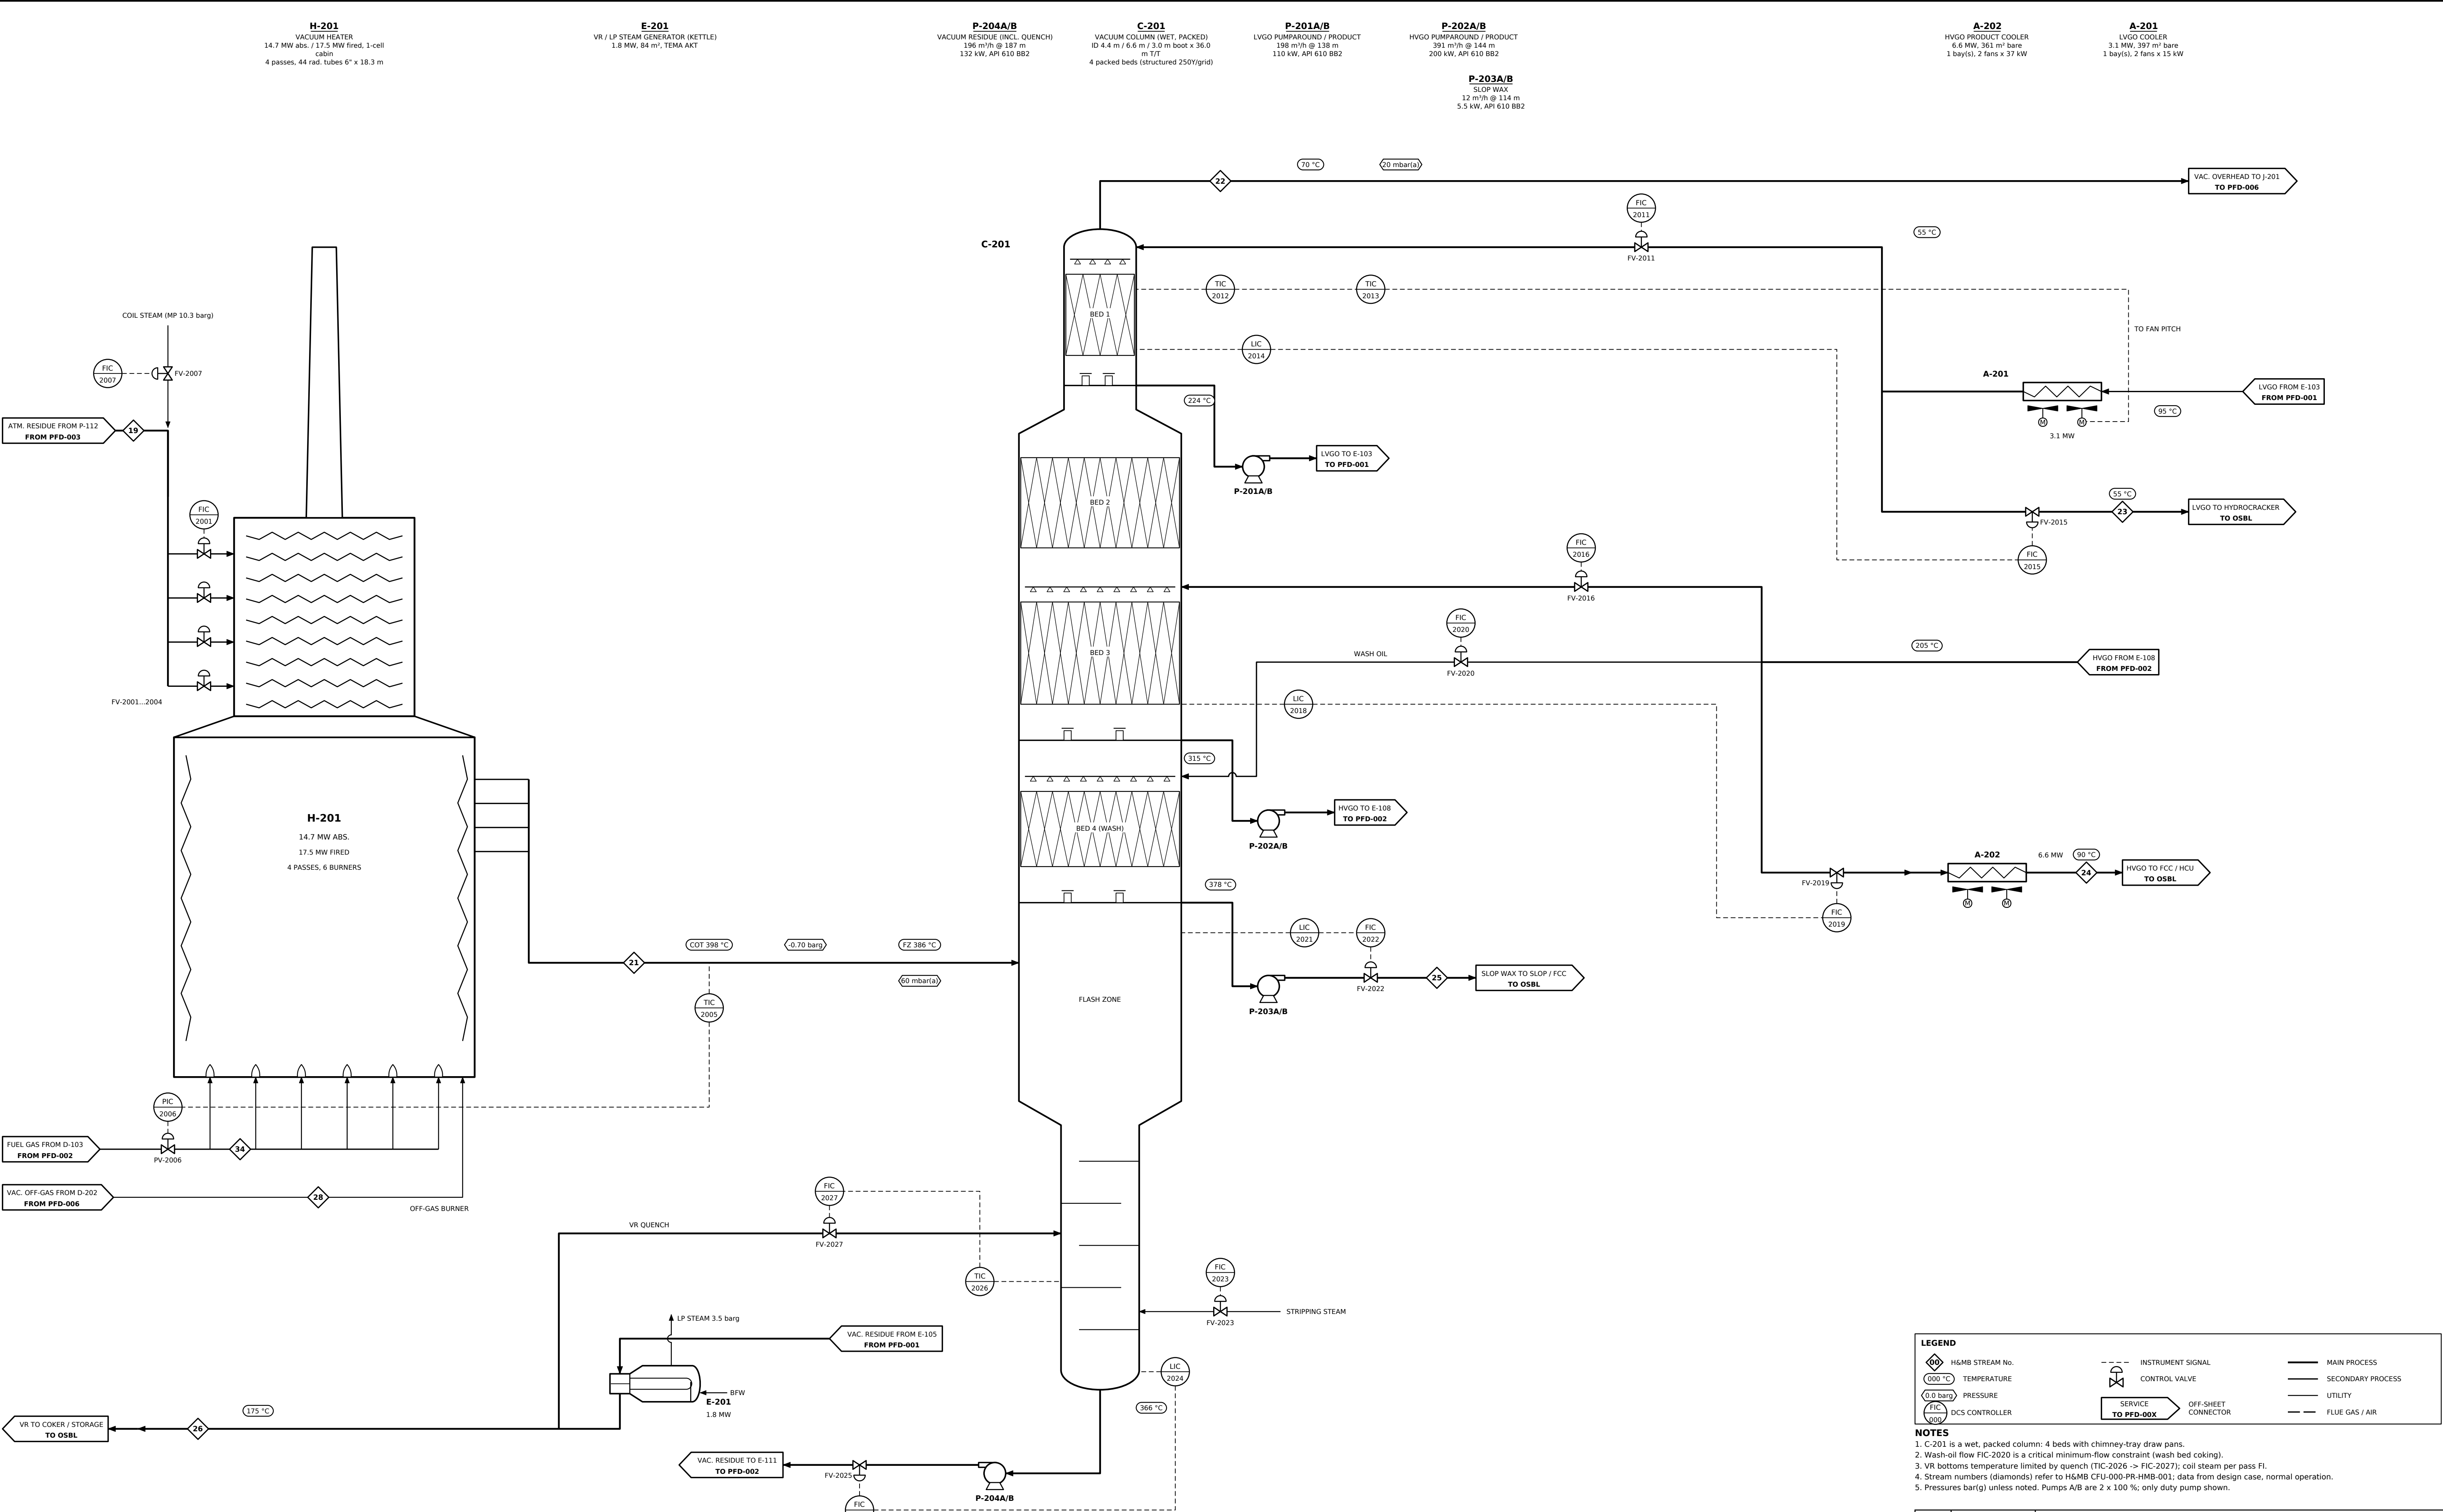

STREAM No.	19	21	22	23	24	25	26	27	28
DESCRIPTION	Atmospheric residue	Vacuum heater outlet	Vacuum column overhead	LVGO product	HVGO product	Slop wax (hot, traced)	Vacuum residue	Vacuum off-gas (NCG + air)	Fuel gas to heaters
PHASE	LIQUID	MIXED	VAPOUR	LIQUID	LIQUID	LIQUID	LIQUID	VAPOUR	VAPOUR
TOTAL FLOW kg/h	256,909	258,055	3,020	50,356	90,396	7,894	108,263	102	6,504
TEMPERATURE °C	349	398	70	55	378	175	45	30	
PRESSURE barg	19.0	-0.70	-0.99	7.0	7.0	9.0	0.0	3.5	
STD LIQ. FLOW BPSD	40,413	40,413	-	8,467	14,553	1,212	16,181	-	
VAPOUR FRACTION (mass)	0	0.264	1	0	0	0	1	1	
MOLECULAR WEIGHT	528.6	528.6	-	339.7	462.4	671.3	829.6	-	

H&MB STREAM No.

TEMPERATURE

PRESSURE

DCS CONTROLLER

INSTRUMENT SIGNAL

CONTROL VALVE

SERVICE TO PFD-00X

MAIN PROCESS

SECONDARY PROCESS

UTILITY

FLUE GAS / AIR

NOTES

1. C-201 is a wet, packed column: 4 beds with chimney-tray draw pans.

2. Wash-oil flow FIC-2020 is a critical minimum-flow constraint (wash bed coking).

3. VR bottoms temperature limited by quench (TIC-2026 -> FIC-2027); coil steam per pass FI.

4. Stream numbers (diamonds) refer to H&MB CFU-000-PR-HMB-001; data from design case, normal operation.

5. Pressures bar(g) unless noted. Pumps A/B are 2 x 100 %; only duty pump shown.

REV	DATE	DESCRIPTION
A	2026-10-02	Issued for review (FEED)

GENERIC REFINERY - GULF COAST

100 KBPSD CRUDE & VACUUM DISTILLATION UNIT

PROCESS

STAGE

SCALE

SHEET

VACUUM HEATER H-201 & VACUUM COLUMN C-201

5 OF 6

DRAWN	CHECKED	APPROVED	DATE
CLAUDE CODE	-	-	2026-10-02

DRAWING NUMBER

CFU-200-PR-PFD-005

REV

A