


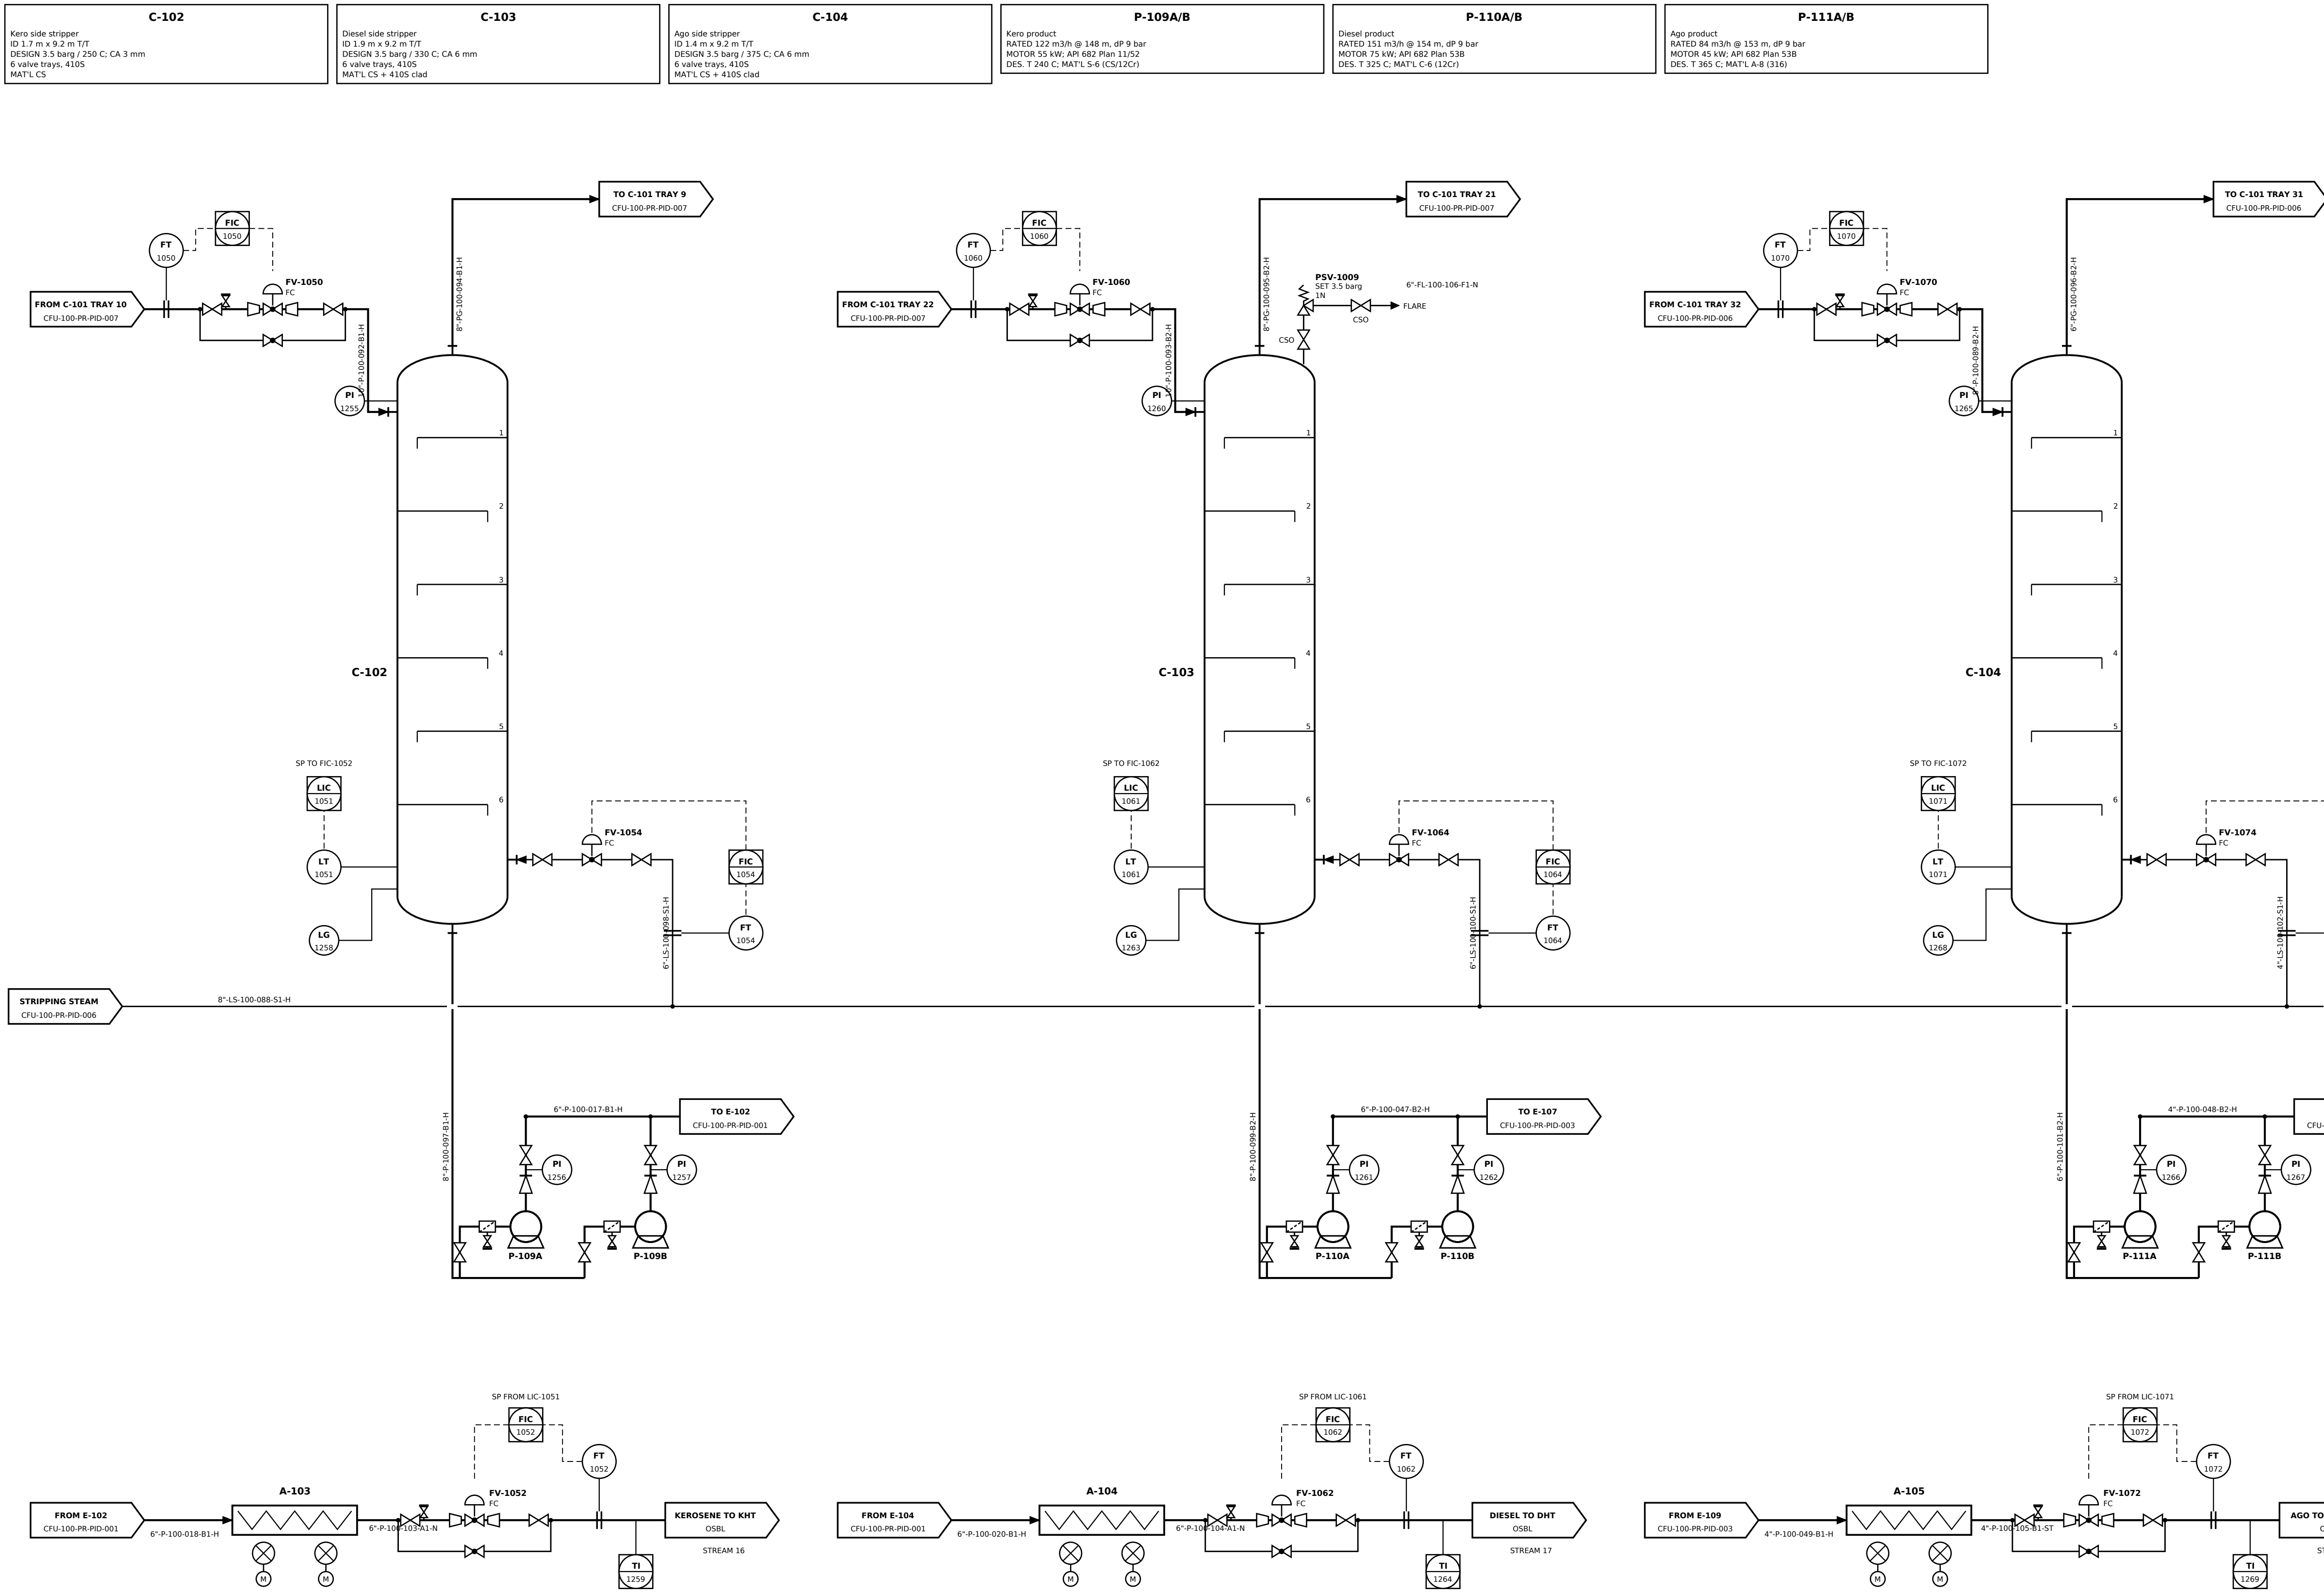

- NOTES**
- 1. Side-stripper vapours return to C-101 one tray above draw; strippers protected by PSV-1009 (fire case).
 - 2. Stripping steam ratio to product rate (6 lb/bbl) via FIC-1054/1064/1074.
 - 3. Product rundown temperatures: kerosene 45 C, diesel 55 C, AGO 60 C (air coolers with VFD on one fan).
 - 4. Line numbers: <NPS>-<fluid>-<area>-<seq>-<class>-<insulation> per CONVENTIONS; see line list CFU-000-PI-LL-001.
 - 5. All vents / drains 3/4" min. with blind or cap; HPV/LPD to piping specification. Valve sizes = line size UNO.
 - 6. Instrument tags per ISA-5.1; index CFU-000-IC-IDX-001. SIS functions per SRS (SIF tags shown in interlocks).

REV	DATE	DESCRIPTION	
A	2026-10-02	Issued for review (FEED)	
GENERIC REFINERY - GULF COAST 100 KBPSD CRUDE & VACUUM DISTILLATION UNIT			
PIPING & INSTRUMENT DIAGRAM SIDE STRIPPERS C-102/103/104 & PRODUCT RUNDOWN			
DISCIPLINE	STAGE	SCALE	SHEET
PROCESS	FEED	NTS	9 OF 17
DRAWN	CHECKED	APPROVED	DATE
CLAUDE CODE	-	-	2026-10-02
DRAWING NUMBER			REV
CFU-100-PR-PID-008			A