


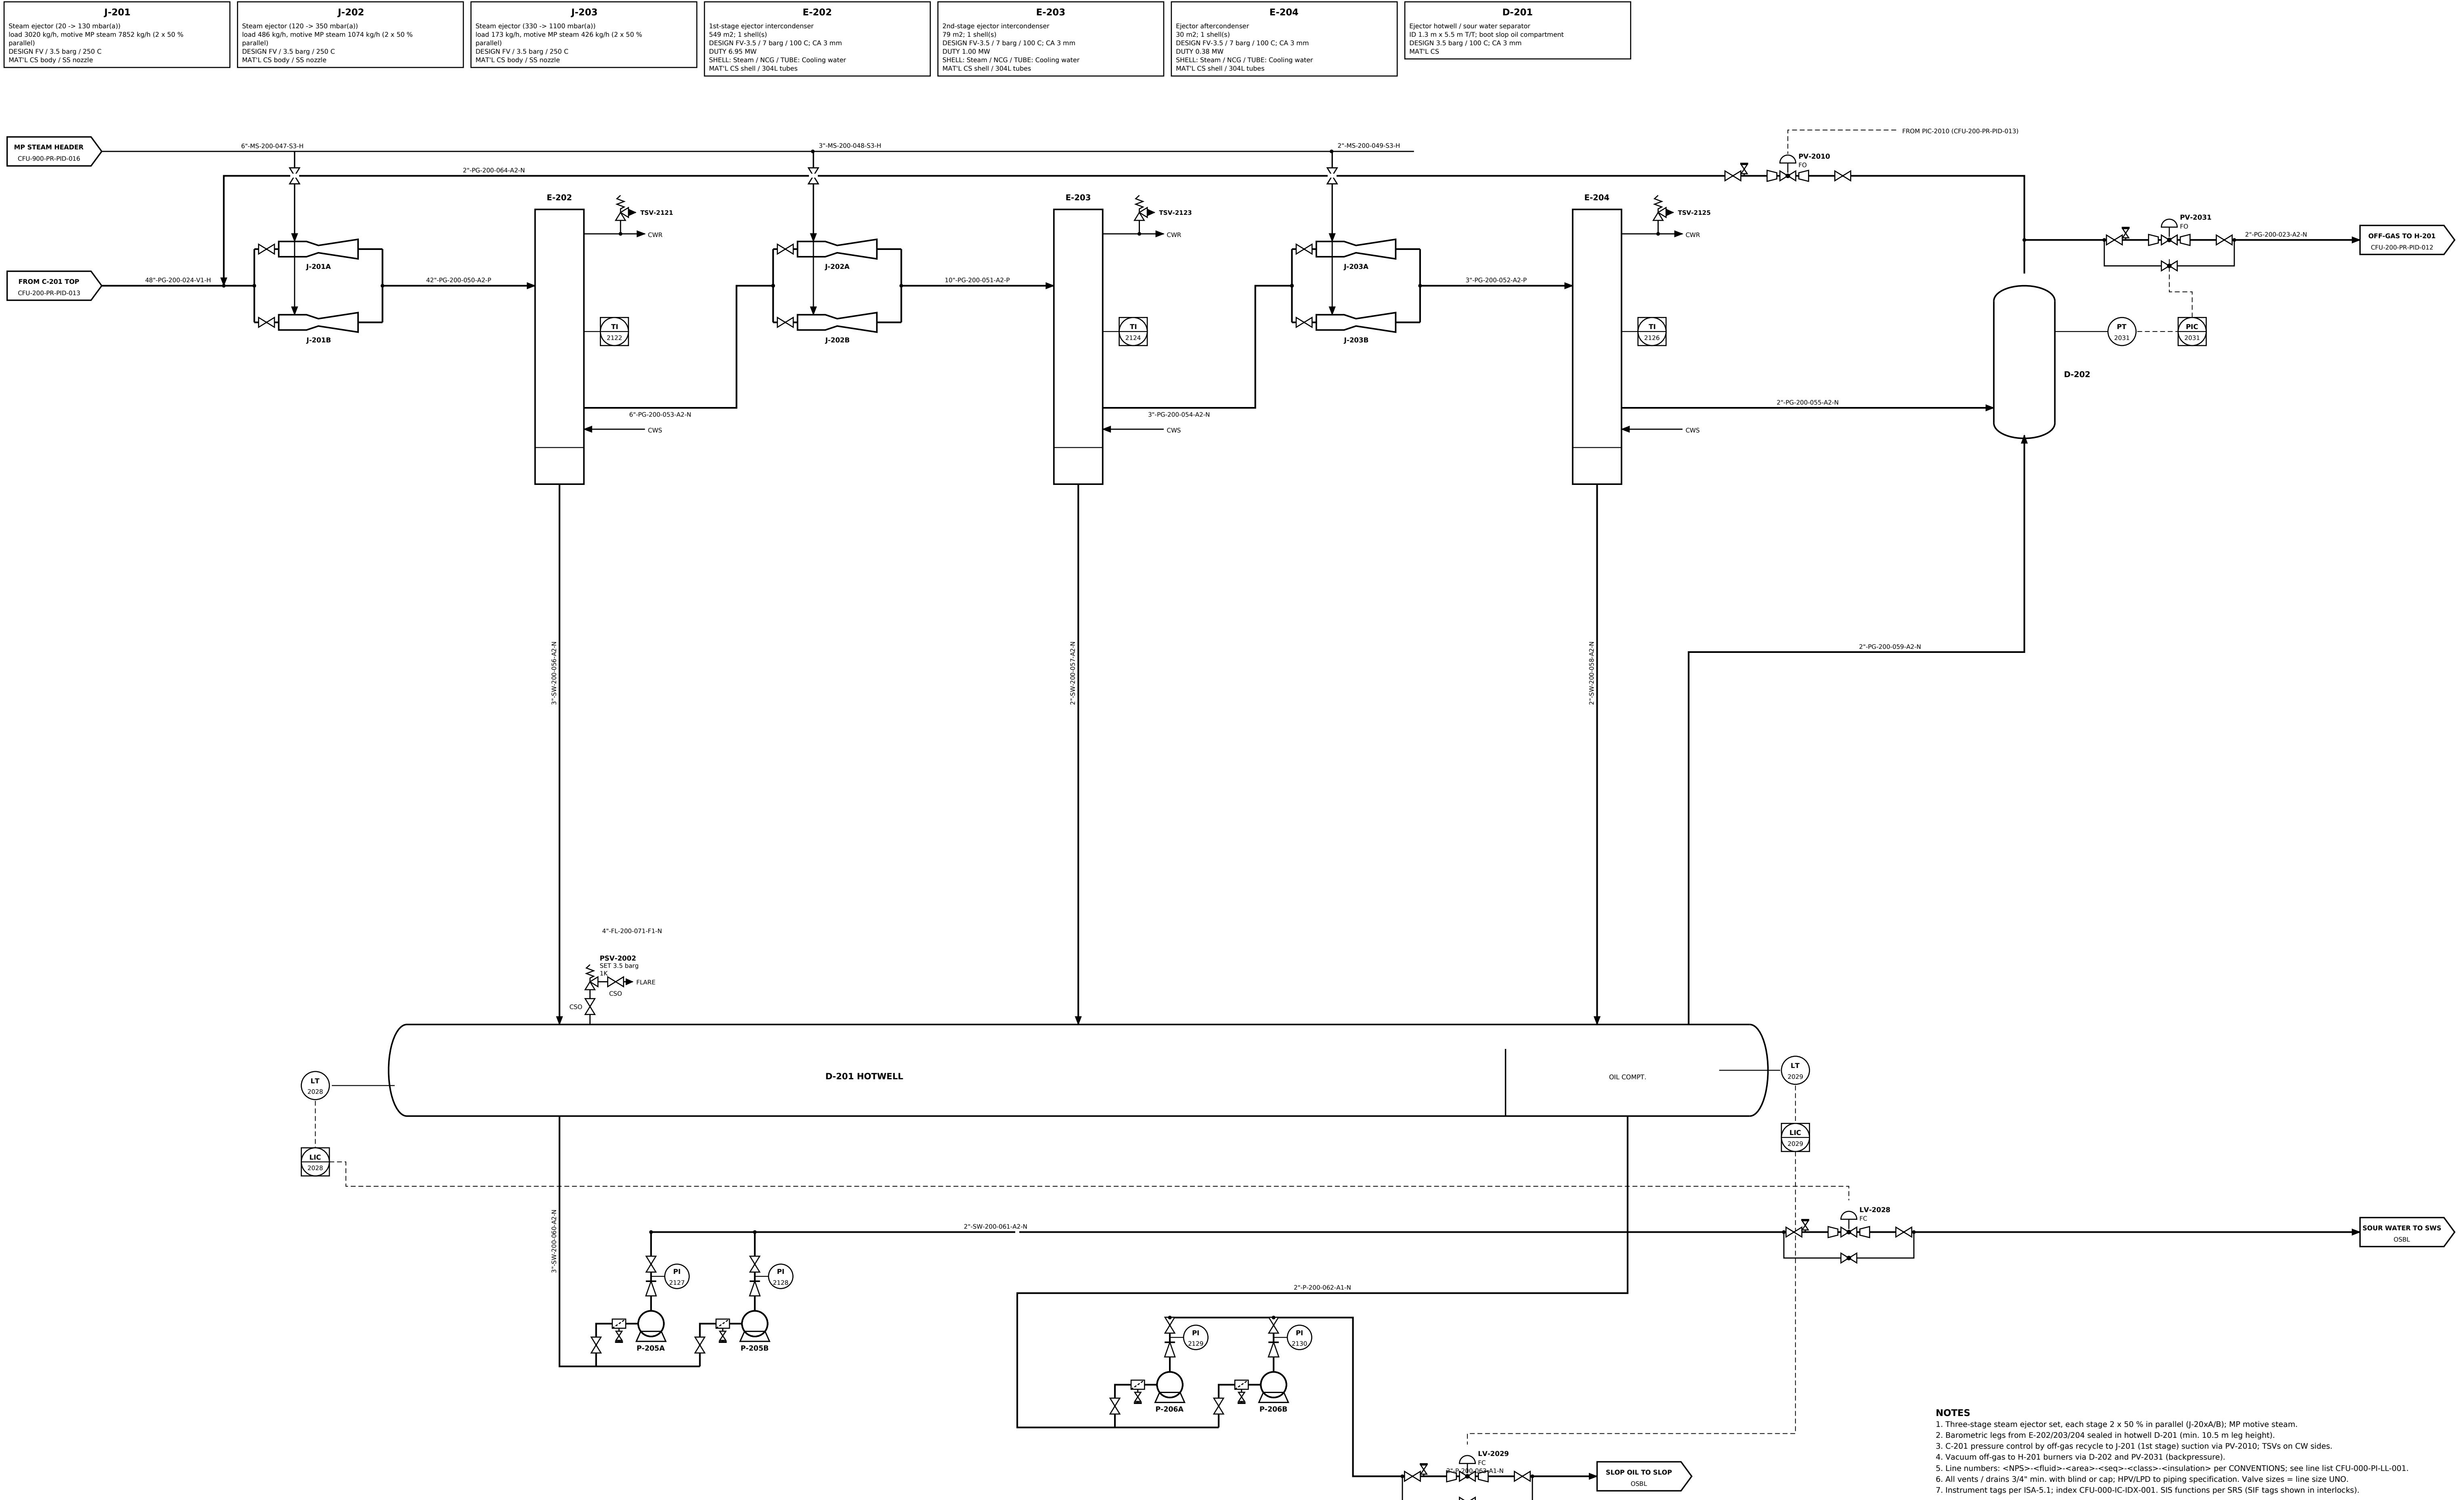

COOLING WATER CONNECTIONS (HEADERS ON CFU-200-PR-PID-010):
E-202: CWS 12" CWS-200-065-U1-N / CWR 12" CWR-200-066-U1-N
E-203: CWS 6" CWS-200-067-U1-N / CWR 6" CWR-200-068-U1-N
E-204: CWS 3" CWS-200-069-U1-N / CWR 3" CWR-200-070-U1-N

- NOTES**
- Three-stage steam ejector set, each stage 2 x 50 % in parallel (J-20xA/B); MP motive steam.
 - Barometric legs from E-202/203/204 sealed in hotwell D-201 (min. 10.5 m leg height).
 - C-201 pressure control by off-gas recycle to J-201 (1st stage) suction via PV-2010; TSVs on CW sides.
 - Vacuum off-gas to H-201 burners via D-202 and PV-2031 (backpressure).
 - Line numbers: <NPS>-<fluid>-<area>-<seq>-<class>-<insulation> per CONVENTIONS; see line list CFU-000-PI-LL-001.
 - All vents / drains 3/4" min. with blind or cap; HPV/LPD to piping specification. Valve sizes = line size UNO.
 - Instrument tags per ISA-5.1; index CFU-000-IC-IDX-001. SIS functions per SRS (SIF tags shown in interlocks).

REV	DATE	DESCRIPTION	
A	2026-10-02	Issued for review (FEED)	
GENERIC REFINERY - GULF COAST			
100 KBPSD CRUDE & VACUUM DISTILLATION UNIT			
PIPING & INSTRUMENT DIAGRAM			
VACUUM EJECTOR SYSTEM & HOTWELL D-201			
DISCIPLINE	STAGE	SCALE	SHEET
PROCESS	FEED	NTS	16 OF 17
DRAWN	CHECKED	APPROVED	DATE
CLAUDE CODE	-	-	2026-10-02
DRAWING NUMBER			REV
CFU-200-PR-PID-015			A