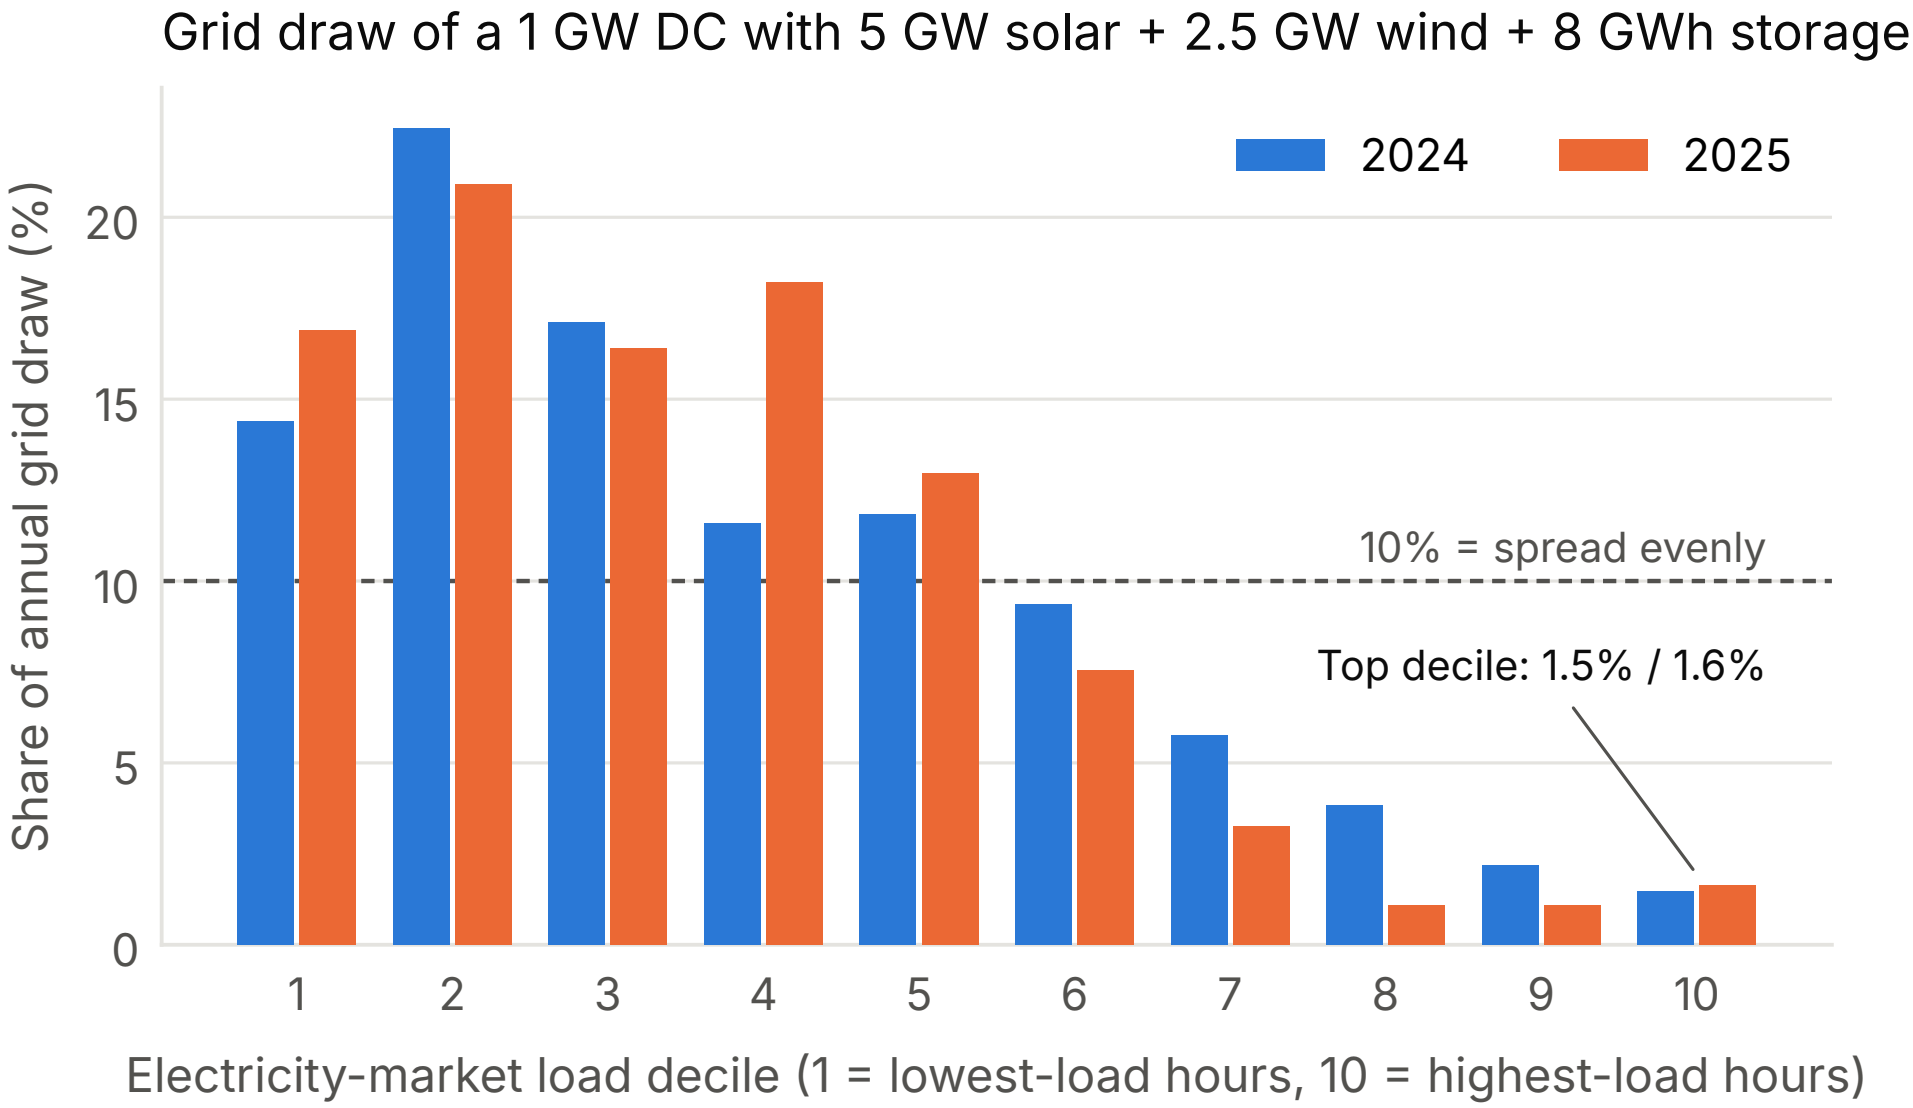
Grid draw of a 1 GW DC with 5 GW solar + 2.5 GW wind + 8 GWh storage
2024
2025
Share of annual grid draw (%)
0
5
10
15
20
10% = spread evenly
Top decile: 1.5% / 1.6%
1
2
3
4
5
6
7
8
9
10
Electricity-market load decile (1 = lowest-load hours, 10 = highest-load hours)