CFD OPTIMIZATION REPORT

Project: TEST-001 | Prepared for: Test Corp

1. EXECUTIVE SUMMARY

CFD analysis for Small Meeting Room. MEETS ASHRAE 55.

2. OPTIMIZED SETTINGS

V=0.36m/s, A=25.0°, T=20.0°C

3. THERMAL ANALYSIS

CFD OPTIMIZATION REPORT

Project: TEST-001 | Prepared for: Test Corp

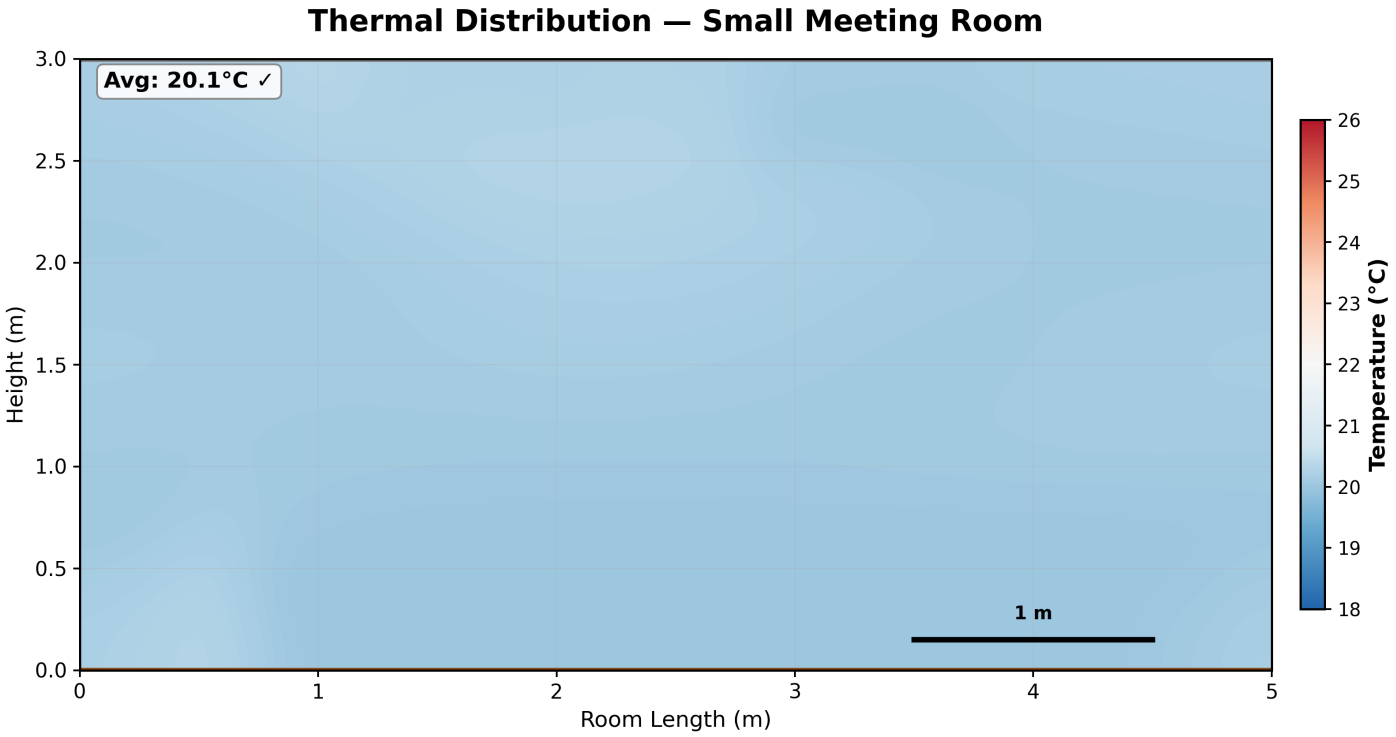

COMFORT ZONE

CFD OPTIMIZATION REPORT

Project: TEST-001 | Prepared for: Test Corp
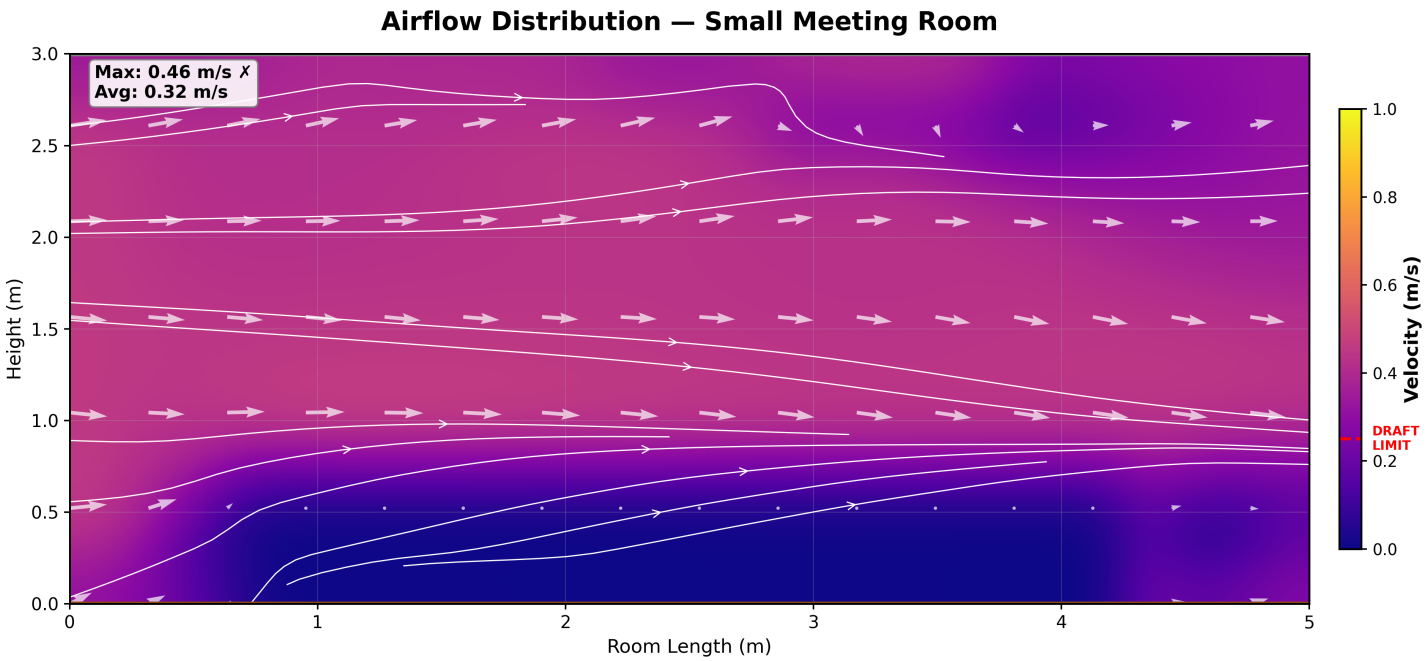
4. AIRFLOW ANALYSIS