


# CONSTRUCTION NOTE

1. LINE TRUCK ACCESSIBLE.
2. REPLACE GRAY SERVICES AND BENT/EXPOSED ANCHOR.

PRIVATE  
PROPERTY

SAPID# 101289291  
MAP: AS115-J18


COORDINATE #  
221168057202  
LOADING DISTRICT  
SUMMER INTERIOR  
TX SIZE - 25/25KVA  
KVA 1Ø - 7.4 KVA  
KVA 3Ø - 15.5 KVA  
% L.F. - 35%

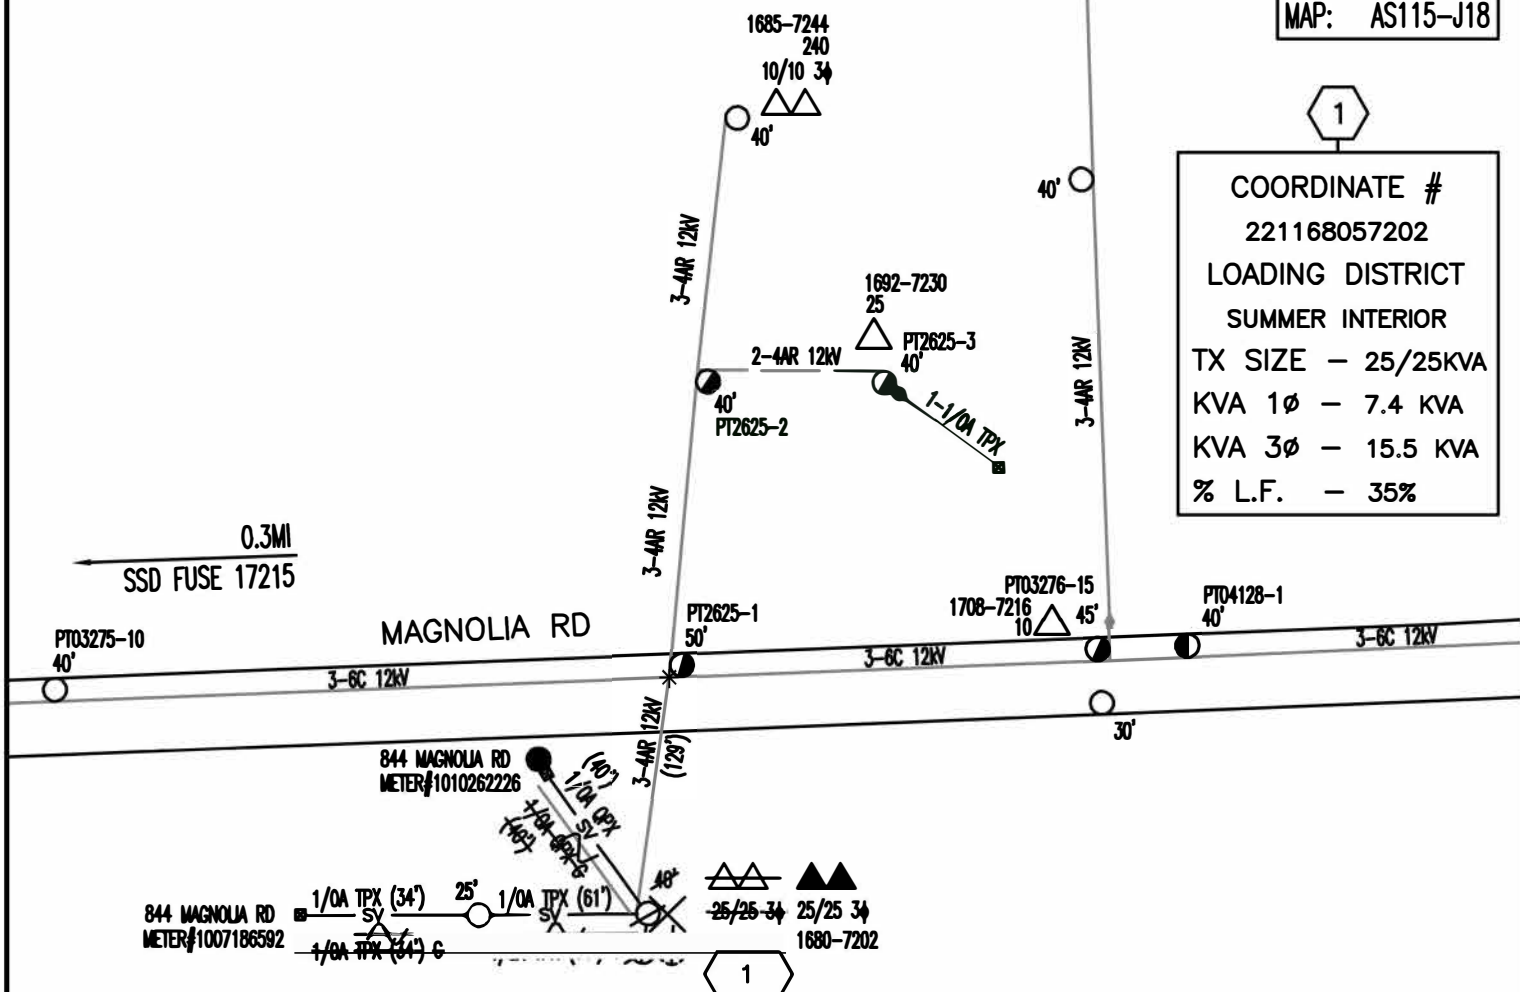

40'/50'-4  
SET 8' DEEP  
HARDSET EAST

INSTALL  
15M PISA ANCHOR  
12' LEAD  
1-3/8" PRI DG

VICINITY SKETCH

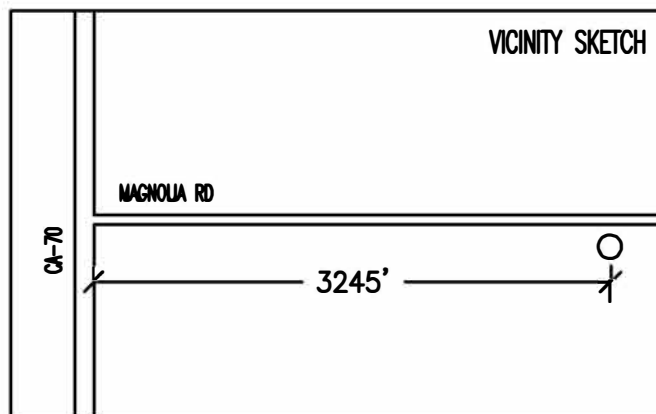

PRIMARY VOLTAGE: 12 kV | VOLTAGE AREA: 2  
LATITUDE: 39.236507 | LONGITUDE: -121.588597  
SOURCE SIDE DEVICE: FUSE 17215  
SUB & CIRCUIT: HONCUT 1102

DSGN SAG: RURAL | RAPTOR ZONE: YES  
LOADING AREA: LIGHT | ARRESTER DIST: 2  
CORROSION AREA: NON | INSULATION DIST: D

EXEMPT EQUIP.INST.: NO | FIRE AREA: LRA-TIER 1

REPLACE LEANING PG&E POLE  
R/O 844 MAGNOLIA RD./1PE  
MARYSVILLE, CA 95901



Know what's below.  
Call before you dig.

NO ENVIRONMENTAL  
ISSUES



PLNR: N/A | N/A  
JPA#: N/A | SCALE: NTS  
NOTIF: 119648377 | DATE: 7/10/2023  
PM: 35412692 | SHEET: 1 OF 1 | REV. 0