CABLE/WIRE MARKING/TAGGING - GENERAL

1. MULTICONDUCTOR CABLE ASSEMBLIES SUCH AS TC-ER, MC, ETC., SHALL HAVE OUTER JACKET WIRE IDENTIFICATION. THE CABLE TAG NUMBER SHALL REMAIN THE SAME FROM ONE END OF THE CABLE TO THE OTHER.
2. NOTE 2 DELETED ON REV. 2.
3. ALL MULTIWIRE CABLE TAGS SHALL INCLUDE THE SOURCE EQUIPMENT NO., THE CIRCUIT NUMBER (IF APPLICABLE), THE USER EQUIPMENT NO., AND A FUNCTION SUFFIX FOR THE CABLE TYPE. SEE EXAMPLES ON THIS DWG. FOR CLARIFICATION.
4. ALL MULTICONDUCTOR CABLES SHALL HAVE INNER CORE WIRE AND OVERALL JACKETS LABELED.
5. SPARE MULTICONDUCTOR CABLES SHALL BE MARKED "SPARE" AND SHALL INCLUDE THE END LOCATIONS OF WHERE THE CABLE IS TERMINATED OR COILED FOR FUTURE USE.
6. WHERE CABLES ARE PARALLELED, THE CABLES SHALL INCLUDE APPROPRIATE SUFFIXES SUCH AS "-P1, -P2, -P3, ETC.", AS INDICATED ON THE CONDUIT/CABLE SCHEDULE, UNLESS NOTED OTHERWISE.
7. CABLE TAGS SHALL USE THE FOLLOWING COLORS AND FONTS,UNLESS NOTED OTHERWISE AND SHALL COMPLY WITH NEC REQUIREMENTS:

   NON-EMERGENCY CIRCUITS:

   WHITE LABEL WITH BLACK LETTERS/NUMBERS, ARIAL 65 TRUE TYPE FONT, UNLESS NOTED OTHERWISE.

   EMERGENCY CIRCUITS (NEC ART. 700, SECTION 700.10):


   RED LABELS WITH WHITE LETTERS/NUMBERS, ARIAL 65 TRUE TYPE FONT UNLESS NOTED OTHERWISE. EMERGENCY CIRCUITS MUST BE CLEARLY DESIGNATED AS BEING PART OF THE EMERGENCY SYSTEM.

   NOTE: LEGALLY REQUIRED AND OPTIONAL STANDBY SYSTEMS (NEC 701 AND 702, RESPECTIVELY) ARE NOT EMERGENCY SYSTEM CIRCUITS AND SHALL NOT BE LABELED AS SUCH OR HAVE RED WIRE LABELS.


8. WHERE MULTICONDUCTOR CABLES CONTAIN NUMBERED, BLACK, INSULATED CONDUCTORS, (ICEA METHOD 4), THE CONTRACTOR SHALL LABEL EACH INDIVIDUAL CONDUCTOR WITH A HEAT SHRINK MARKING SLEEVE THAT INDICATES THE 3-DIGIT COLOR ABBREVIATION AS INDICATED ON THE DRAWINGS WHERE APPLICABLE, [I.E., (RED), (BLU), (BLK), ETC.]. THE HEAT SHRINK TUBING PER EACH CONDUCTOR DOES NOT HAVE TO BE A DIFFERENT COLOR.
9. WHERE MULTICONDUCTOR CABLES CONTAIN COLORED CONDUCTORS, (ICEA METHOD 1, TABLE E2), AND NOT ALL WIRE COLORS INDICATED ON THE DRAWINGS ARE AVAILABLE WITHIN THE CABLE, THE CONTRACTOR SHALL USE THE CORRECT COLORS TO THE FULLEST EXTENT POSSIBLE AND RE-IDENTIFY OTHER COLORS WITH A TAG NUMBER AND COLOR INDICATION PRINTED ON THE SHRINK SLEEVES [I.E., (RED), (BLU), (BLK), ETC.]. THE HEAT SHRINK TUBING PER EACH CONDUCTOR DOES NOT HAVE TO BE A DIFFERENT COLOR.
10. REGARDLESS OF ICEA METHOD USED, THE CONTRACTOR SHALL IDENTIFY AND MARK ONE OF THE CONDUCTORS GREEN WITH COLORED ELECTRICAL TAPE OR HEAT SHRINK AND WITH A WHITE HEAT SHRINK SLEEVE IDENTIFYING THE EQUIPMENT GROUNDING CONDUCTOR AS INDICATED, [I.E., (GRN)]. THE HEAT SHRINK TUBING DOES NOT HAVE TO BE GREEN IN COLOR AND BARE GROUNDING CONDUCTORS DO NOT REQUIRE A WIRE MARKER. EQUIPMENT GROUNDING CONDUCTOR MARKINGS SHALL COMPLY WITH NEC ART. 250.119.
11. CABLE AND WIRE TAGGING ON THIS DRAWING DOES NOT APPLY TO CABLES THAT ARE PART OF PRE-WIRED, PACKAGED, MANUFACTURED EQUIPMENT, OR PURCHASED SYSTEMS WITH SEPARATE VENDOR DRAWINGS.

INDIVIDUAL WIRE IN CONDUIT AND/OR INNER CORE MARKING/TAGGING IN MULTICONDUCTOR CABLES


1. WIRE TAG NUMBERS ARE NOT REQUIRED FOR INDIVIDUAL POWER CONDUCTORS IN CONDUIT SYSTEMS, BUT PHASES SHALL BE MARKED WITH COLORED ELECTRICAL TAPE AS NOTED ON DWG. LP100-EJ-00000001 AND OTHER DRAWINGS SUCH AS THE SCHEMATIC DIAGRAMS OR INTERCONNECTING WIRING DIAGRAMS.
2. INDIVIDUAL CONTROL WIRE TAGS SHALL INDICATE THE EQUIPMENT NO., TERMINAL STRIP NO., AND TERMINAL WHERE THE WIRE IS TERMINATED AS INDICATED IN EXAMPLE NO. 1
3. WHERE THERE IS NO TERMINAL STRIP, TERMINAL STRIP NUMBER COMPONENT IS OMITTED. SEE EXAMPLE NO. 2 BELOW.
4. INSULATED EQUIPMENT GROUNDING CONDUCTORS LARGER THAN 6 AWG IN EACH CONDUIT SHALL BE MARKED WITH GREEN MARKING TAPE. BARE COPPER EQUIPMENT GROUNDING CONDUCTORS DO NOT REQUIRE IDENTIFICATION.
5. WIRE COLORS ARE FOR INFORMATION ONLY AND NOT PART OF TAG NO.
6. WHERE LOCATED IN AN MCC, CIRCUIT OR CIRCUIT BREAKER NUMBER COMPONENT OF TAG IS NOT REQUIRED SINCE SOURCE IS SINGLE BREAKER IN AN INDIVIDUAL CUBICLE.
7. ABOVEGROUND RACEWAYS(CONDUIT OR EMT) DO NOT REQUIRE CONDUIT TAGS.



EXAMPLE NO. 1
WIRE TAGS AT NUMBERED TERMINAL STRIP



EXAMPLE NO. 2
WIRE TAGS AT TERMINAL STRIP WITHOUT NUMBER

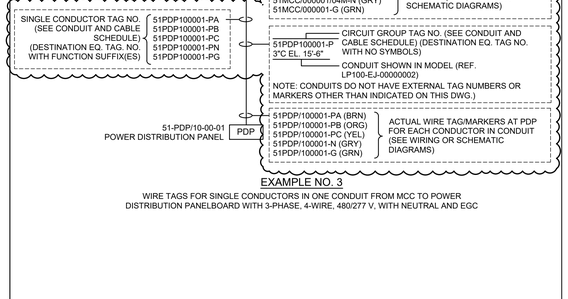

EXAMPLE NO. 3
WIRE TAGS FOR SINGLE CONDUCTORS IN ONE CONDUIT FROM MCC TO POWER DISTRIBUTION PANELBOARD WITH 3-PHASE, 4-WIRE, 480/277 V, WITH NEUTRAL AND EGC

CABLE TYPE (FUNCTION) SUFFIXES

1. SEE CABLE/WIRE MARKING/TAGGING GENERAL SECTION, THIS DWG. THE FOLLOWING SUFFIXES ARE TO BE INDICATED AS PART OF THE CABLE TAG NO. WITH A PRECEDING DASH, FOR EXAMPLE: "-P" SUFFIX INDICATES A POWER CABLE.

C - CONTROL; (24 VDC OR 120 VAC, CONTROL CIRCUITS ONLY, NO POWER, TYPE TC-ER OR MC MULTICONDUCTOR CABLES RATED 600 V)

D - DATA; ETHERNET, COAX, OPTICAL FIBER CABLES (300 V RATED INSULATION, IF RATED)

G - EQUIPMENT GROUNDING CONDUCTOR OR GROUNDING ELECTRODE CONDUCTOR, SINGLE CONDUCTOR IN CONDUIT OR CABLE TRAY, MAY BE BARE, COVERED, OR 600 V INSULATED. NOT TO BE USED FOR NEUTRAL CONDUCTOR

M - 5 KV OR 15 KV:

- MULTICONDUCTOR CABLES: (-M) OR, (-M1, -M2, ETC., FOR PARALLEL CABLES);
- SINGLE CONDUCTORS IN CONDUIT OR TRAY: (-MA, -MB, -MC, -MG) OR, (-M1A, -M1B, -M1C, -M1G, -M2A, -M2B, -M2C, -M2G, ETC., FOR PARALLEL CONDUCTORS).

(NOTE: GROUNDING CONDUCTORS ARE NOT MV-105 INSULATED BUT RETAIN THE "M" FOR THE RELATED MEDIUM VOLTAGE CIRCUIT.)

LEGEND:
M = MEDIUM VOLTAGE
= SEQUENCE NUMBER
ALPHA = PHASE (SINGLE CONDUCTORS)

N - NEUTRAL OR GROUNDED CONDUCTOR, MAY BE CURRENT-CARRYING, OR HRG CONDUCTOR FROM XFMR "X0" BUSHING TO HRG OR NGR RESISTOR FOR IMPEDANCE GROUNDED SYSTEMS; SINGLE CONDUCTOR. FOR 5 AND 15 KV INSTALLATIONS "N" CONDUCTORS ARE MV-105 INSULATED

P - < 1000 VOLTS,

- MULTICONDUCTOR CABLES: (-P) OR, (-P1, -P2, ETC., FOR PARALLEL CABLES);
- SINGLE CONDUCTORS IN CONDUIT OR TRAY: (-PA, -PB, -PC, -G) OR, (-P1A, -P1B, -P1C, -G, -P2A, -P2B, -P2C, -G, ETC., FOR PARALLEL CONDUCTORS).

(NOTE: GROUNDING CONDUCTORS FOR CIRCUITS <1000 V DO NOT REQUIRE A "P" AND IF IN PARALLEL DO NOT REQUIRE A "P" OR SEQUENCE NO.)

LEGEND:
P = POWER < 1000 VOLTS
= SEQUENCE NUMBER
ALPHA = PHASE (SINGLE CONDUCTORS)

S - SIGNAL; 4-20mA, DISCREET I/O, TWISTED OR SHIELDED PAIRS AND TRIADS 300 OR 600 V INSULATION, TYPES TC-ER, ITC-ER, OR MC MULTICONDUCTOR CABLES

CONDUIT MARKING/TAGGING

1. THE TERM "CONDUIT" SHALL INCLUDE CIRCULAR TYPE RACEWAYS INCLUDING EMT, RIGID CONDUIT, AND FLEXIBLE CONDUIT.
2. CONDUITS FOR PUBLIC ADDRESS WIRING SHALL BE LABELED EVERY 20 FT. (MAX.).
3. ABOVEGROUND CONDUITS CONTAINING CIRCUITS GREATER THAN 600 V NOMINAL, SHALL BE PAINTED RED, AND LABELED "HIGH VOLTAGE" EVERY 20 FT. (MAX.).
4. SPARE UNDERGROUND CONDUITS SHALL BE TAGGED AS "SPARE" WHERE THEY ARE STUBBED UP.
5. METALLIC CONDUIT SURFACES WHERE ADHESIVE LABELS ARE APPLIED MUST BE CLEANED AND DEGREASED WITH AN APPROPRIATE CLEANSER SUCH AS CRC #02018 LECTRACLEAN HEAVY-DUTY DEGREASER BEFORE APPLYING THE LABELS. THE CONTRACTOR MUST ENSURE THE CLEANING PRODUCT APPLIED WILL NOT DAMAGE THE METALLIC SURFACE PRIOR TO APPLICATION.
6. CONDUIT LABELS, WHERE REQUIRED, IN HYGIENIC CLEAN ROOMS SHALL BE FDA APPROVED. USE BRADY TYPE B-855 LABELS OR EQUIVALENT.
7. CONDUITS CONTAINING EMERGENCY CIRCUITS SHALL BE CLEARLY IDENTIFIED AND DESIGNATED AS "EMERGENCY" CIRCUITS WITH LABELS APPLIED ON THE CONDUIT PER 2023 NEC SECTION 700.10. THE LABELS SHALL BE RED WITH WHITE LETTERS, ARIAL 65 TRUE TYPE FONT, UNLESS NOTED OTHERWISE.

   NOTE: LEGALLY REQUIRED AND OPTIONAL STANDBY SYSTEMS (NEC 701 AND 702, RESPECTIVELY) ARE NOT "EMERGENCY SYSTEM CIRCUITS" AND SHALL NOT BE LABELED AS SUCH.


MULTICONDUCTOR CABLE MARKING/TAGGING

1. CABLE TAGS SHALL BE APPLIED BY EACH CONTRACTOR FOR THEIR APPLICABLE SCOPE ON THE OUTER JACKETS OF MULTICONDUCTOR CABLES IN ACCORDANCE WITH PROJECT SPEC LP100-265-EMS-16195, SECTION 2.2. EXAMPLES ARE SHOWN BELOW:

   "2.2 WIRE MARKERS
   A. FOR FEEDERS #3 AWG AND LARGER USE 3/4 INCH BY 1.5 INCH NYLON MARKER PLATES AFFIXED WITH NYLON TIE WRAPS AT BOTH ENDS. MARK WITH A PERMANENT MARKER THE SOURCE, THE CIRCUIT NUMBER AND EQUIPMENT NUMBER BEING SERVED.
   1. PANDUIT NO. MP150-C OR EQUAL

   B. FOR CONTROL WIRING, BRANCH CIRCUITS AND FEEDER WIRING LESS THAN #3 AWG USE COMPUTER PRINTABLE, SLIP-ON HEAT SHRINKABLE WIRE MARKERS AT BOTH ENDS. PRINT THE SOURCE, THE CIRCUIT NUMBER AND EQUIPMENT NUMBER BEING SERVED.
   1. BRADY OR EQUAL"


2. TAGS ARE REQUIRED FOR ALL CABLES OR WIRES PASSING THROUGH JUNCTION BOXES.
3. WHERE USED, HEAT SHRINK SLEEVES SHALL BE WHITE WITH BLACK LETTERS. "WRAP AROUND" OR ADHESIVE TAGS SHALL NOT BE USED.
4. RETAIN SLASH MARKS IN CABLE TAG FOR EQUIPMENT NUMBERS WITH SLASHES. REMOVE DASHES THAT ARE PART OF EQUIPMENT NUMBERS WHEN CREATING THE CABLE OR WIRE TAGS.
5. IF PANELBOARD/BREAKER DESIGN DOESN'T UTILIZE A CIRCUIT NUMBER DESIGNATION FOR EACH PHASE, ADJUST CIRCUIT DESIGNATION ACCORDINGLY. FOR INSTANCE, IF CIRCUIT BREAKER NO. 1 INCLUDES AØ, BØ, AND CØ, THE CKT. NO. ON THE CABLE TAG WOULD ONLY REFLECT CKT. 1.
6. THE PREFIX "LP1" IN THE EQUIPMENT NUMBER IS OMITTED FOR THE CABLE TAGS.

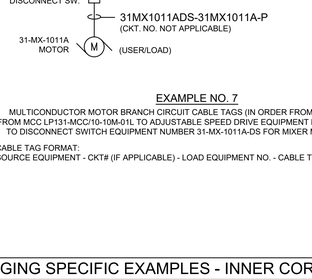

EXAMPLE NO. 7

MULTICONDUCTOR MOTOR BRANCH CIRCUIT CABLE TAGS (IN ORDER FROM TOP TO BOTTOM) FROM MCC LP131-MCC/10-10M-01L TO ADJUSTABLE SPEED DRIVE EQUIPMENT NO. 31-MX-1011A-ASD TO DISCONNECT SWITCH EQUIPMENT NUMBER 31-MX-1011A-DS FOR MIXER MOTOR 31-MX-101A

CABLE TAG FORMAT:
SOURCE EQUIPMENT - CKT# (IF APPLICABLE) - LOAD EQUIPMENT NO. - CABLE TYPE SUFFIX (THIS DWG.)

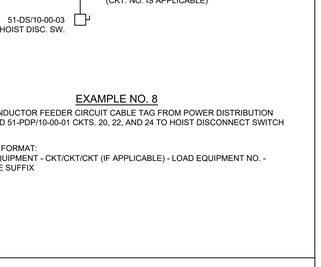


EXAMPLE NO. 8

MULTICONDUCTOR FEEDER CIRCUIT CABLE TAG FROM POWER DISTRIBUTION PANELBOARD 51-PDP/10-00-01 CKTS. 20, 22, AND 24 TO HOIST DISCONNECT SWITCH

CABLE TAG FORMAT:
SOURCE EQUIPMENT - CKT/CKT/CKT (IF APPLICABLE) - LOAD EQUIPMENT NO. - CABLE TYPE SUFFIX

MULTICONDUCTOR CABLE/WIRE TAGGING SPECIFIC EXAMPLES - INNER CORE AND OUTER JACKET

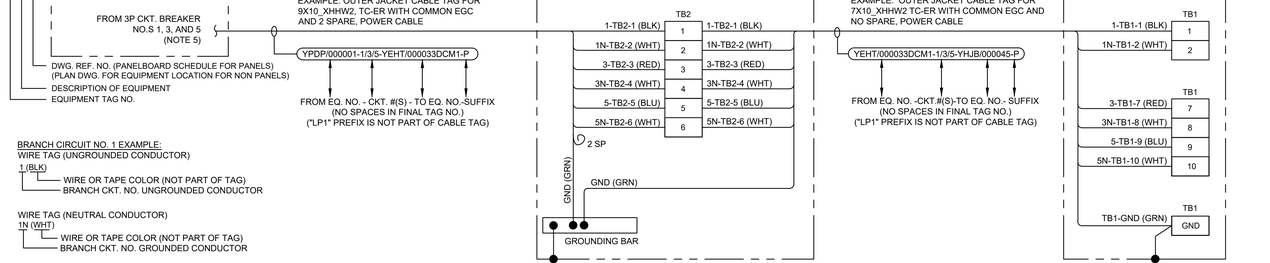

BRANCH CIRCUIT NO. 1 EXAMPLE:
WIRE TAG (UNGROUNDED CONDUCTOR)
1 (BLK)
WIRE OR TAPE COLOR (NOT PART OF TAG)
BRANCH CKT. NO. UNGROUNDED CONDUCTOR

WIRE TAG (NEUTRAL CONDUCTOR)
1N (WHT)
WIRE OR TAPE COLOR (NOT PART OF TAG)
BRANCH CKT. NO. GROUNDED CONDUCTOR

WIRE TAG (EQUIPMENT GROUNDING CONDUCTOR)
GND (GRN)
WIRE OR TAPE COLOR (NOT PART OF TAG)
MARKED GND IF NOT GREEN INSULATED OR BARE ENTIRE LENGTH

NOTES:
1. INDIVIDUAL WIRE TAGS MAY VARY SLIGHTLY FROM THE PHILOSOPHY PRESENTED ON THIS EXAMPLE. HOWEVER, ALL WIRES MUST HAVE TAGS THAT CLEARLY INDICATE WHICH TERMINAL IT IS CONNECTED TO, AND CKT. NO. IF APPLICABLE.

BRANCH CIRCUIT NO. 1 EXAMPLE:
WIRE TAG (UNGROUNDED CONDUCTOR)
EXAMPLE: 1-TB2-1 (BLK)
WIRE OR TAPE COLOR (NOT PART OF TAG)
TERMINAL NO.
TERMINAL STRIP OR BOARD NO.
BRANCH CKT. NO. UNGROUNDED CONDUCTOR (EQ. NO. PREFIX NOT NECESSARY)


WIRE TAG (NEUTRAL CONDUCTOR)
EXAMPLE: 1N-TB2-2 (WHT)
WIRE OR TAPE COLOR (NOT PART OF TAG)
TERMINAL NO.
TERMINAL STRIP OR BOARD NO.
FUNCTION (NEUTRAL)
BRANCH CKT. NO. OF UNGROUNDED CONDUCTOR (EQ. NO. PREFIX NOT NECESSARY)

WIRE TAG (EQ. GND. CONDUCTOR)
EXAMPLE: GND (GRN)
WIRE OR TAPE COLOR (NOT PART OF TAG)
MARKED GND IF NOT GREEN INSULATED OR BARE ENTIRE LENGTH


BRANCH CIRCUIT NO. 1 EXAMPLE:
WIRE TAG (UNGROUNDED CONDUCTOR)
EXAMPLE: 1-TB1-1 (BLK)
WIRE OR TAPE COLOR (NOT PART OF TAG)
TERMINAL NO
TERMINAL STRIP OR BOARD NO.
BRANCH CKT. NO. UNGROUNDED CONDUCTOR (EQ. NO. PREFIX NOT NECESSARY)

WIRE TAG (NEUTRAL CONDUCTOR)
EXAMPLE: 1N-TB1-2 (WHT)
WIRE OR TAPE COLOR (NOT PART OF TAG)
TERMINAL NO.
TERMINAL STRIP OR BOARD NO.
BRANCH CKT. NO. OF UNGROUNDED CONDUCTOR (EQ. NO. PREFIX NOT NECESSARY)


WIRE TAG (EQ. GND. CONDUCTOR)
EXAMPLE: TB1-GND (GRN)
WIRE OR TAPE COLOR (NOT PART OF TAG)
MARKED GND IF NOT GREEN INSULATED OR BARE ENTIRE LENGTH
TERMINAL STRIP OR BOARD NO. IF TERMINAL NO. IS PRESENT. (EQ. NO. PREFIX NOT NECESSARY)

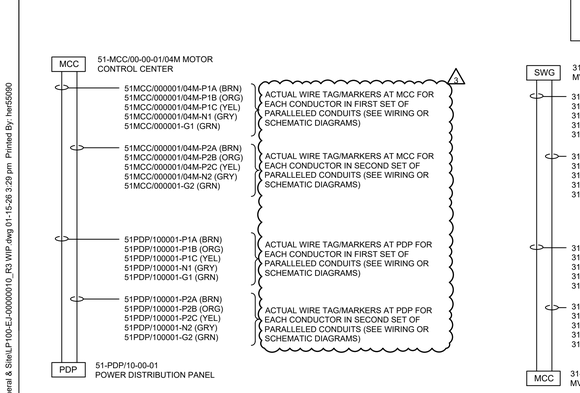

EXAMPLE NO. 4
WIRE TAGS FOR INDIVIDUAL CONDUCTORS IN TWO, PARALLEL ABOVEGROUND CONDUITS FROM MCC TO POWER DISTRIBUTION PANELBOARD 3-PHASE, 4-WIRE, 480/277 V, WITH NEUTRAL AND EGC (SEE EXAMPLE NO. 3 THIS DWG., FOR CIRCUIT GROUP AND SINGLE CONDUCTOR TAGGING METHODOLOGY)

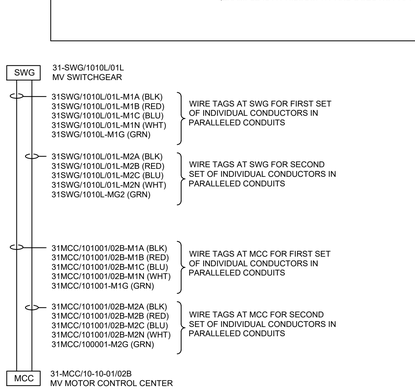

EXAMPLE NO. 5
WIRE TAGS FOR INDIVIDUAL CONDUCTORS IN TWO SETS OF PARALLEL CONDUITS FROM MV SWITCHGEAR 31-SWG/1010L-01L-TO-MV-MOTOR CONTROL CENTER 31-MCC/10-10-01/02B (SEE EXAMPLE NO. 3 THIS DWG., FOR CIRCUIT GROUP AND SINGLE CONDUCTOR TAGGING METHODOLOGY)

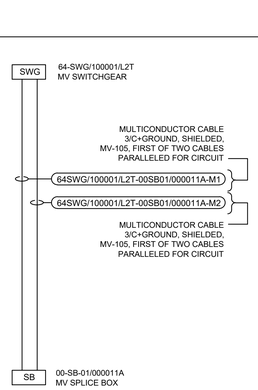

EXAMPLE NO. 6
CABLE TAGS FOR TWO PARALLELED MULTICONDUCTOR MV CABLES FROM MV SWITCHGEAR 64-SWG/100001/L2T TO SPLICE BOX 00-SB-01/000011A

EXAMPLE NO. 9
MULTICONDUCTOR CABLES FROM POWER DISTRIBUTION PANEL LP1Y-PDP/00-00-01 SUPPLIED FROM MULTIPLE BRANCH CIRCUIT BREAKERS 1, 3, AND 5 TO EHT CONTROLLER WHICH THEN SUPPLIES A JUNCTION BOX DOWNSTREAM (EXAMPLE IS A PHILOSOPHY AND DOES NOT APPLY ONLY TO EHT)

NOTES:
1. FOR GENERAL NOTES AND SYMBOLS SEE DWGS, LP100-EJ-00000001 THRU -00000003.
2. THE TERMS "MARKING", "LABELING", AND "TAGGING" ARE USED INTERCHANGEABLY ON THIS DWG.
3. VENDOR/MANUFACTURER PROVIDED WIRE, CABLE AND CONDUIT MARKINGS ARE NOT SUBJECT TO FIELD MARKING/TAGGING INDICATED ON THIS DWG. AND SHALL NOT BE RELABELED, UNLESS NOTED OTHERWISE.
4. MARKER MATERIALS SHALL BE SUITABLE FOR THE APPLICATION (INDOORS, OUTDOORS, AND/OR FDA APPROVED WHERE FDA REGULATIONS APPLY SUCH AS IN HYGIENIC CLEAN ROOMS).
5. MARKING/TAGGING REQUIREMENTS SHALL APPLY TO ALL WIRE AND CABLES IN TRAY AND RACEWAY SYSTEMS, INDOORS, OUTDOORS, UNDERGROUND, AND ABOVEGROUND AS INDICATED BY THE DRAWINGS AND PROJECT SPECIFICATIONS.
6. EXAMPLES ON THIS DRAWING ARE FOR IN FORMATION ONLY AND DEPICT THE METHODOLOGY TO BE USED. NONE OF THE EXAMPLES ARE NODE OR EQUIPMENT SPECIFIC.

3 REVISION 3 NOTES:
CLARIFICATIONS ADDED TO EXAMPLES TO COORDINATE WITH CONDUIT AND CABLE SCHEDULES AND MODEL

PROFESSIONAL ENGINEER
REGISTERED
No. PE12300742
STATE OF INDIANA
Covering Rev 3, 19Jan2026
Digitally signed by Sam Benefield
Date: 2026.01.19 17:07:57 -05'00'

FLUOR

Lilly

ELECTRICAL CONDUIT AND CABLE MARKING
BUILDING 00 SITE / GENERAL

REV	ZONE	PROJECT NUMBER / DESCRIPTION	CHANGE CONTROL	DATE
3		ISSUED FOR CONSTRUCTION	N/A	15-JAN-2026
2		ISSUED FOR CONSTRUCTION	N/A	15-DEC-2025
1		ISSUED FOR CONSTRUCTION	N/A	30-OCT-2025
0		ISSUED FOR CONSTRUCTION	N/A	14-JUL-2025
A		ISSUED FOR SQUAD CHECK AND CLIENT APPROVAL	N/A	07-JUL-2025

REVISIONS

CONFIDENTIAL INFORMATION
THIS DRAWING AND THE IDEAS AND DESIGNS SHOWN THEREON ARE THE EXCLUSIVE PROPERTY OF ELI LILLY AND COMPANY AND ARE NOT TO BE USED, REPRODUCED OR DISCLOSED, EITHER IN WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF ELI LILLY AND COMPANY.

SYSTEM TYPE: NA		EDIFICE/BUILDING: 00	LEVEL/FLOOR: 0
SUB DISCIPLINE: EJ	LOCATION CODE: LP1	LOCATION/GRID: N/A	CO CODE: YELLOW
			PROJECT NAME: LP1-306-1181
CRITICAL QUALITY: NO		ENTERPRISE GROUP:	DRAWING INTENTION:
			DRAWING SCALE: NONE
CRITICAL BUSINESS: NO		EQUIPMENT CLASSIFICATION: NA	ALTERNATE DOCUMENT ID: NA
			MERIDIAN REV: 3
CRITICAL HSE: NO		VENDOR: NA	DOCUMENT ID: LP100-EJ-00000010
NON-CRITICAL: YES		ENGINEERING AGENCY DOC ID: NA	

EFDEE Engineering Rc
PROJECT NO. B1LG
NODE: GEN

REV	DATE	DES	ENG	CHK	APP	PM APP
3	15-JAN-2026	EG	SB	AA	SB	
2	15-DEC-2025	EG	SB	AA	SB	
1	30-OCT-2025	EG	SB	MV	SB	
0	14-JUL-2025	EG	SB	MV	SB	
A	07-JUL-2025	EG	SB	MV	SB	

P:\265\DWG\00-General & Site\LP100-EJ-00000010_R3 WIP.dwg 01-15-26 3:29 pm Printed By: hel5090

IF YOU ARE USING A PRINTED COPY OF THIS DOCUMENT, IT IS AN UNCONTROLLED PRINT. CONFIRM WITH THE OFFICIAL "ELECTRONIC RECORD" DOCUMENT IN THE GLOBAL ENGINEERING CONTENT MANAGEMENT SYSTEM.

IF YOU ARE USING A PRINTED COPY OF THIS DOCUMENT, IT IS AN UNCONTROLLED PRINT. CONFIRM WITH THE OFFICIAL "ELECTRONIC RECORD" DOCUMENT IN THE GLOBAL ENGINEERING CONTENT MANAGEMENT SYSTEM.