
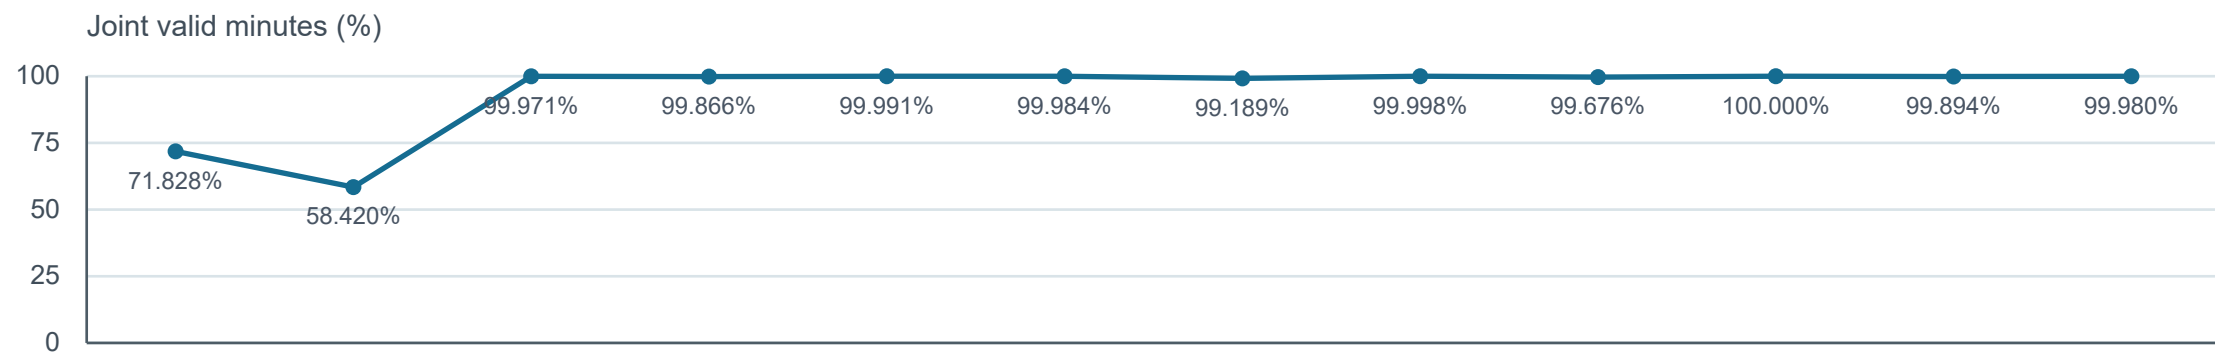


Measured AC records: missing time is not zero load

CU-BEMS / Chamchuri 5 / floor 2 / 2019 / joint observations across 16 AC channels

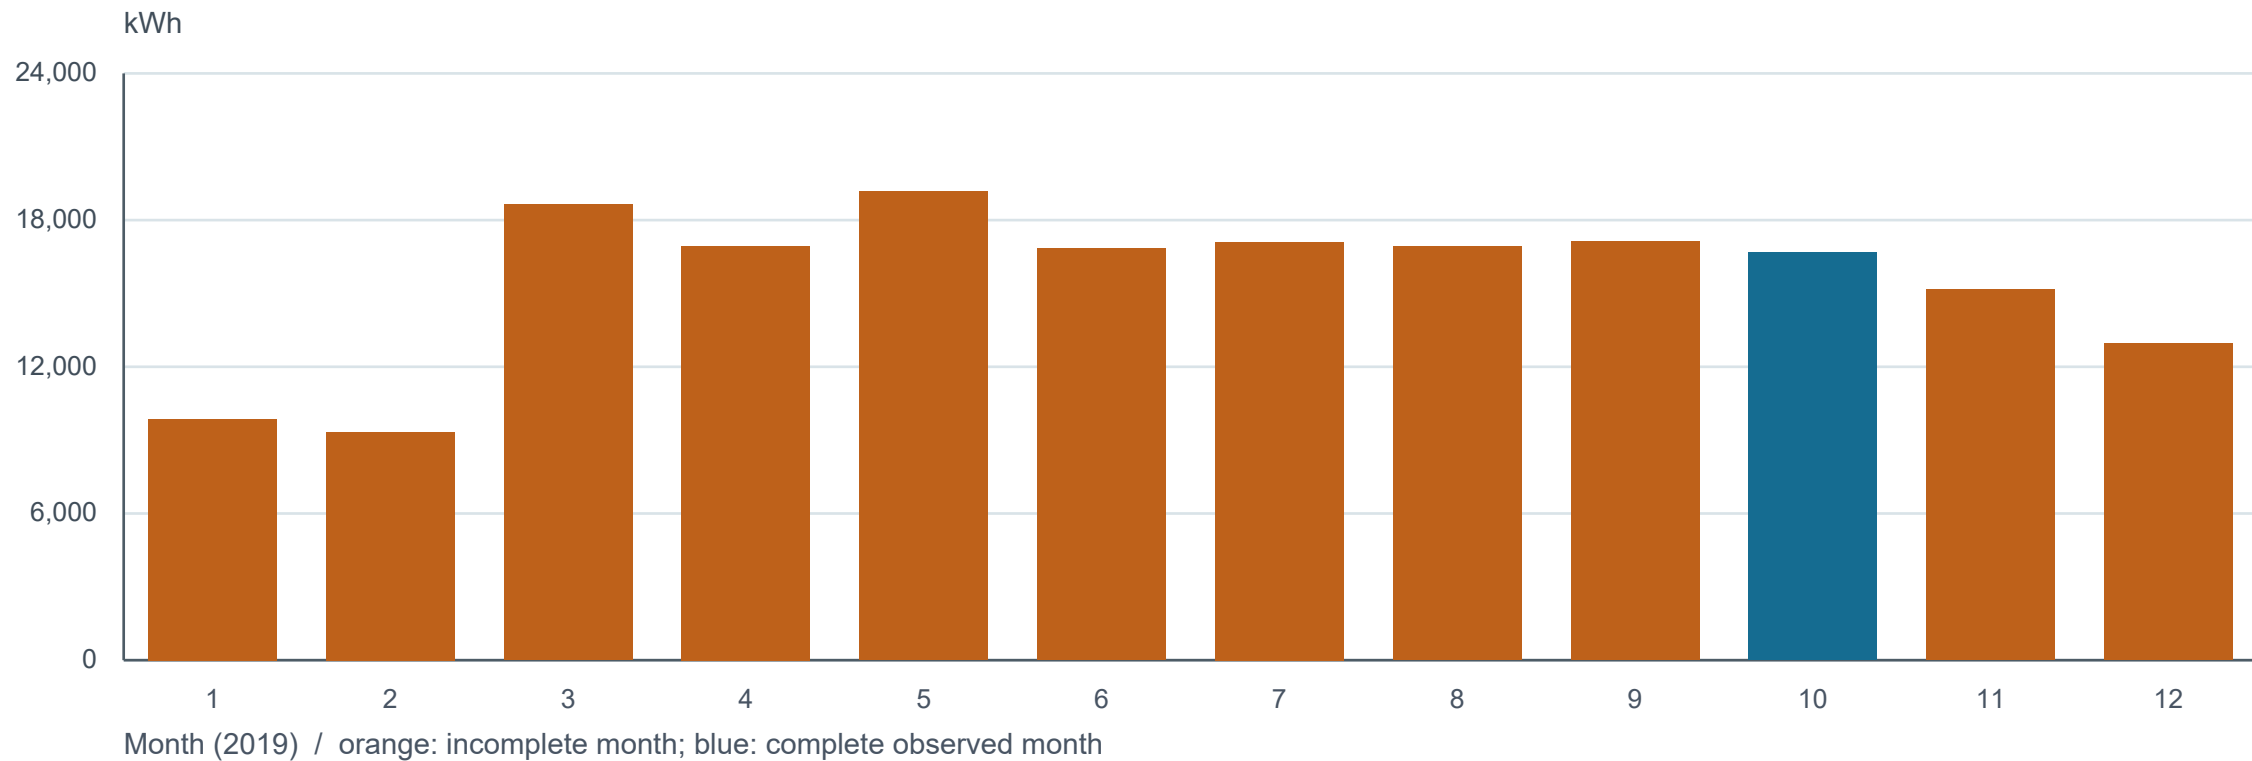

Joint coverage: 94.30% (495,619 / 525,600 minutes).

Only available samples are integrated: kW x 1/60 h. No complete annual energy total is asserted.

A fixed week of actual submeter observations

CU-BEMS / floor 2 / zone 2 AC2 / 1-7 July 2019 / source local-clock interpretation



Fixed chronological selection, without inspecting model error: 168 hourly intervals; 2 incomplete hours.

Only fully observed hours are drawn. Missing hourly values remain empty in the CSV.

This device shares zone 2 with other AC units; its serviced area, capacity, COP and controls are not documented.

No reference catalogue device or arbitrary 35 m2 room is substituted. This is measured evidence, not calibration.

One public building: 12 measured monthly records

Madrid / Casa Consistorial - Casa de la Villa / 2024 / general active-electricity sensor

