
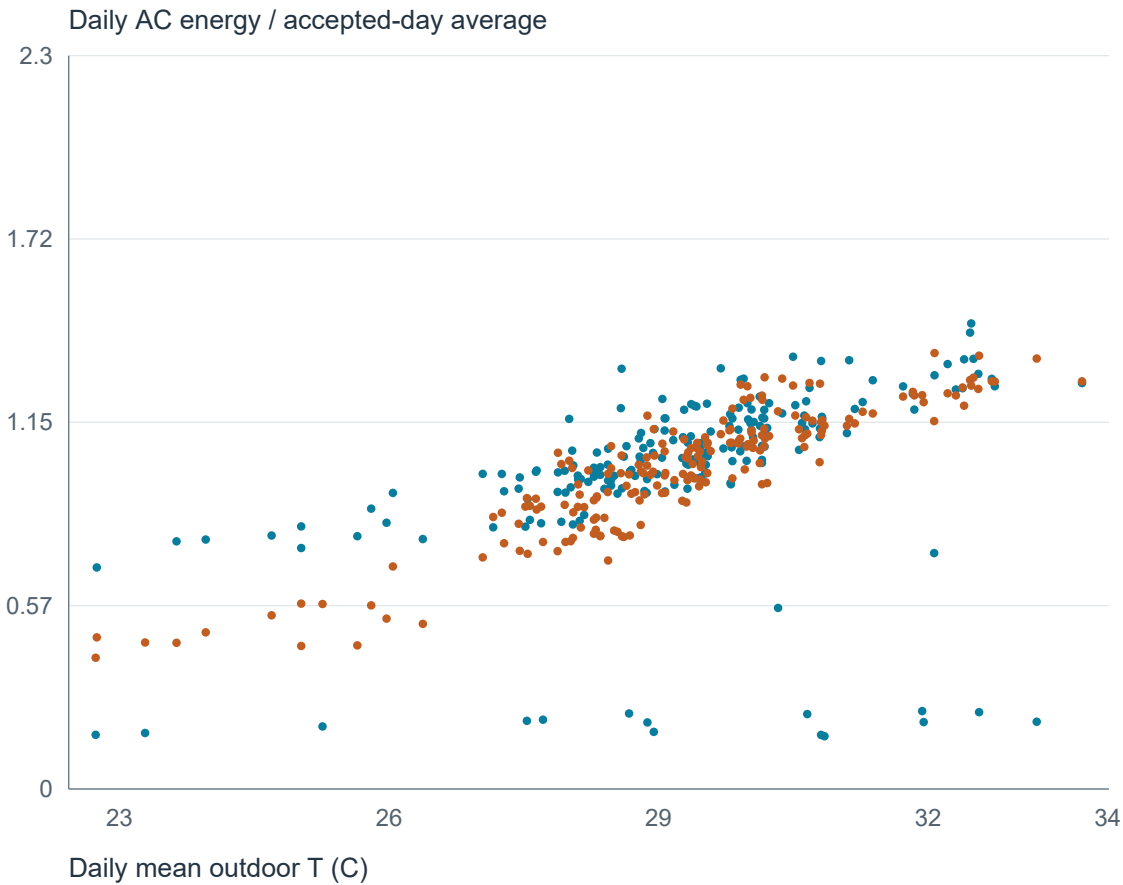


Office floor: timing agrees, temperature response differs

CU-BEMS / floor 2 / 16 AC channels / 198 fully observed weekdays out of 261 / Bangkok 2019 ERA5 city reference

Measured floor AC Default office room model

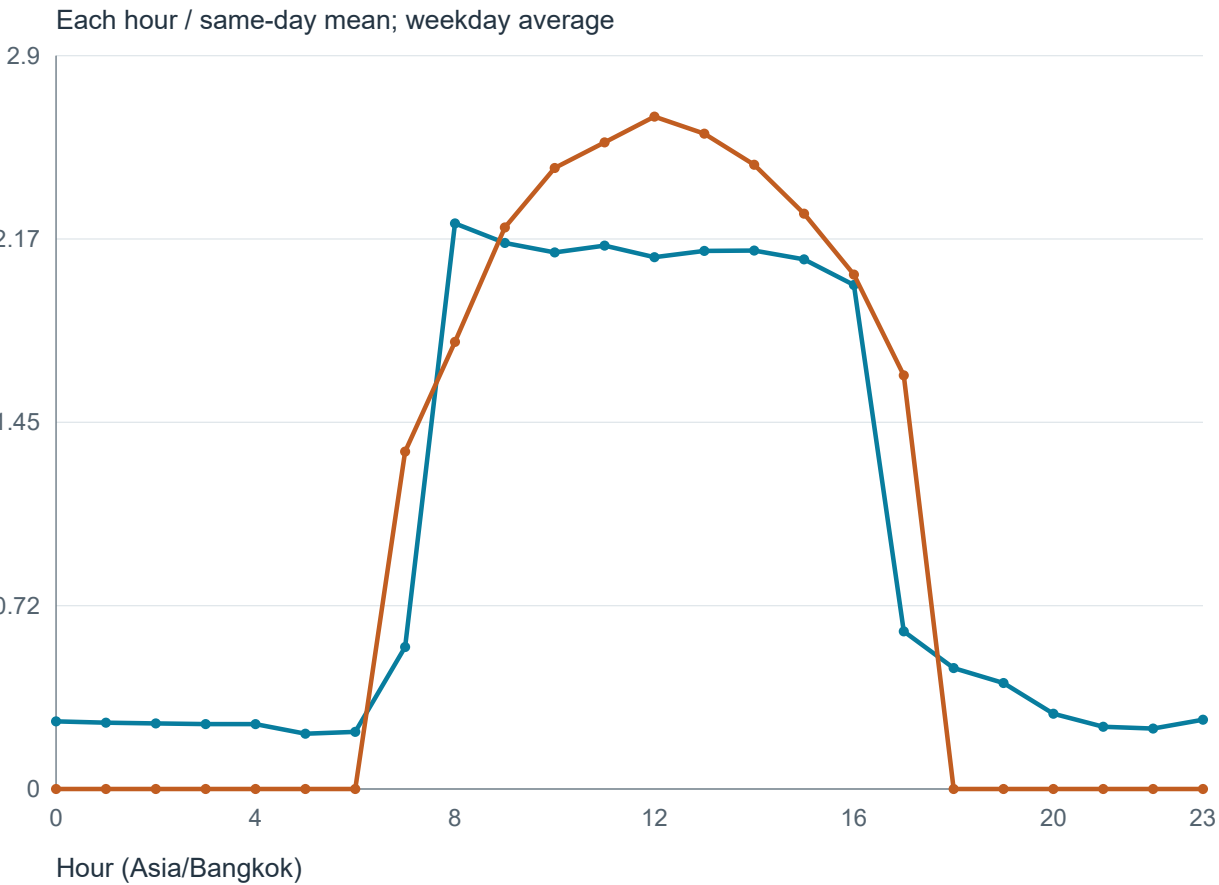

24-point profile correlation: 0.948; normalized RMSE: 0.404

Relative daily slope: measured 5.69%/C; model 9.73%/C

63 incomplete weekdays excluded; missing channels are never zero-filled. Both methods use the same accepted dates.

No zone area, unit capacity or true operating schedule: normalization supports trend comparison only.

OLS associations include occupancy, humidity, solar and season effects. Correlation does not establish causal sensitivity.