


Room-level evidence: substantial untuned mismatch

Hyderabad / 2019-05-10 to 28 IST / first 9 days development, last 10 dates evaluation / three single-AC homes

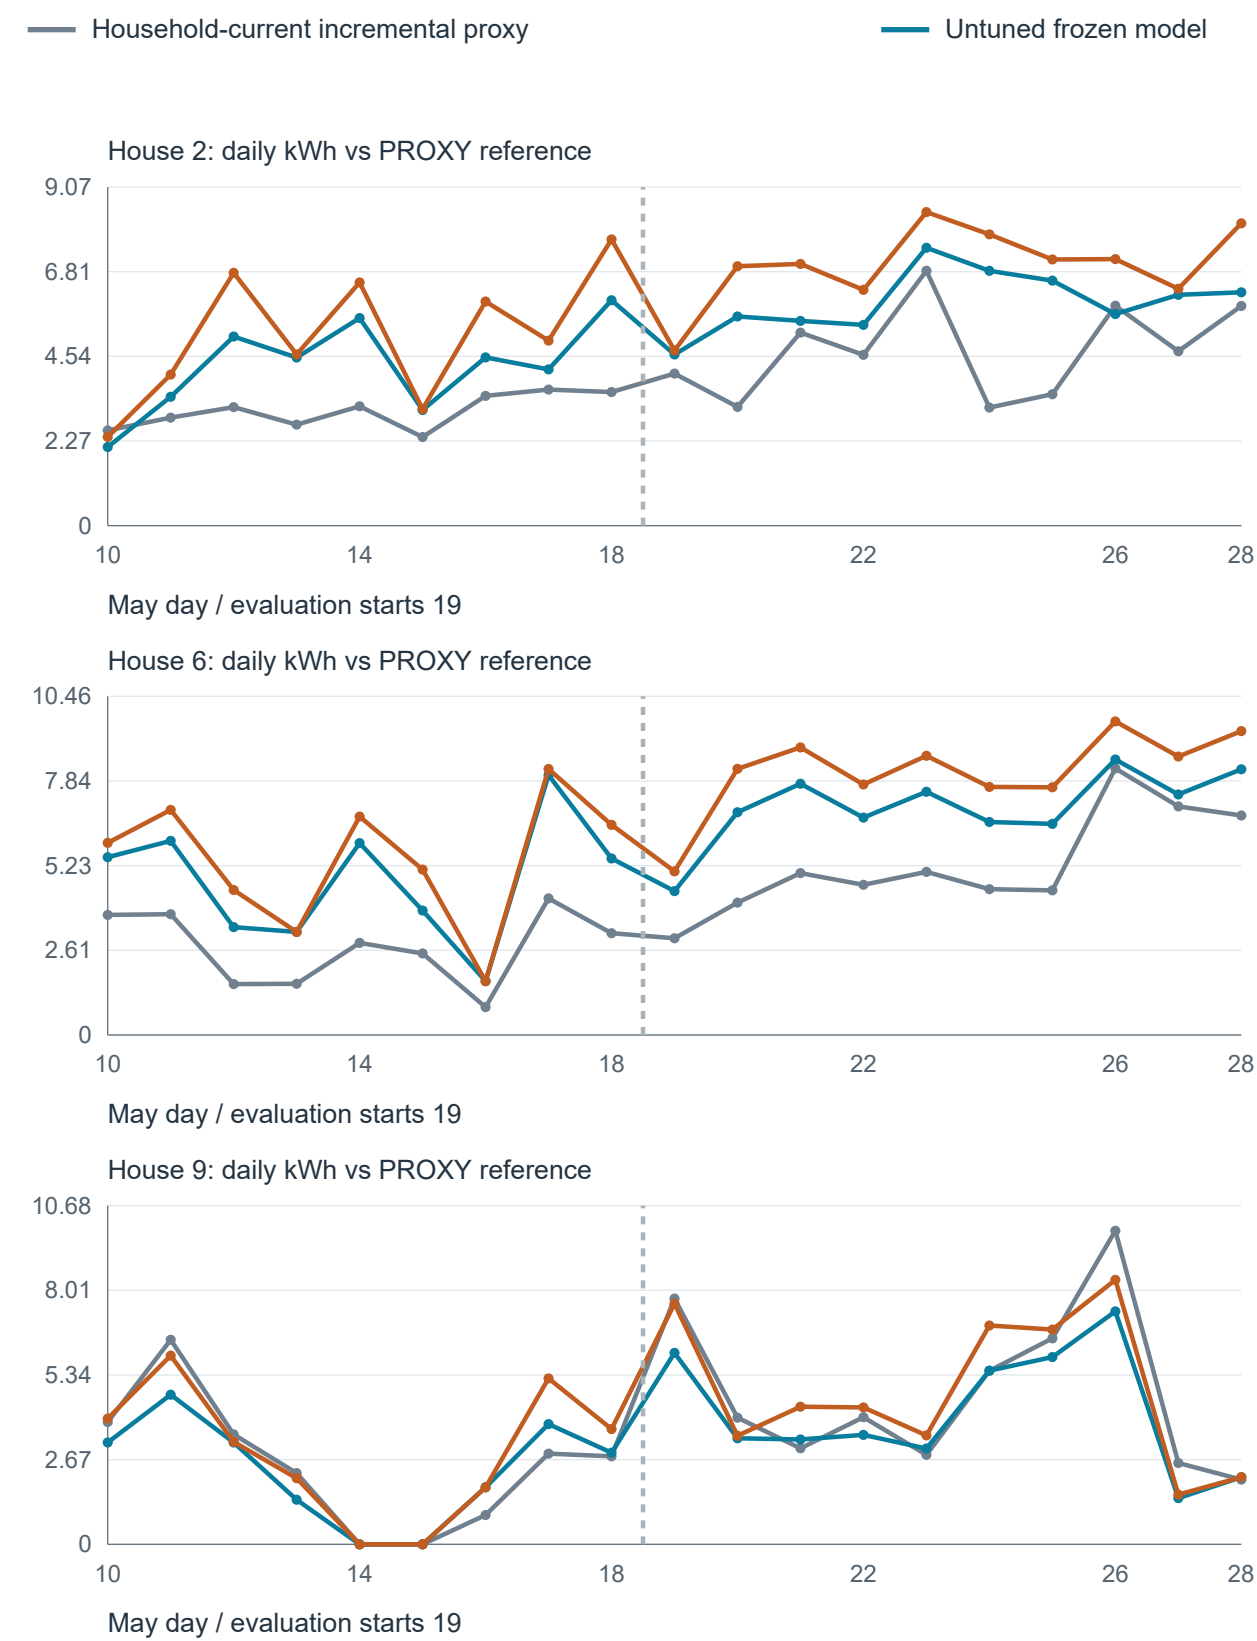

No AC submeter, measured PF/COP or individual room area. Energy proxy uses 230V / PF0.9; +/-10% recorded separately.
Reported homeowner setpoint + labelled ON/OFF; same frozen equations. A lower fitted room-T error is not calibrated AC energy.