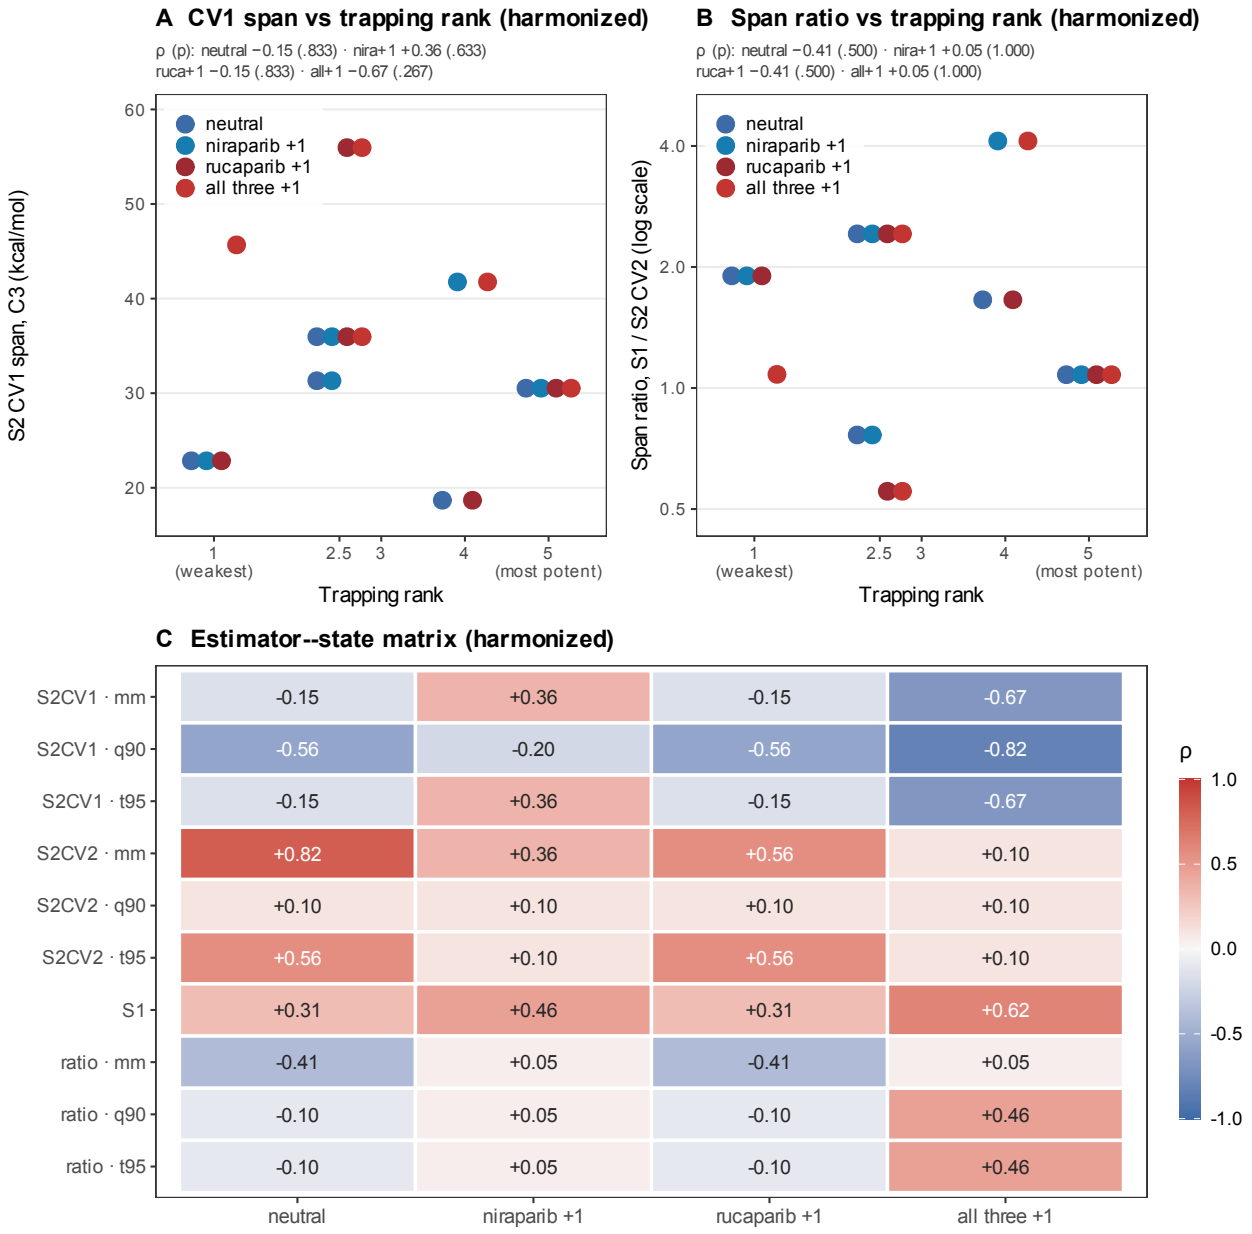
A CV1 span vs trapping rank (harmonized)
ρ (p): neutral −0.15 (.833) · nira+1 +0.36 (.633)
ruca+1 −0.15 (.833) · all+1 −0.67 (.267)
neutral
niraparib +1
rucaparib +1
all three +1
S2 CV1 span, C3 (kcal/mol)
Trapping rank
(weakest)
(most potent)
B Span ratio vs trapping rank (harmonized)
ρ (p): neutral −0.41 (.500) · nira+1 +0.05 (1.000)
ruca+1 −0.41 (.500) · all+1 +0.05 (1.000)
Span ratio, S1 / S2 CV2 (log scale)
C Estimator--state matrix (harmonized)
S2CV1 · mm
S2CV1 · q90
S2CV1 · t95
S2CV2 · mm
S2CV2 · q90
S2CV2 · t95
S1
ratio · mm
ratio · q90
ratio · t95
ρ