Company:		Page:	1
Address:		Specifier:	
Phone I Fax:	|	E-Mail:	
Design:	Concrete - Mar 12, 2024	Date:	3/13/2024
Fastening point:			

Specifier's comments:

1 Input data

Anchor type and diameter:	**Kwik Bolt TZ2 - CS 1 (4) hnom1**
Item number:	2210300 KB-TZ2 1x6 1/2
Effective embedment depth:	$h_{ef,act}$ = 4.000 in., h_{nom} = 4.625 in.
Material:	Carbon Steel
Evaluation Service Report:	ESR-4266
Issued I Valid:	12/17/2021 | 12/1/2023
Proof:	Design Method ACI 318-19 / Mech
Stand-off installation:	e_b = 0.000 in. (no stand-off); t = 0.500 in.
Anchor plate^R :	l_x x l_y x t = 16.000 in. x 16.000 in. x 0.500 in.; (Recommended plate thickness: not calculated)
Profile:	no profile
Base material:	cracked concrete, 4000, f_c' = 4,000 psi; h = 8.000 in.
Installation:	**hammer drilled hole, Installation condition: Dry**
Reinforcement:	tension: not present, shear: not present; no supplemental splitting reinforcement present
	edge reinforcement: none or < No. 4 bar
Seismic loads (cat. C, D, E, or F)	Tension load: yes (17.10.5.3 (d))
	Shear load: yes (17.10.6.3 (a))

^{R} - The anchor calculation is based on a rigid anchor plate assumption.

Geometry [in.] & Loading [lb, in.lb]

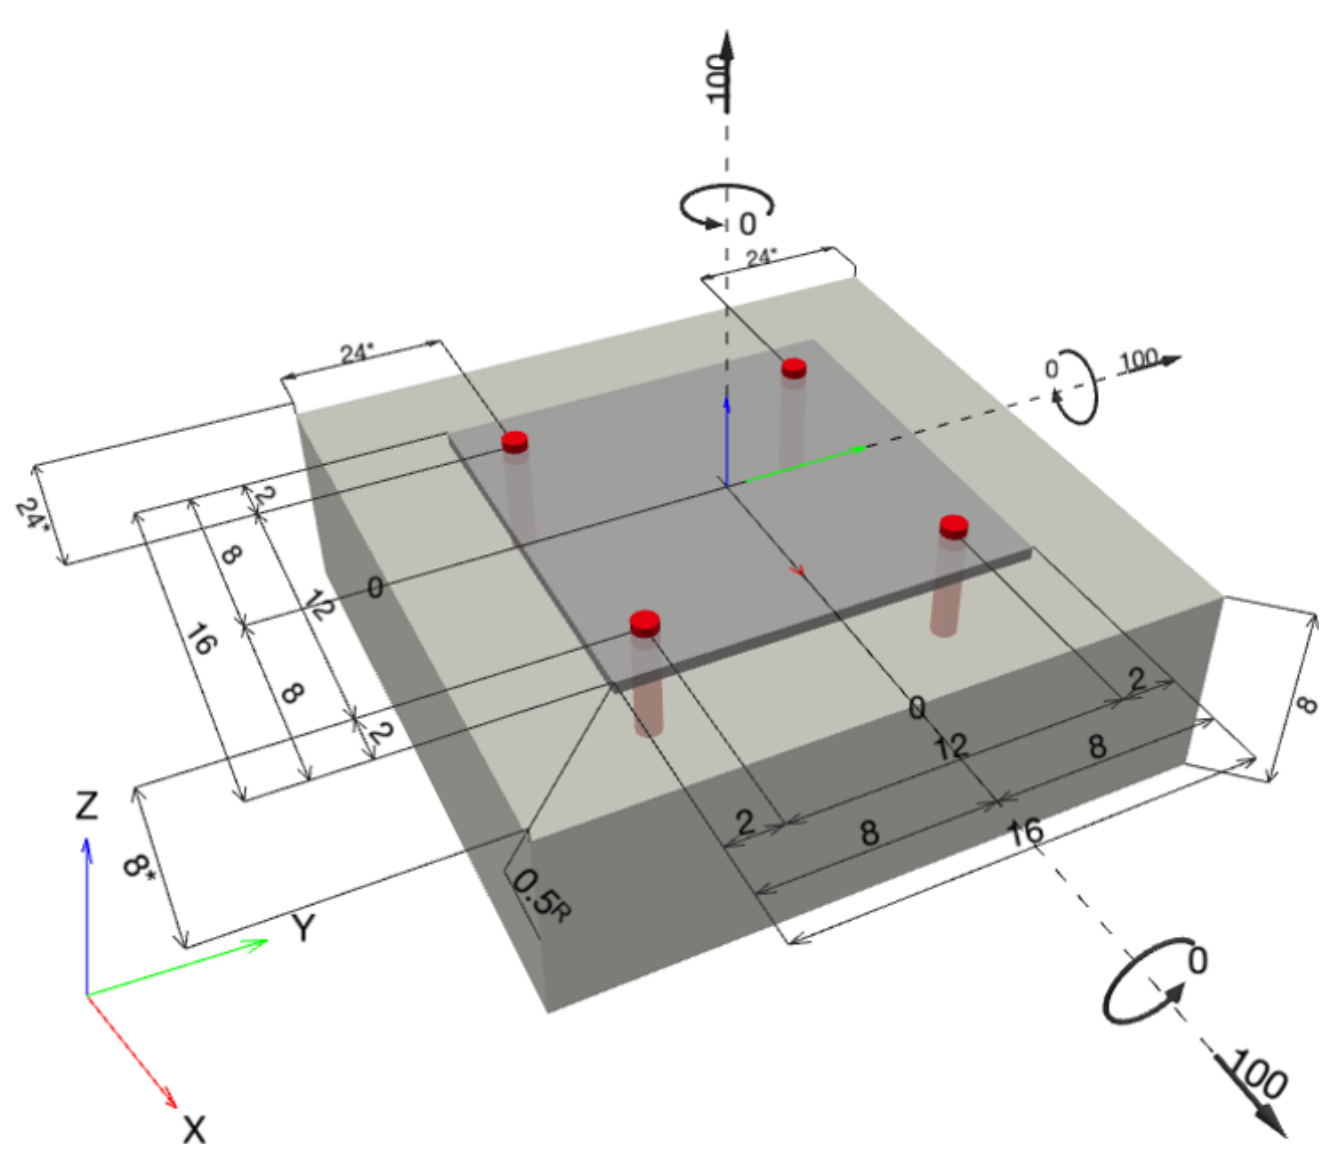

Company:		Page:	2
Address:		Specifier:	
Phone I Fax:	|	E-Mail:	
Design:	Concrete - Mar 12, 2024	Date:	3/13/2024
Fastening point:			

1.1 Design results

Case	Description	Forces [lb] / Moments [in.lb]	Seismic	Max. Util. Anchor [%]
1	Combination 1	$N = 100; V_x = 100; V_y = 100;$ $M_x = 0; M_y = 0; M_z = 0;$	yes	2

2 Load case/Resulting anchor forces

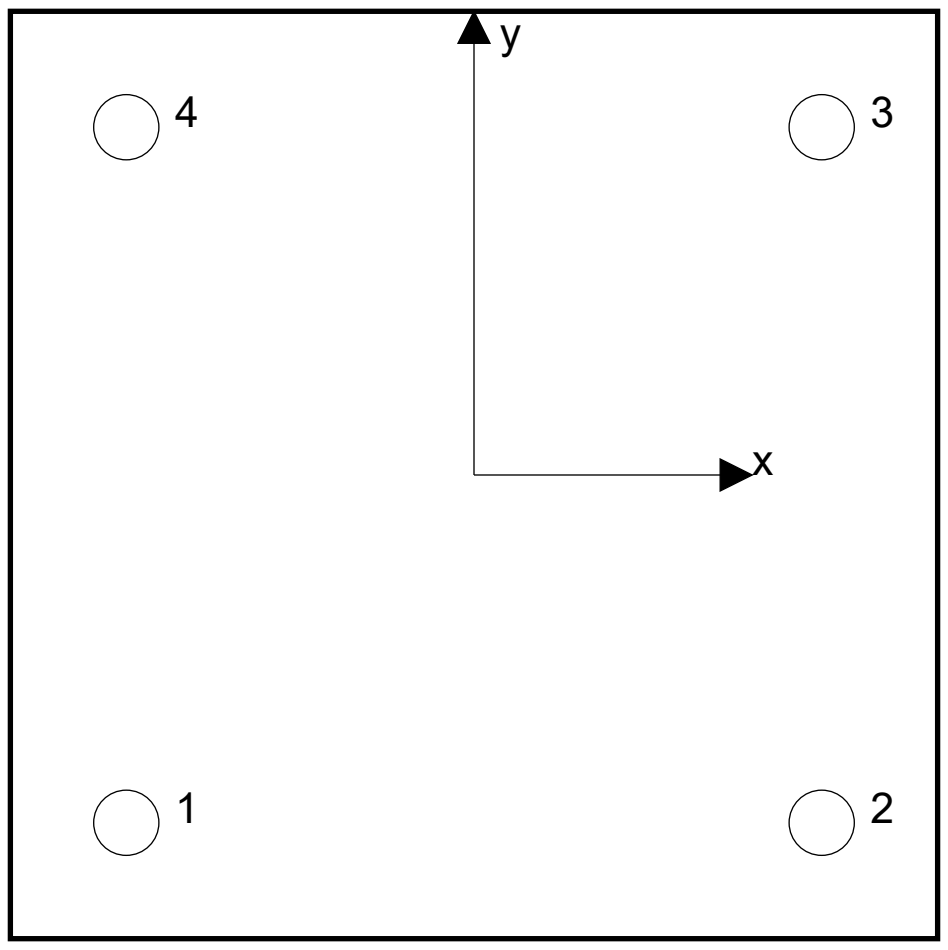

Anchor reactions [lb]
Tension force: (+Tension, -Compression)

Anchor	Tension force	Shear force	Shear force x	Shear force y
1	25	35	25	25
2	25	35	25	25
3	25	35	25	25
4	25	35	25	25

max. concrete compressive strain: - [‰]
max. concrete compressive stress: - [psi]
resulting tension force in (x/y)=(0.000/0.000): 0 [lb]
resulting compression force in (x/y)=(0.000/0.000): 0 [lb]

Anchor forces are calculated based on the assumption of a rigid anchor plate.

3 Tension load

	Load N_{ua} [lb]	Capacity ϕ N_n [lb]	Utilization $\beta_N = N_{ua}/\phi$ N_n	Status
Steel Strength*	25	31,036	1	OK
Pullout Strength*	N/A	N/A	N/A	N/A
Concrete Breakout Failure**	100	20,719	1	OK

* highest loaded anchor **anchor group (anchors in tension)

3.1 Steel Strength

N_{sa} = ESR value refer to ICC-ES ESR-4266

$\phi\ N_{sa} \geq N_{ua}$ ACI 318-19 Table 17.5.2

Variables

$A_{se,N}$ [in.^{2}]	f_{uta} [psi]
0.47	88,000

Calculations

N_{sa} [lb]
41,382

Results

N_{sa} [lb]	ϕ_{steel}	$\phi_{nonductile}$	$\phi\ N_{sa}$ [lb]	N_{ua} [lb]
41,382	0.750	1.000	31,036	25

Company:		Page:	4
Address:		Specifier:	
Phone I Fax:	|	E-Mail:	
Design:	Concrete - Mar 12, 2024	Date:	3/13/2024
Fastening point:			

3.2 Concrete Breakout Failure

$N_{cbg} = \left(\frac{A_{Nc}}{A_{Nc0}}\right) \psi_{ec,N}\ \psi_{ed,N}\ \psi_{c,N}\ \psi_{cp,N}\ N_b$ ACI 318-19 Eq. (17.6.2.1b)

$\phi\ N_{cbg} \geq N_{ua}$ ACI 318-19 Table 17.5.2

A_{Nc} see ACI 318-19, Section 17.6.2.1, Fig. R 17.6.2.1(b)

$A_{Nc0} = 9\ h_{ef}^2$ ACI 318-19 Eq. (17.6.2.1.4)

$\psi_{ec,N} = \left(\frac{1}{1 + \frac{2\ e_N'}{3\ h_{ef}}}\right) \leq 1.0$ ACI 318-19 Eq. (17.6.2.3.1)

$\psi_{ed,N} = 0.7 + 0.3 \left(\frac{c_{a,min}}{1.5h_{ef}}\right) \leq 1.0$ ACI 318-19 Eq. (17.6.2.4.1b)

$\psi_{cp,N} = \mathrm{MAX}\left(\frac{c_{a,min}}{c_{ac}}, \frac{1.5h_{ef}}{c_{ac}}\right) \leq 1.0$ ACI 318-19 Eq. (17.6.2.6.1b)

$N_b = k_c\ \lambda_a\ \sqrt{f_c'}\ h_{ef}^{1.5}$ ACI 318-19 Eq. (17.6.2.2.1)

Variables

h_{ef} [in.]	$e_{c1,N}$ [in.]	$e_{c2,N}$ [in.]	$c_{a,min}$ [in.]	$\psi_{c,N}$
4.000	0.000	0.000	8.000	1.000

c_{ac} [in.]	k_c	λ_a	f_c' [psi]
11.000	21	1.000	4,000

Calculations

A_{Nc} [in.^{2}]	A_{Nc0} [in.^{2}]	$\psi_{ec1,N}$	$\psi_{ec2,N}$	$\psi_{ed,N}$	$\psi_{cp,N}$	N_b [lb]
576.00	144.00	1.000	1.000	1.000	1.000	10,625

Results

N_{cbg} [lb]	$\phi_{concrete}$	$\phi_{seismic}$	$\phi_{nonductile}$	$\phi\ N_{cbg}$ [lb]	N_{ua} [lb]
42,501	0.650	0.750	1.000	20,719	100

4 Shear load

	Load V_{ua} [lb]	Capacity ϕ V_n [lb]	Utilization $\beta_V = V_{ua}/\phi$ V_n	Status
Steel Strength*	35	8,977	1	OK
Steel failure (with lever arm)*	N/A	N/A	N/A	N/A
Pryout Strength**	141	59,501	1	OK
Concrete edge failure in direction y+**	141	10,797	2	OK

* highest loaded anchor   **anchor group (relevant anchors)

4.1 Steel Strength

$V_{sa,eq}$ = ESR value	refer to ICC-ES ESR-4266
ϕ $V_{steel} \geq V_{ua}$	ACI 318-19 Table 17.5.2

Variables

$A_{se,V}$ [in.^{2}]	f_{uta} [psi]	$\alpha_{V,seis}$
0.47	88,000	0.735

Calculations

$V_{sa,eq}$ [lb]
13,811

Results

$V_{sa,eq}$ [lb]	ϕ steel	$\phi_{nonductile}$	ϕ $V_{sa,eq}$ [lb]	V_{ua} [lb]
13,811	0.650	1.000	8,977	35

4.2 Pryout Strength

$V_{cpg} = k_{cp} \left[\left(\frac{A_{Nc}}{A_{Nc0}} \right) \psi_{ec,N}\ \psi_{ed,N}\ \psi_{c,N}\ \psi_{cp,N}\ N_b \right]$ ACI 318-19 Eq. (17.7.3.1b)

$\phi\ V_{cpg} \geq V_{ua}$ ACI 318-19 Table 17.5.2

A_{Nc} see ACI 318-19, Section 17.6.2.1, Fig. R 17.6.2.1(b)

$A_{Nc0} = 9\ h_{ef}^2$ ACI 318-19 Eq. (17.6.2.1.4)

$\psi_{ec,N} = \left(\frac{1}{1 + \frac{2\ e_N'}{3\ h_{ef}}} \right) \leq 1.0$ ACI 318-19 Eq. (17.6.2.3.1)

$\psi_{ed,N} = 0.7 + 0.3 \left(\frac{c_{a,min}}{1.5 h_{ef}} \right) \leq 1.0$ ACI 318-19 Eq. (17.6.2.4.1b)

$\psi_{cp,N} = \text{MAX}\left(\frac{c_{a,min}}{c_{ac}}, \frac{1.5 h_{ef}}{c_{ac}} \right) \leq 1.0$ ACI 318-19 Eq. (17.6.2.6.1b)

$N_b = k_c\ \lambda_a\ \sqrt{f_c'}\ h_{ef}^{1.5}$ ACI 318-19 Eq. (17.6.2.2.1)

Variables

k_{cp}	h_{ef} [in.]	$e_{c1,N}$ [in.]	$e_{c2,N}$ [in.]	$c_{a,min}$ [in.]
2	4.000	0.000	0.000	8.000

$\psi_{c,N}$	c_{ac} [in.]	k_c	λ_a	f_c' [psi]
1.000	11.000	21	1.000	4,000

Calculations

A_{Nc} [in.^{2}]	A_{Nc0} [in.^{2}]	$\psi_{ec1,N}$	$\psi_{ec2,N}$	$\psi_{ed,N}$	$\psi_{cp,N}$	N_b [lb]
576.00	144.00	1.000	1.000	1.000	1.000	10,625

Results

V_{cpg} [lb]	$\phi_{concrete}$	$\phi_{seismic}$	$\phi_{nonductile}$	$\phi\ V_{cpg}$ [lb]	V_{ua} [lb]
85,002	0.700	1.000	1.000	59,501	141

4.3 Concrete edge failure in direction y+

$V_{cbg} = \left(\frac{A_{Vc}}{A_{Vc0}}\right) \psi_{ec,V}\ \psi_{ed,V}\ \psi_{c,V}\ \psi_{h,V}\ \psi_{parallel,V}\ V_b$ ACI 318-19 Eq. (17.7.2.1b)

$\phi\ V_{cbg} \geq V_{ua}$ ACI 318-19 Table 17.5.2

A_{Vc} see ACI 318-19, Section 17.7.2.1, Fig. R 17.7.2.1(b)

$A_{Vc0} = 4.5\ c_{a1}^2$ ACI 318-19 Eq. (17.7.2.1.3)

$\psi_{ec,V} = \left(\frac{1}{1 + \frac{e_V'}{1.5c_{a1}}}\right) \leq 1.0$ ACI 318-19 Eq. (17.7.2.3.1)

$\psi_{ed,V} = 0.7 + 0.3\left(\frac{c_{a2}}{1.5c_{a1}}\right) \leq 1.0$ ACI 318-19 Eq. (17.7.2.4.1b)

$\psi_{h,V} = \sqrt{\frac{1.5c_{a1}}{h_a}} \geq 1.0$ ACI 318-19 Eq. (17.7.2.6.1)

$V_b = 9\ \lambda_a\ \sqrt{f_c'}\ c_{a1}^{1.5}$ ACI 318-19 Eq. (17.7.2.2.1b)

Variables

c_{a1} [in.]	c_{a2} [in.]	e_{cV} [in.]	$\psi_{c,V}$	h_a [in.]
16.000	8.000	0.000	1.000	8.000

l_e [in.]	λ_a	d_a [in.]	f_c [psi]	$\psi_{parallel,V}$
4.000	1.000	1.000	4,000	1.000

Calculations

A_{Vc} [in.^{2}]	A_{Vc0} [in.^{2}]	$\psi_{ec,V}$	$\psi_{ed,V}$	$\psi_{h,V}$	V_b [lb]
352.00	1,152.00	1.000	0.800	1.732	36,429

Results

V_{cbg} [lb]	$\phi_{concrete}$	$\phi_{seismic}$	$\phi_{nonductile}$	$\phi\ V_{cbg}$ [lb]	V_{ua} [lb]
15,424	0.700	1.000	1.000	10,797	141

5 Combined tension and shear loads, per ACI 318-19 section 17.8

β_N	β_V	ζ	Utilization $\beta_{N,V}$ [%]	Status
0.005	0.013	5/3	1	OK

$\beta_{NV} = \beta_N^{\zeta} + \beta_V^{\zeta} <= 1$

Company:		Page:	8
Address:		Specifier:	
Phone I Fax:	|	E-Mail:	
Design:	Concrete - Mar 12, 2024	Date:	3/13/2024
Fastening point:			

6 Warnings

- The anchor design methods in PROFIS Engineering require rigid anchor plates per current regulations (AS 5216:2021, ETAG 001/Annex C, EOTA TR029 etc.). This means load re-distribution on the anchors due to elastic deformations of the anchor plate are not considered - the anchor plate is assumed to be sufficiently stiff, in order not to be deformed when subjected to the design loading. PROFIS Engineering calculates the minimum required anchor plate thickness with CBFEM to limit the stress of the anchor plate based on the assumptions explained above. The proof if the rigid anchor plate assumption is valid is not carried out by PROFIS Engineering. Input data and results must be checked for agreement with the existing conditions and for plausibility!
- Condition A applies where the potential concrete failure surfaces are crossed by supplementary reinforcement proportioned to tie the potential concrete failure prism into the structural member. Condition B applies where such supplementary reinforcement is not provided, or where pullout or pryout strength governs.
- Refer to the manufacturer's product literature for cleaning and installation instructions.
- For additional information about ACI 318 strength design provisions, please go to https://submittals.us.hilti.com/PROFISAnchorDesignGuide/
- "An anchor design approach for structures assigned to Seismic Design Category C, D, E or F is given in ACI 318-19, Chapter 17, Section 17.10.5.3 (a) that requires the governing design strength of an anchor or group of anchors be limited by ductile steel failure. If this is NOT the case, the connection design (tension) shall satisfy the provisions of Section 17.10.5.3 (b), Section 17.10.5.3 (c), or Section 17.10.5.3 (d). The connection design (shear) shall satisfy the provisions of Section 17.10.6.3 (a), Section 17.10.6.3 (b), or Section 17.10.6.3 (c)."
- Section 17.10.5.3 (b) / Section 17.10.6.3 (a) require the attachment the anchors are connecting to the structure be designed to undergo ductile yielding at a load level corresponding to anchor forces no greater than the controlling design strength. Section 17.10.5.3 (c) / Section 17.10.6.3 (b) waive the ductility requirements and require the anchors to be designed for the maximum tension / shear that can be transmitted to the anchors by a non-yielding attachment. Section 17.10.5.3 (d) / Section 17.10.6.3 (c) waive the ductility requirements and require the design strength of the anchors to equal or exceed the maximum tension / shear obtained from design load combinations that include E, with E increased by ω_0.
- Hilti post-installed anchors shall be installed in accordance with the Hilti Manufacturer's Printed Installation Instructions (MPII). Reference ACI 318-19, Section 26.7.

Fastening meets the design criteria!

Company:		Page:	9
Address:		Specifier:	
Phone I Fax:	|	E-Mail:	
Design:	Concrete - Mar 12, 2024	Date:	3/13/2024
Fastening point:			

7 Installation data

Anchor type and diameter: Kwik Bolt TZ2 - CS 1 (4) hnom1

Profile: no profile

Item number: 2210300 KB-TZ2 1x6 1/2

Hole diameter in the fixture: d_f = 1.125 in.

Maximum installation torque: 2,227 in.lb

Plate thickness (input): 0.500 in.

Hole diameter in the base material: 1.000 in.

Recommended plate thickness: not calculated

Hole depth in the base material: 5.000 in.

Drilling method: Hammer drilled

Minimum thickness of the base material: 8.000 in.

Cleaning: Manual cleaning of the drilled hole according to instructions for use is required.

Hilti KB-TZ2 stud anchor with 4.625 in embedment, 1 (4) hnom1, Carbon steel, installation per ESR-4266

7.1 Recommended accessories

Drilling	Cleaning	Setting
• Suitable Rotary Hammer • Properly sized drill bit	• Manual blow-out pump	• Torque wrench • Hammer

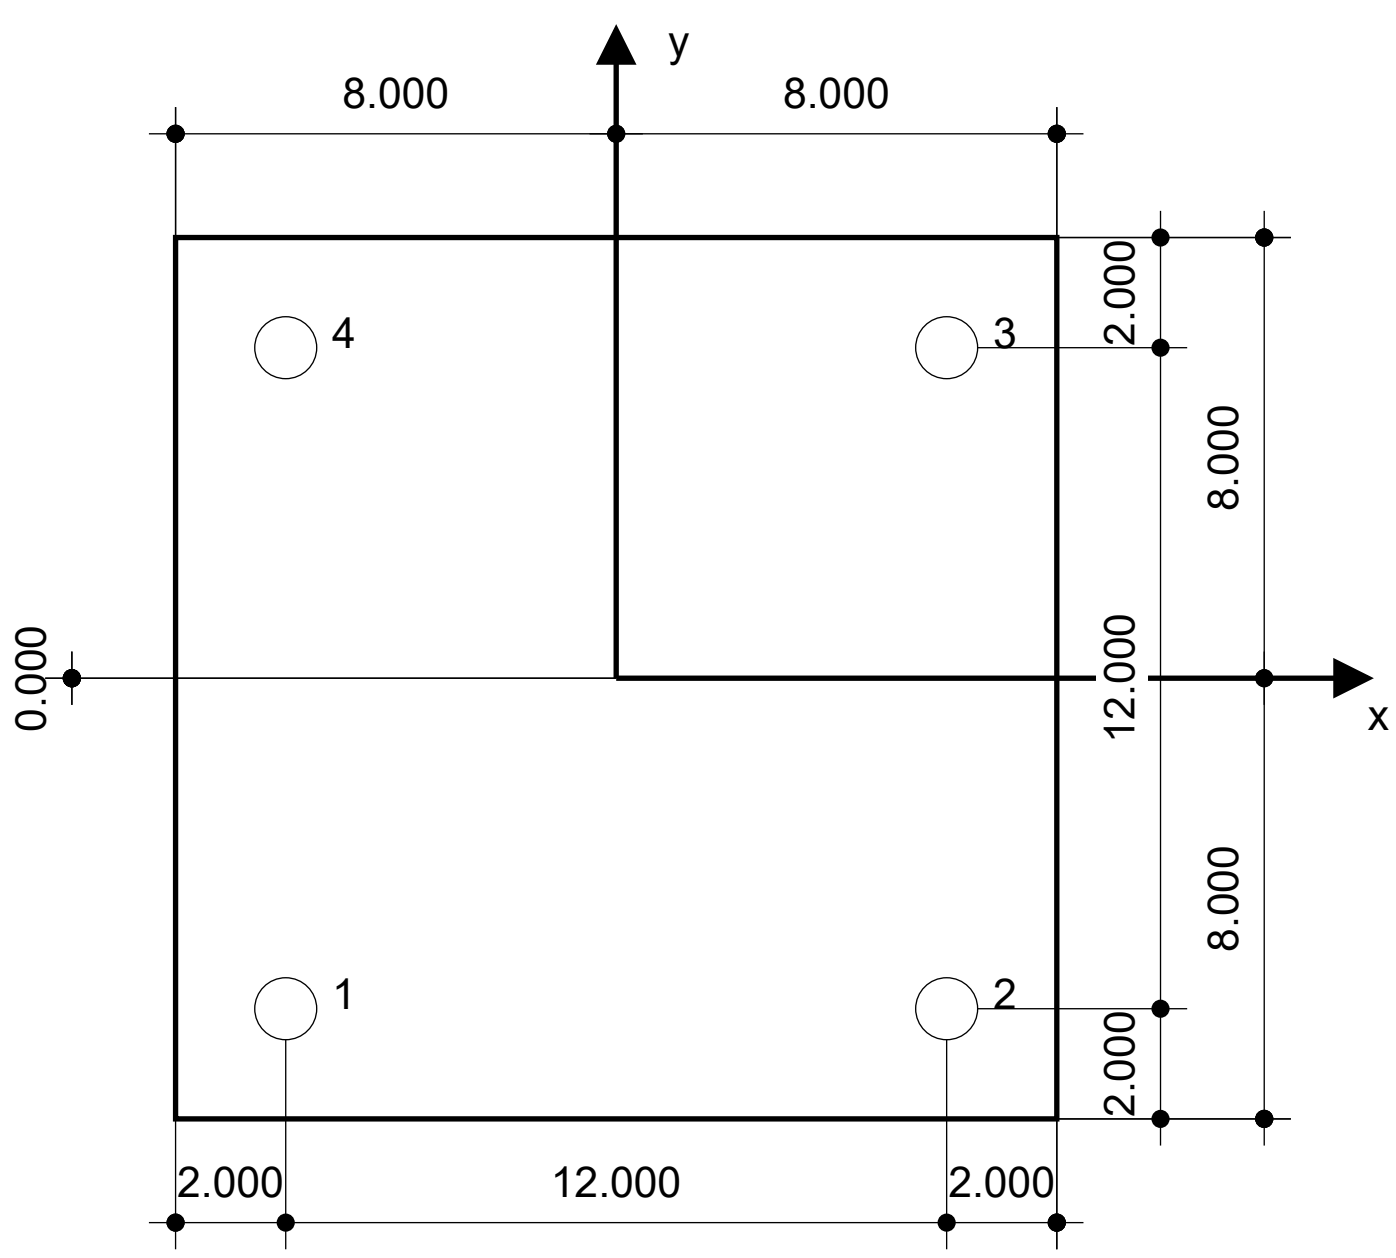

Coordinates Anchor [in.]

Anchor	x	y	c_{-x}	c_{+x}	c_{-y}	c_{+y}
1	-6.000	-6.000	24.000	20.000	24.000	36.000
2	6.000	-6.000	36.000	8.000	24.000	36.000
3	6.000	6.000	36.000	8.000	36.000	24.000
4	-6.000	6.000	24.000	20.000	36.000	24.000

8 Remarks; Your Cooperation Duties

- Any and all information and data contained in the Software concern solely the use of Hilti products and are based on the principles, formulas and security regulations in accordance with Hilti's technical directions and operating, mounting and assembly instructions, etc., that must be strictly complied with by the user. All figures contained therein are average figures, and therefore use-specific tests are to be conducted prior to using the relevant Hilti product. The results of the calculations carried out by means of the Software are based essentially on the data you put in. Therefore, you bear the sole responsibility for the absence of errors, the completeness and the relevance of the data to be put in by you. Moreover, you bear sole responsibility for having the results of the calculation checked and cleared by an expert, particularly with regard to compliance with applicable norms and permits, prior to using them for your specific facility. The Software serves only as an aid to interpret norms and permits without any guarantee as to the absence of errors, the correctness and the relevance of the results or suitability for a specific application.
- You must take all necessary and reasonable steps to prevent or limit damage caused by the Software. In particular, you must arrange for the regular backup of programs and data and, if applicable, carry out the updates of the Software offered by Hilti on a regular basis. If you do not use the AutoUpdate function of the Software, you must ensure that you are using the current and thus up-to-date version of the Software in each case by carrying out manual updates via the Hilti Website. Hilti will not be liable for consequences, such as the recovery of lost or damaged data or programs, arising from a culpable breach of duty by you.