


Test Procedure Reference	Calibration	Job No.	Calibration
Unique No.	Calibration	Test Description	Calibration
R&D Reference	Calibration	Test Date	07/10/2025
Valve Description	Calibration	Valve Drawing No.	Calibration



Calibration Ambient Temperature

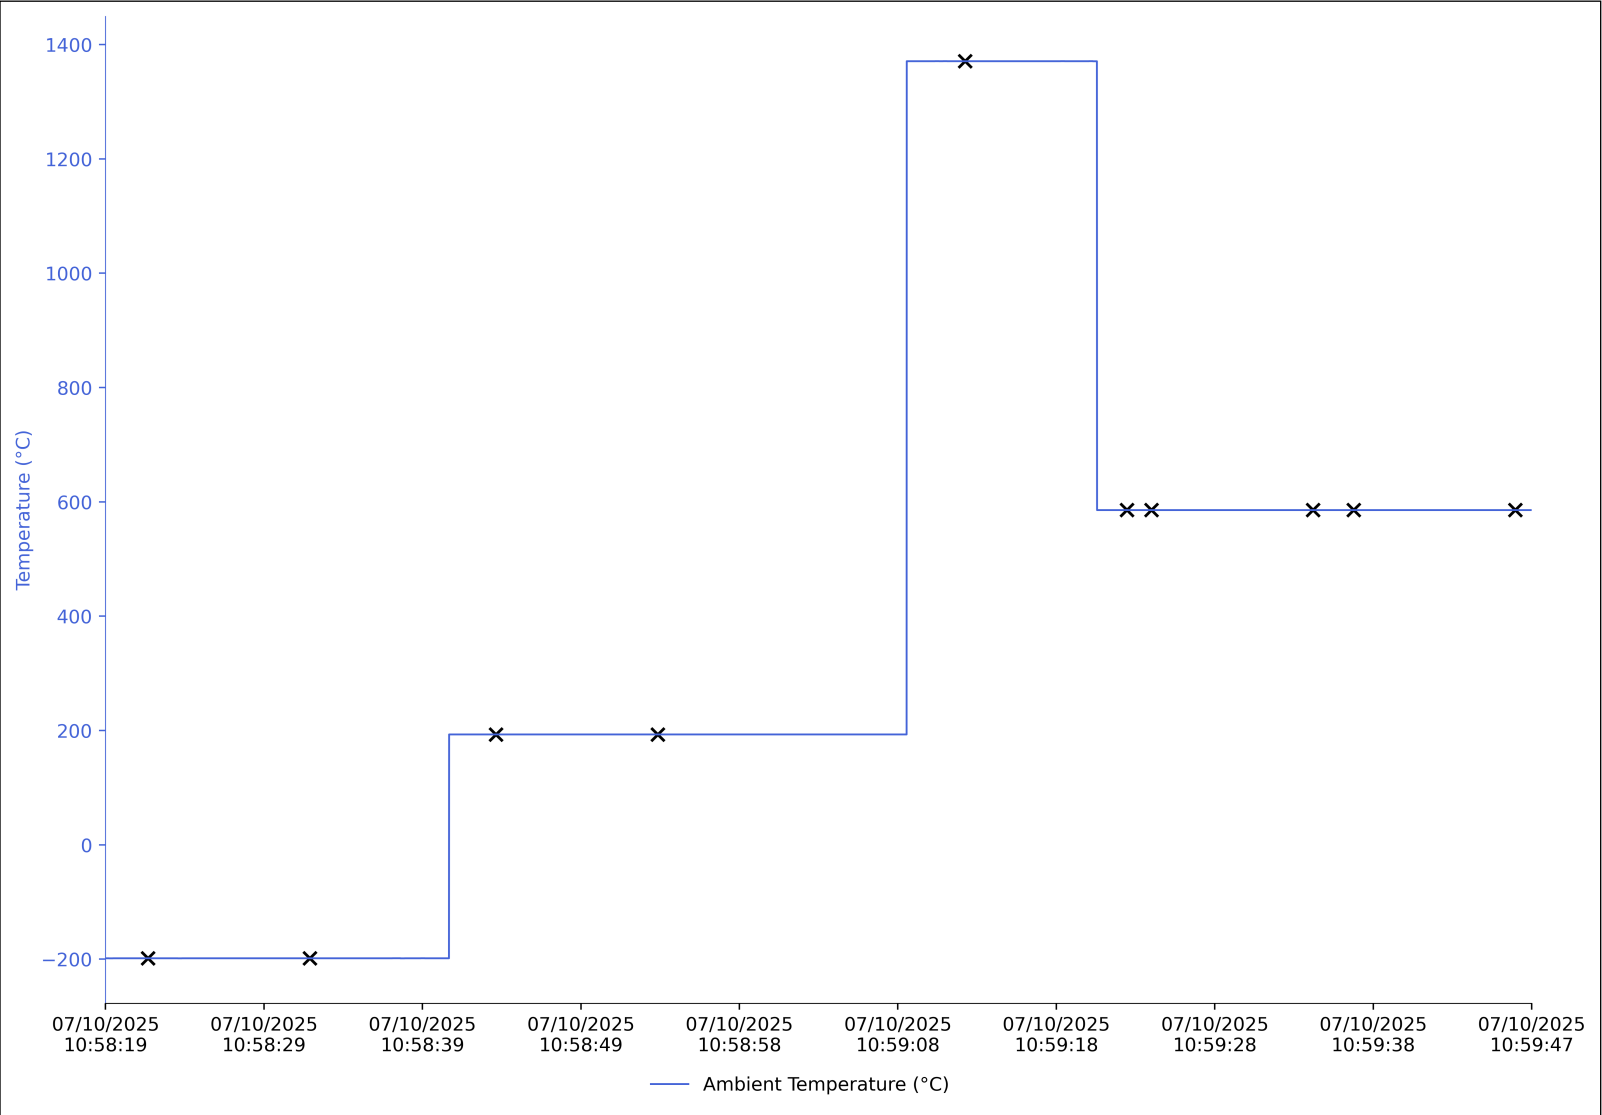

0	-5.89	9.28	24.46	39.64	54.81
1	-199	193.0	1225.0	586.0	586.0
2	-13.565	1.576	41.471	16.751	16.751
3	7.67	7.7	17.01	22.89	38.06

Data Recording Equipment Used

Data Logger      [FAT Rig 2](#)  
Serial No.         [54fef25d6e66c54c](#)  
Transducers

Gauges

Torque Transducer [N/A](#)

Cycle Count        [1](#)

Test Pressure       [0 psi](#)

Breakout Torque    [N/A](#)

Running Torque     [N/A](#)

3rd Party Stamp and Date

Operative: [Jason Bradley](#)