


Test Procedure Reference	Calibration	Job No.	Calibration
Unique No.	Calibration	Test Description	Calibration
R&D Reference	Calibration	Test Date	30/09/2025
Valve Description	Calibration	Valve Drawing No.	Calibration



Calibration Mass Spectrometer

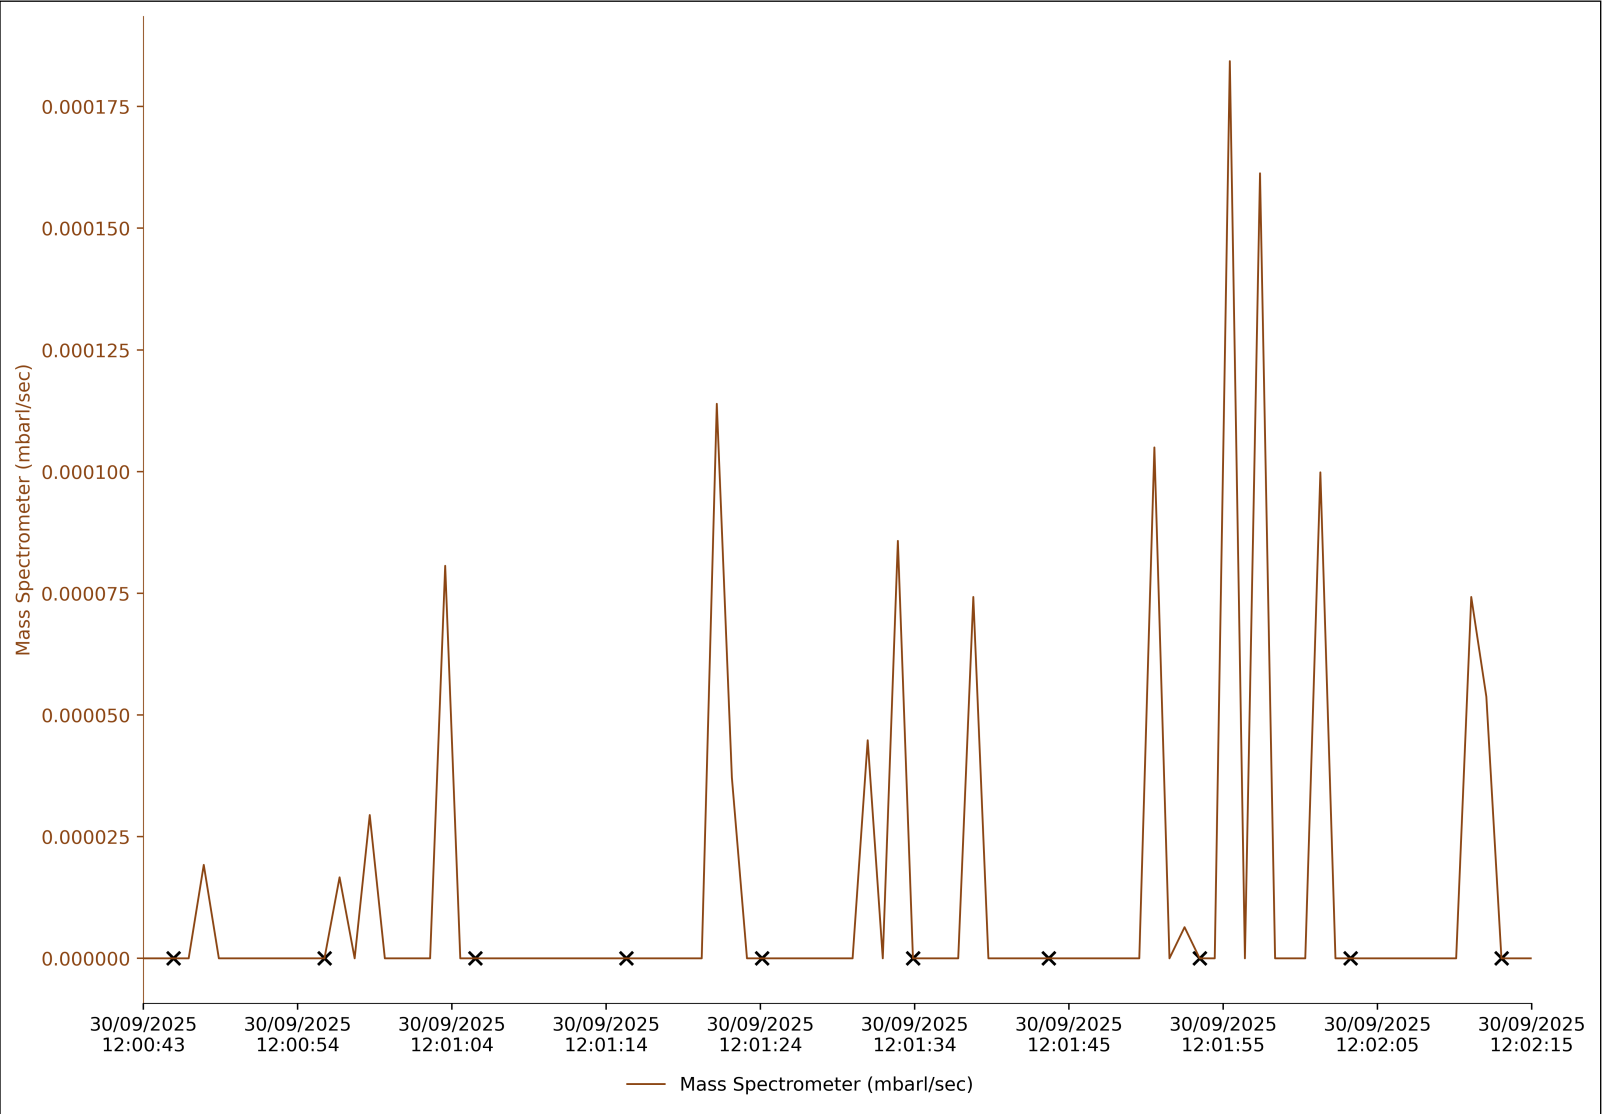

0	0.0	2500.0	5000.0	7500.0	10000.0
1	0	0.0	0.0	0.0	0.0
2	0.0	-0.0	0.0	0.0	0.0
3	0.0	2500.0	5000.0	7500.0	10000.0

Data Recording Equipment Used	
Data Logger	FAT Rig 1
Serial No.	a53beec16f67e4c2
Transducers	
Gauges	
Torque Transducer	N/A
Cycle Count	1
Test Pressure	0 psi
Breakout Torque	N/A
Running Torque	N/A
3rd Party Stamp and Date	
Operative: Jason Bradley	