


Test Procedure Reference	Calibration	Job No.	Calibration
Unique No.	Calibration	Test Description	Calibration
R&D Reference	Calibration	Test Date	30/09/2025
Valve Description	Calibration	Valve Drawing No.	Calibration



Calibration Torque

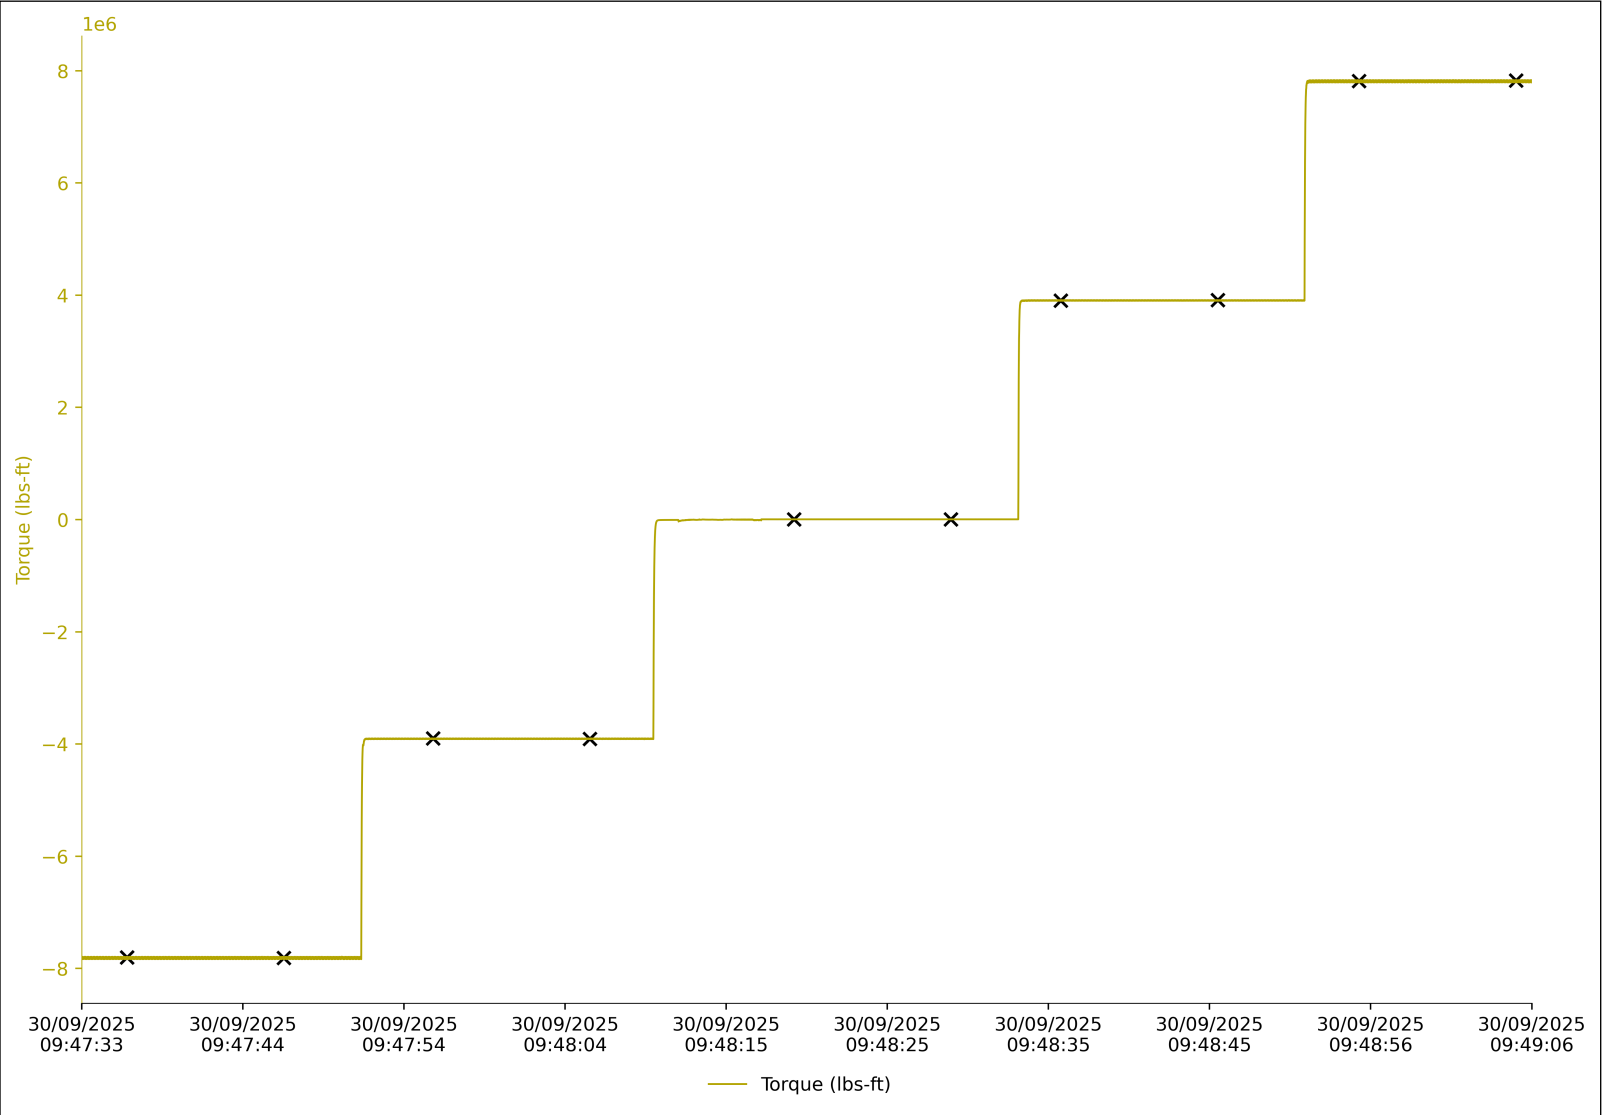

Applied (mV)	-10000	-5000	0	5000	10000
Counts (avg)	-7812981	-3906245	5188	3906089	7813065
Converted (mV)	-10000.616	-4999.994	6.641	4999.795	10000.724
Abs Error (mV) - ±1.0 mV	0.62	0.01	6.64	0.2	0.72

Data Recording Equipment Used

Data Logger [FAT Rig 1](#)
 Serial No. [a53beec16f67e4c2](#)
 Transducers

Gauges

Torque Transducer [N/A](#)

Cycle Count	1
-------------	-------------------

Test Pressure	0 psi
---------------	-----------------------

Breakout Torque	N/A
Running Torque	N/A

3rd Party Stamp and Date

Operative: [Jason Bradley](#)