

SHEET NOTES:

1. ALL WORK SHOWN ON SHEET IS PART OF OPTION BID 0005.
2. REFER TO CIVIL PLANS FOR PROJECT OPTIONS AND PHASING PLANS.
3. COORDINATE SYSTEM SHUT DOWNS WITH OWNER. SYSTEM TIE-IN WORK SHALL BE DONE DURING THE OFF SEASON RELATED TO THE SYSTEM. CHILLED WATER WORK SHALL BE DONE DURING WINTER MONTHS AND STEAM AND CONDENSATE WORK SHALL BE DONE DURING SUMMER MONTHS.

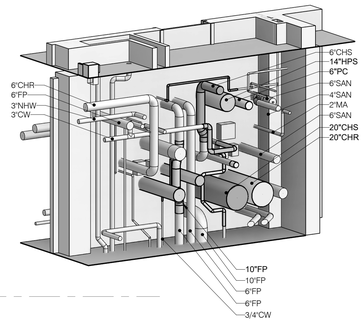

C9 ENTRANCE VIEW – BUILDING 01 - MECH SG182


NO SCALE

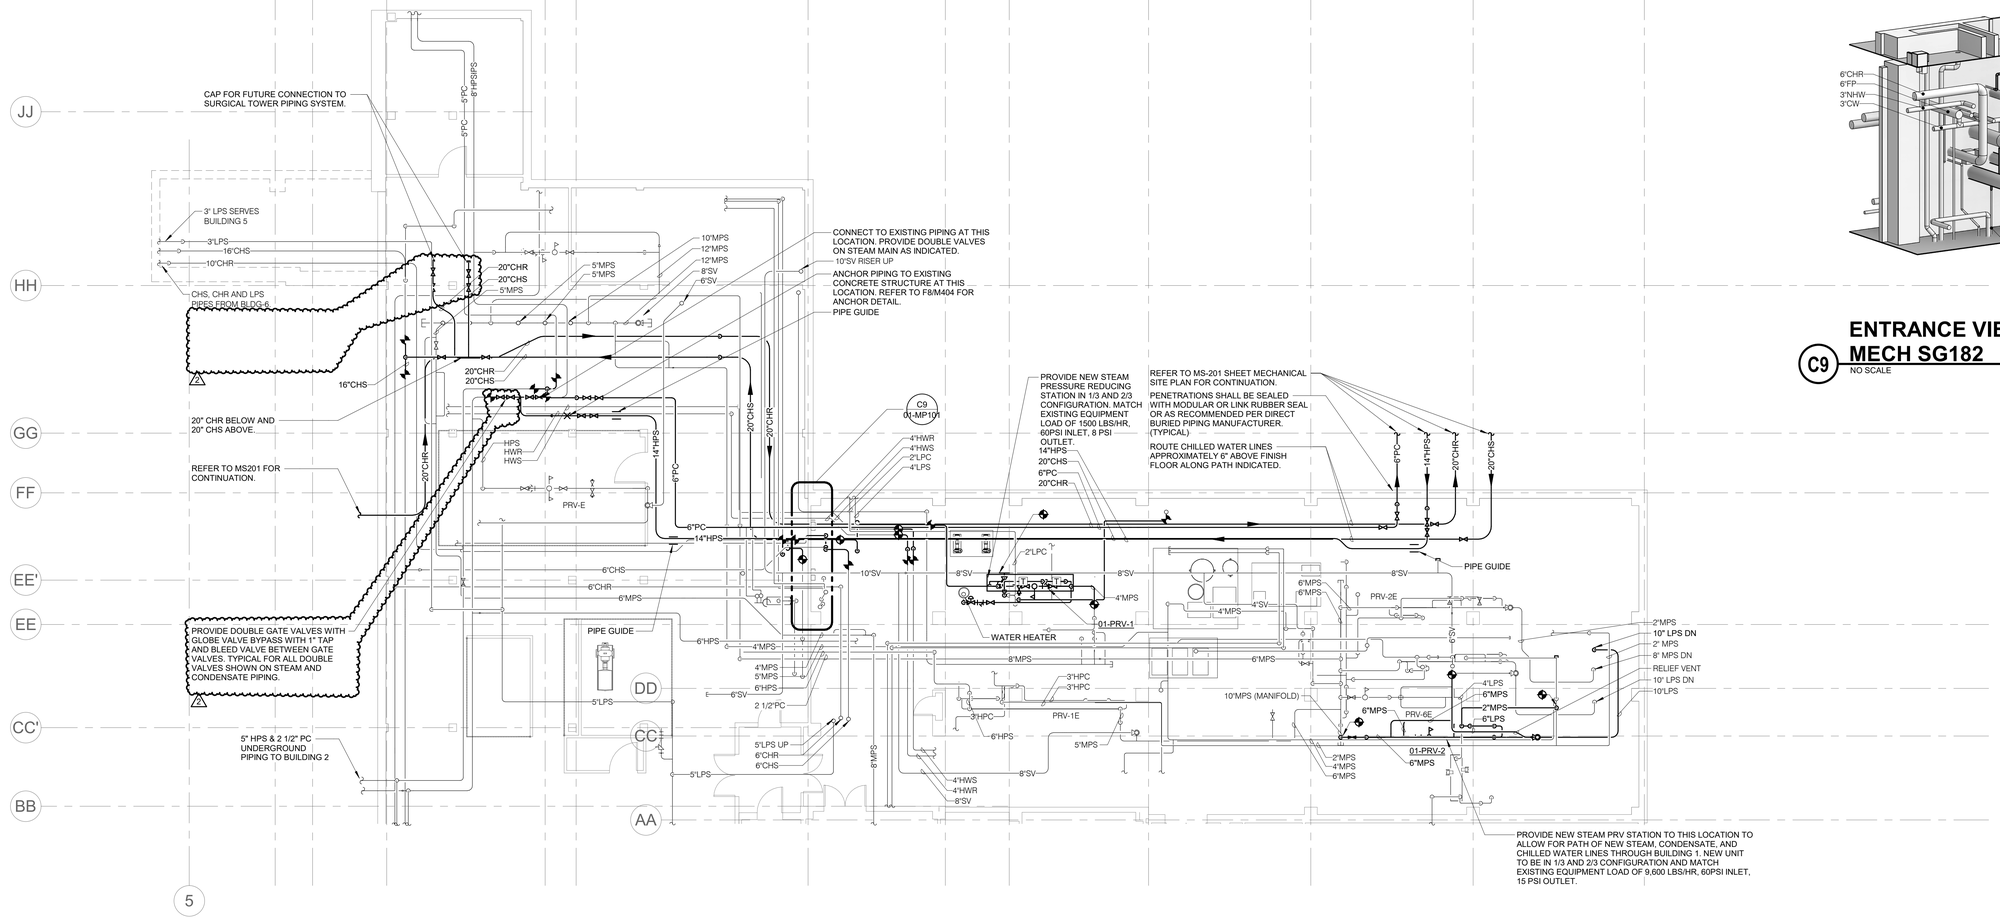

E4 BUILDING 1 - SUB-GROUND LEVEL - MECHANICAL PIPING - OPTION BID 0005

1/8" = 1'-0"

NORTH



BIDDING RFIS	09/23/2026
Revisions:	Date:

CONSTRUCTION AGENT

US Army Corps of Engineers ®

New England District

CONSULTANT

IMEG
The FUTURE Built Smarter www.imegcorp.com
15 SUNNEN DRIVE
SUITE 104
ST. LOUIS, MO 63143
P: 314.645.1132 F: 314.645.1173
PROJECT #22000669.04

DESIGNER OF RECORD

A/E:
LEO A DALY JOINT VENTURE | Perkins&Will

STAMP

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title
BUILDING 1 - SUB-GROUND LEVEL - MECHANICAL PIPING - OPTION BID 0005

Approved:

Phase
READY TO ADVERTISE

FULLY SPRINKLERED

Project Title
CHILLED WATER PLANT REPLACEMENT AND SITE UTILITY IMPROVEMENTS PHASE A2

Location
950 Campbell Avenue, West Haven, CT 06516

Issue Date	Checked	Drawn
2026-07-31	RUSARN	BHAACH

Project Number
689-040

Building Number
01

Drawing Number
01-MP101

Autodesk Docs://001-10210-001_Phase_A2/689_040_VAWH-BLDG-01_MP.rvt

10/28/2026 12:54:00 PM

VA FORM 08 - 6231