



NOTES:
1. CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 4000 PSI AT 28 DAYS WITH A MINIMUM CEMENT CONTENT OF 600 POUNDS PER CUBIC YARD FOR ALL FOOTINGS.
2. ALL CONCRETE SHALL HAVE A SLUMP OF NO GREATER THAN 4" (TO WITHIN A TOLERANCE OF 1").
3. ALL EXPOSED CONCRETE SHALL BE AIR-ENTRAINED, 6 (WITHIN 1% TOLERANCE), CONFORMING TO ASTM C260.
4. REINFORCING STEEL BARS SHALL BE A MINIMUM ASTM A615, GRADE 60, AND SHALL BE FIELD WIRED IN PLACE.
5. ALL FORMWORK AND PLACEMENT OF CONCRETE SHALL COMPLY WITH GOOD CONSTRUCTION PRACTICED AND BE IN ACCORDANCE WITH ALL LOCAL GOVERNING CODES, AND REGULATIONS AS WELL AS THE ACI AND UNIFORM BUILDING CODE.
6. ALL STEEL SHALL BE GRADE F = 60,000


C1 RETAINING WALL
NTS

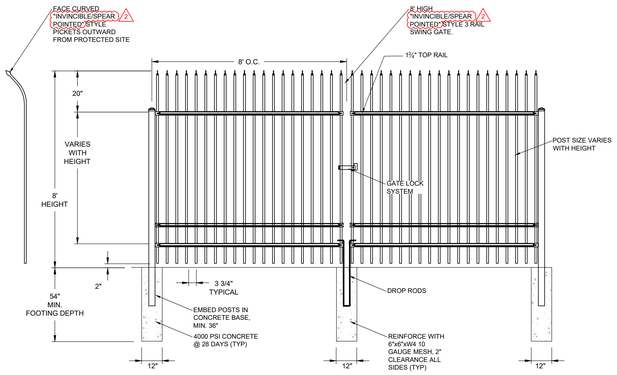

C4 8' HIGH PERIMETER SECURITY DOUBLE SWING GATE
NTS

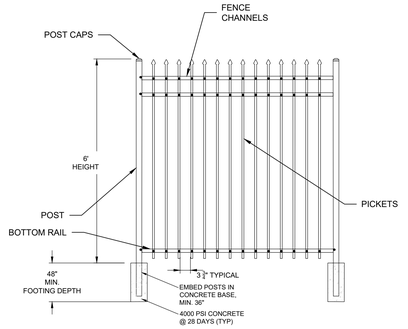


C6 6' HIGH WROUGHT IRON FENCE
NTS

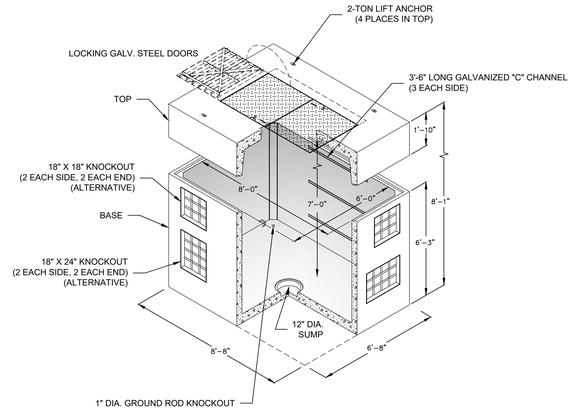


NOTE: DESIGNED FOR 0 TO 5'-0" OF COVER

C9 WATER METER VAULT
NTS




NOTES;
1. PROVIDE THRUST BLOCKS AS REQUIRED.


D1 POST INDICATOR VALVE
NTS

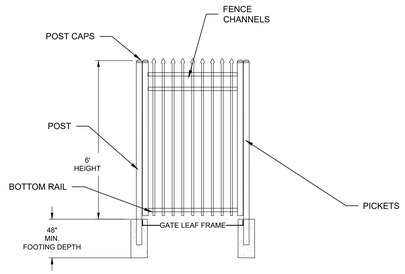


D4 6' HIGH WROUGHT IRON SWING GATE
NTS

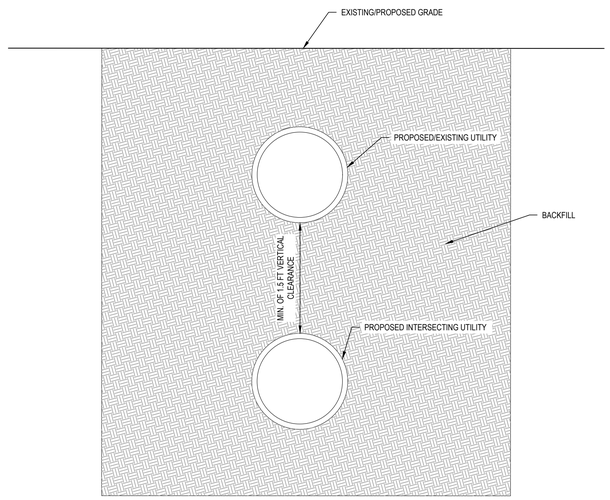

F5 TYPICAL UTILITY INTERSECTION: VERTICAL CLEARANCE ≥ 1.5 FT
NTS

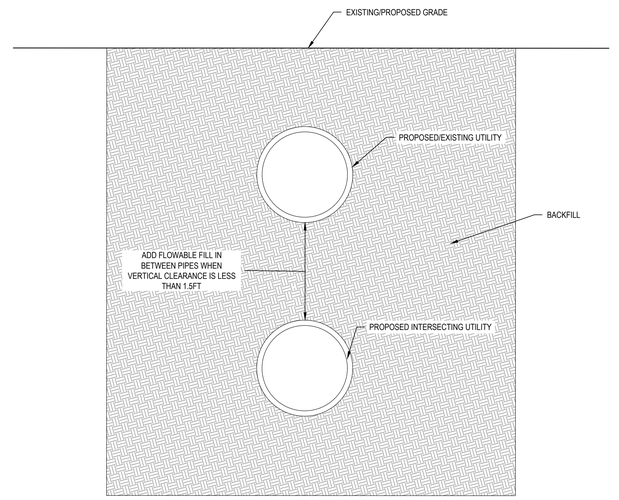


F8 TYPICAL UTILITY INTERSECTION: VERTICAL CLEARANCE < 1.5 FT
NTS

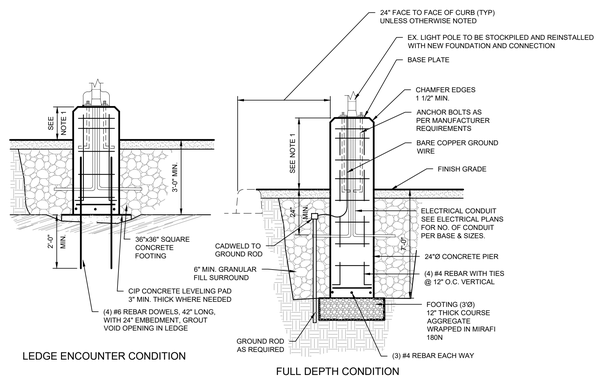

NOTE:
1. POLE BASE HEIGHT REVEAL ABOVE FINISHED GRADE SHALL BE AS 36" UNLESS OTHERWISE SPECIFIED ON PLANS

F1 LIGHT POLE BASE
NTS



NOTES

1. THE BACKFILL MATERIAL SHALL BE CRUSHED STONE OR OTHER GRANULAR MATERIAL MEETING THE REQUIREMENTS OF CLASS I, CLASS II, OR CLASS III MATERIAL AS DEFINED IN ASTM D2321. BEDDING & BACKFILL FOR SURFACE DRAINAGE INLETS SHALL BE PLACED & COMPACTED UNIFORMLY IN ACCORDANCE WITH ASTM D2321.

F4 AREA DRAIN
NTS

BIDDING RFIS	09/23/2026 /2
Revisions:	Date:

CONSTRUCTION AGENT
US Army Corps of Engineers ®
New England District

CONSULTANT
Mabbett®
Scientists | Engineers | Program Managers
Mabbett & Associates, Inc.
105 Central Street Stoneham, MA 02180-1248
T. 781-275-6050
www.mabbett.com

DESIGNER OF RECORD
A/E:
LEO A DALY JOINT VENTURE | Perkins&Will

STAMP

Office of Construction and Facilities Management
VA | U.S. Department of Veterans Affairs

Drawing Title: CIVIL DETAILS
Approved:
Phase: READY TO ADVERTISE
FULLY SPRINKLERED
Project Title: CHILLED WATER PLANT REPLACEMENT AND SITE UTILITY IMPROVEMENTS PHASE A2
Location: 950 CAMPBELL AVENUE WEST HAVEN, CT 06516
Issue Date: 2026-07-31
Checked: RBB
Drawn: KRS
Project Number: 689-040
Building Number: 17
Drawing Number: CK505

Autodesk Docs://001-110210-001_Phase_A2/689-040_BLDG-17_ARCH-Interior.rvt

VA FORM 08 - 6231