

FLOW DIAGRAM SYMBOLS LIST

SYMBOL:	DESCRIPTION:
—A—	COMPRESSED AIR
—D—	DRAIN
—FOF—	FUEL OIL FILL
—FOR—	FUEL OIL RETURN
—FOS—	FUEL OIL SUPPLY
—HPC—	HIGH-PRESSURE CONDENSATE
—HPS—	HIGH-PRESSURE STEAM
	PITCH PIPE IN DIRECTION
	DIRECTION OF FLOW IN PIPE
	UNION/FLANGE
	EXTERNAL EMERGENCY VALVE
	SHUTOFF VALVE NORMALLY OPEN
	SHUTOFF VALVE NORMALLY CLOSED
	THROTTLING VALVE
0.5	AUTOMATIC BALANCING VALVE (NO. INDICATES GPM)
0.5	BALANCING VALVE (NO. INDICATES GPM)
	CONTROL VALVE (THREE-WAY)
	CONTROL VALVE (TWO-WAY)
	SOLENOID/TWO POSITION VALVE
	CHECK VALVE
	SAFETY/RELIEF VALVE
	PRESSURE REDUCING VALVE (LIQUID/GAS)
	"WYE" - STRAINER
	"WYE" - STRAINER W/SHUTOFF VALVE AND HOSE CONNECTION WITH CAP
	FLEXIBLE CONNECTION
	PRESSURE/TEMPERATURE TEST PLUG
	REDUCER - REFERENCE SPECIFICATION FOR CONCENTRIC/ECCENTRIC AND FOT/FOB
	METER
	PRESSURE GAUGE (FURNISHED WITH BALL VALVE)
	SUCTION DIFFUSER WITH SUPPORT FOOT
	AUTOMATIC AIR VENT
	MANUAL AIR VENT W/ BALL VALVE
	DRAIN WITH HOSE CONNECTION, CAP & BALL VALVE
T	TEMPERATURE SENSOR WITH WELL
	THERMOMETER WITH WELL (FILLED TYPE)
FM	FLOW METER
VS	VACUUM SWITCH
PT	PRESSURE TRANSMITTER

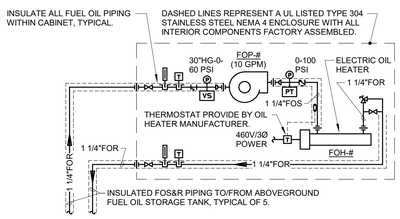





INDICATORS AND SWITCHES MOUNTED ON FUEL OIL HEATER PANEL FACE

C1 ELECTRIC OIL HEATER FLOW DIAGRAM

NO SCALE

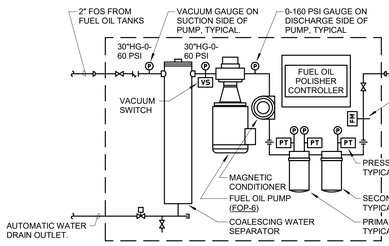




INDICATORS AND SWITCHES MOUNTED ON FUEL OIL POLISHER PANEL FACE

E2 FUEL OIL POLISHER

NO SCALE

TANK CONTROLLER LIST

SYMBOL:	DESCRIPTION:
FL	FLUID LEVEL TRANSMITTER
HH	HIGH-HIGH LEVEL ALARM SWITCH
HL	HIGH LEVEL SWITCH
ILD	INTERSTITIAL LEAK DETECTOR
WL	WATER LEVEL TRANSMITTER

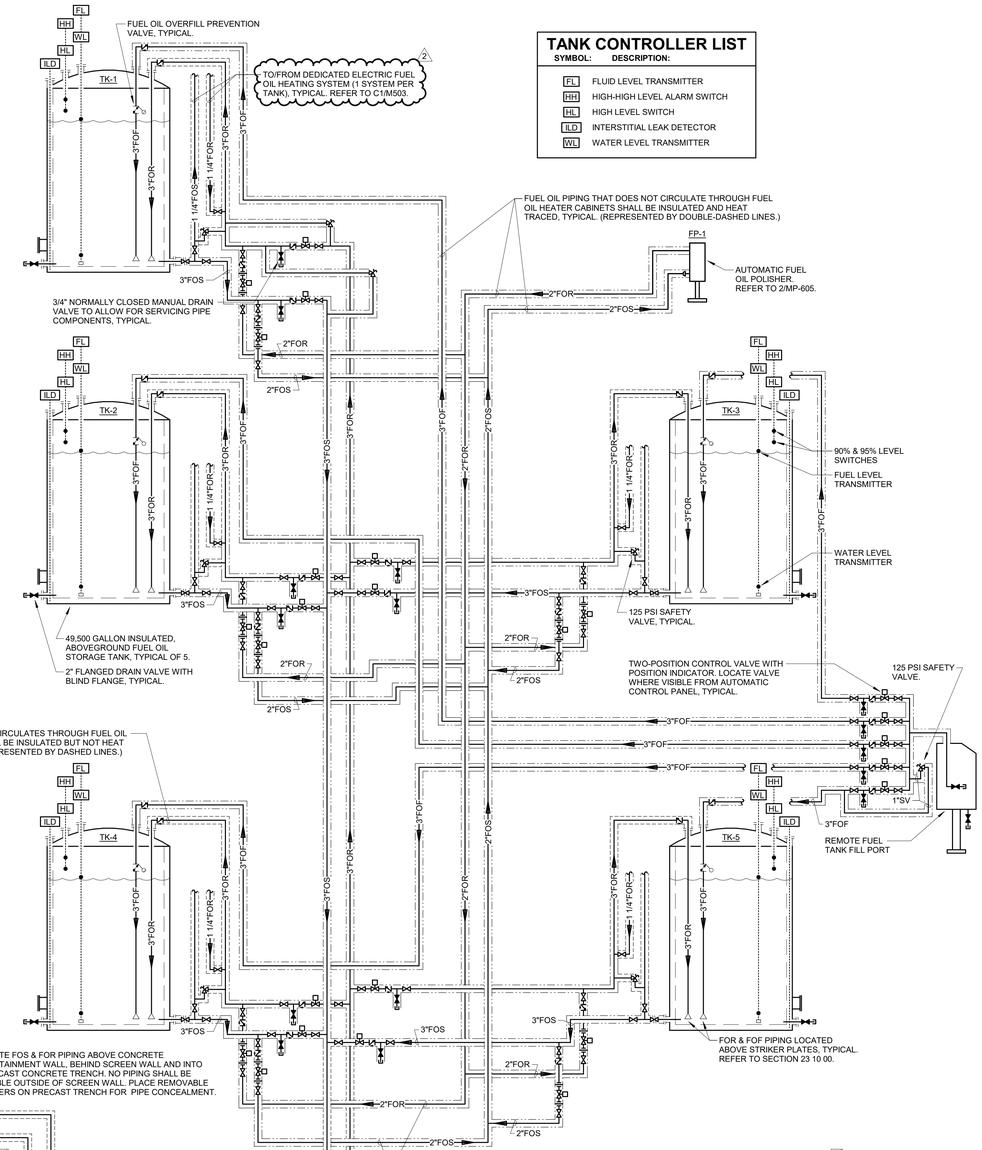

F5 TANK YARD FUEL OIL PIPING FLOW DIAGRAM

NO SCALE

BIDDING RFIS	09/23/2026
Revisions:	Date:

CONSTRUCTION AGENT

US Army Corps of Engineers ®

New England District

CONSULTANT

IMEG
The FUTURE. Built Smarter www.imegcorp.com
15 SUNNEN DRIVE
SUITE 104
ST. LOUIS, MO 63143
P: 314.645.1132 F: 314.645.1173
PROJECT #22000669.04

DESIGNER OF RECORD

A/E:
LEO A DALY JOINT VENTURE | Perkins&Will

STAMP

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: MECHANICAL DIAGRAMS	Phase: READY TO ADVERTISE	Project Title: CHILLED WATER PLANT REPLACEMENT AND SITE UTILITY IMPROVEMENTS PHASE A2	Project Number: 689-040
Approved:	FULLY SPRINKLERED	Location: 950 CAMPBELL AVENUE WEST HAVEN, CT 06516	Building Number: 17
		Issue Date: 2026-07-31 / Checked: RUSARN / Drawn: BHAACH	Drawing Number: M503

Autodesk Docs://001-102\10-001_Phase_A2\689-040_VAWH BLDG-17_MP.rvt
10/28/2026 12:48:26 PM

VA FORM 08 - 6231