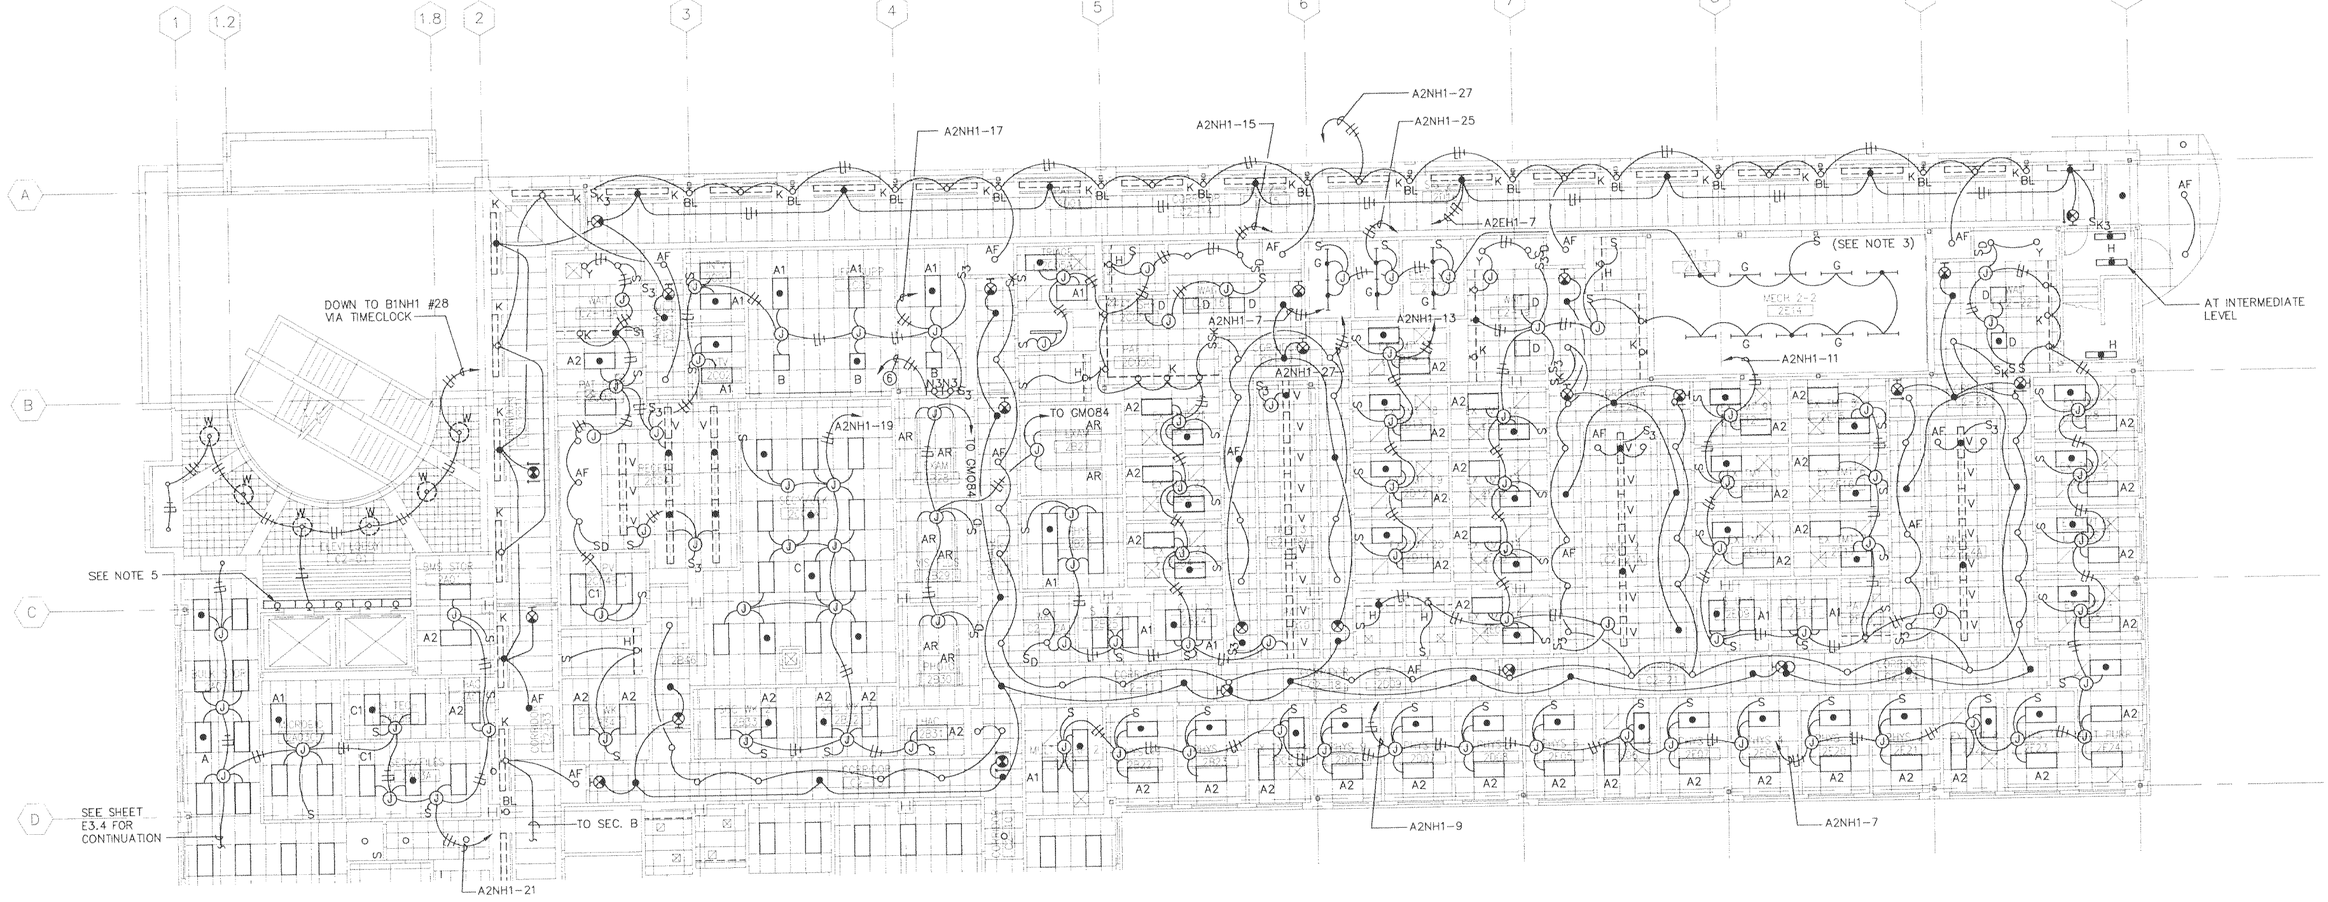



1/E3.3 PARTIAL LIGHTING PLAN - LEVEL 2 - AREA A

SCALE: 1/8" = 1'-0"

NOTES:

1. FIXTURE TYPE INDICATED IN ROOM IS TYPICAL FOR ALL LIGHT FIXTURES IN THAT ROOM.
2. A SHALLOW JUNCTION BOX (1-1/2" DEPTH) SHALL BE USED FOR MOUNTING LIGHT FIXTURE TYPE "BL" WHERE STRUCTURAL STEEL COLUMNS OCCUR.
3. COORDINATE WITH STRUCTURAL AND MECHANICAL CONTRACTORS FOR PLACEMENT OF LIGHT FIXTURES IN ELEC., MECH., AND SIGNAL ROOMS.
4. THE DIMMABLE TRACK LIGHTING IN EXAM ROOMS 2B27 AND 2B28 SHALL BE CONNECTED TO THE LUMBART INSTRUMENT CONTROL PANEL. (CONNECT TO CONNECTION POINT #5 AND INSTALL PER MANUFACTURER'S REQUIREMENTS.
5. ELEVATOR LOBBY LIGHTS-TYPE "S". FOUR (4)-4' AND ONE (1)-3' TO SPAN TOTAL LENGTH OF LOBBY.

(6) CONNECT TO NEAREST RECEPTACLE CIRCUIT IN ROOM.

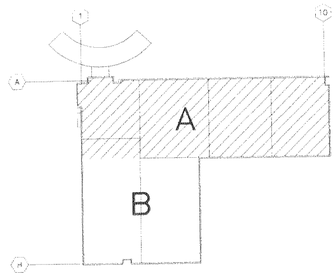

KEY PLAN
NO SCALE

N PROJECT NORTH

GRAPHIC SCALE
4' 0 4' 8' 12' 16' 20'
1/8"=1'-0" scale feet

DVM JOB No.: 95150
CAD FILE No.: 30C-2ALP

Revisions	Date

DOUGLAS V. MACMAHON LTD.
REGISTERED PROFESSIONAL ENGINEERS
1121 KAPAHULU AVENUE
HONOLULU, HAWAII 96816

ARCHITECTS HAWAII LIMITED
Pacific Tower, Suite 300
1001 Bishop Street
Honolulu, Hawaii 96813
Telephone: (808) 523-9636
FAX: (808) 521-3280

This work was prepared by me or under my supervision and construction of this project will be under my supervision.

Signature

NOTE: Contractor to check and verify all dimensions at job before proceeding with work.

Drawing Title: PARTIAL LIGHTING PLAN LEVEL 2 - AREA A

Approved: Area Project Manager

Project Title: AMBULATORY CARE AND RENOVATE E-WING PHASE I, AMBULATORY CARE CLINIC

Building Number: 30 | Checked: TS | Drawn: TY

Location: VAMROC, HONOLULU, HAWAII

Date: DEC. 23, 1996

Project No.: 459-002A

Drawing No.: E3.3 Dwg. Of

Department of Veterans Affairs

VA FORM, 08-6231A, JAN 1990

GPO U.S. GOVERNMENT PRINTING OFFICE: 1994-440-487