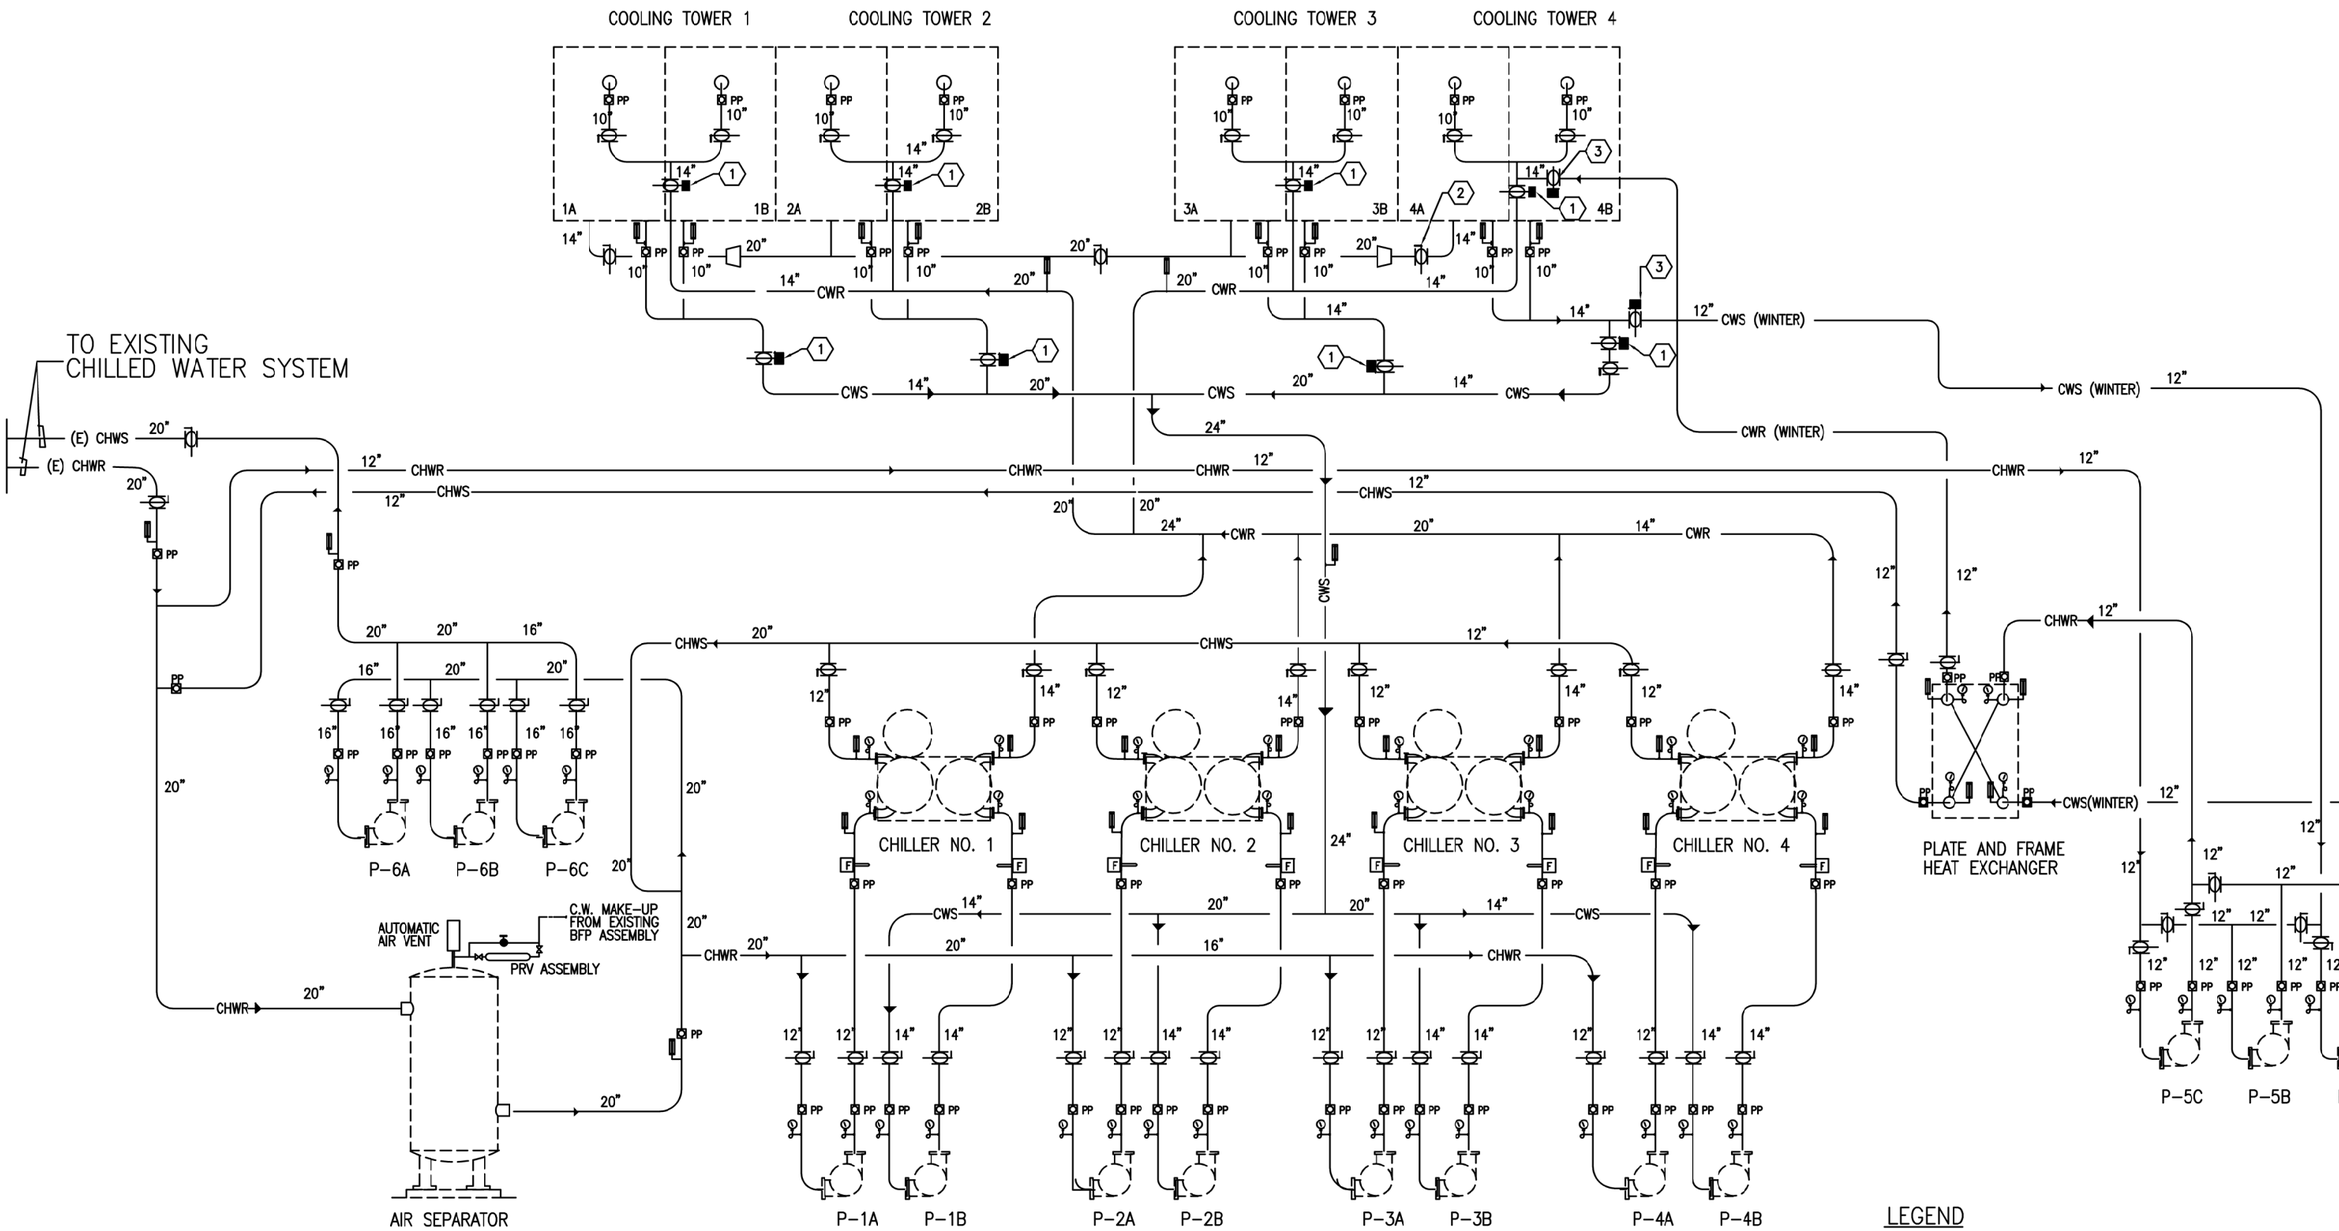



## 1 – CHILLER PLANT FLOW SCHEMATIC – MECHANICAL

SCALE: NONE

M-2.1 WORK NOTES:

1. REPLACE THE EXISTING 14" CONTROL VALVE WITH NEW BUTTERFLY VALVE WITH PNEUMATIC OPERATOR.
2. REPLACE THE EXISTING 14" CONTROL VALVE WITH A MANUAL BUTTERFLY VALVE.
3. REPLACE THE EXISTING 12" CONTROL VALVE WITH NEW BUTTERFLY VALVE WITH PNEUMATIC OPERATOR.

LEGEND

- PRESSURE GAUGE – RANGE 0-100 PSIG
- THERMOMETER – RANGE 0-100 DEGREES F
- PP PETE'S PLUG – 1/2" (PRESSURE & TEMPERATURE PLUG)
- F FLOW METER
- BUTTERFLY VALVE WITH PNEUMATIC ACTUATOR
- BUTTERFLY VALVE

| | |
|---|---|
| CWS | CONDENSER WATER SUPPLY |
| CWR | CONDENSER WATER RETURN |
| CHWS | CHILLED WATER SUPPLY |
| CHWR | CHILLED WATER RETURN |

\\bepfiles\ofs$\FACILITY_MASTER_DRAWINGS\Chilled_Water_Plant\11-13-12 Replace-Control-Valve\M02-schematic-BEPVFD.dwg, 7/