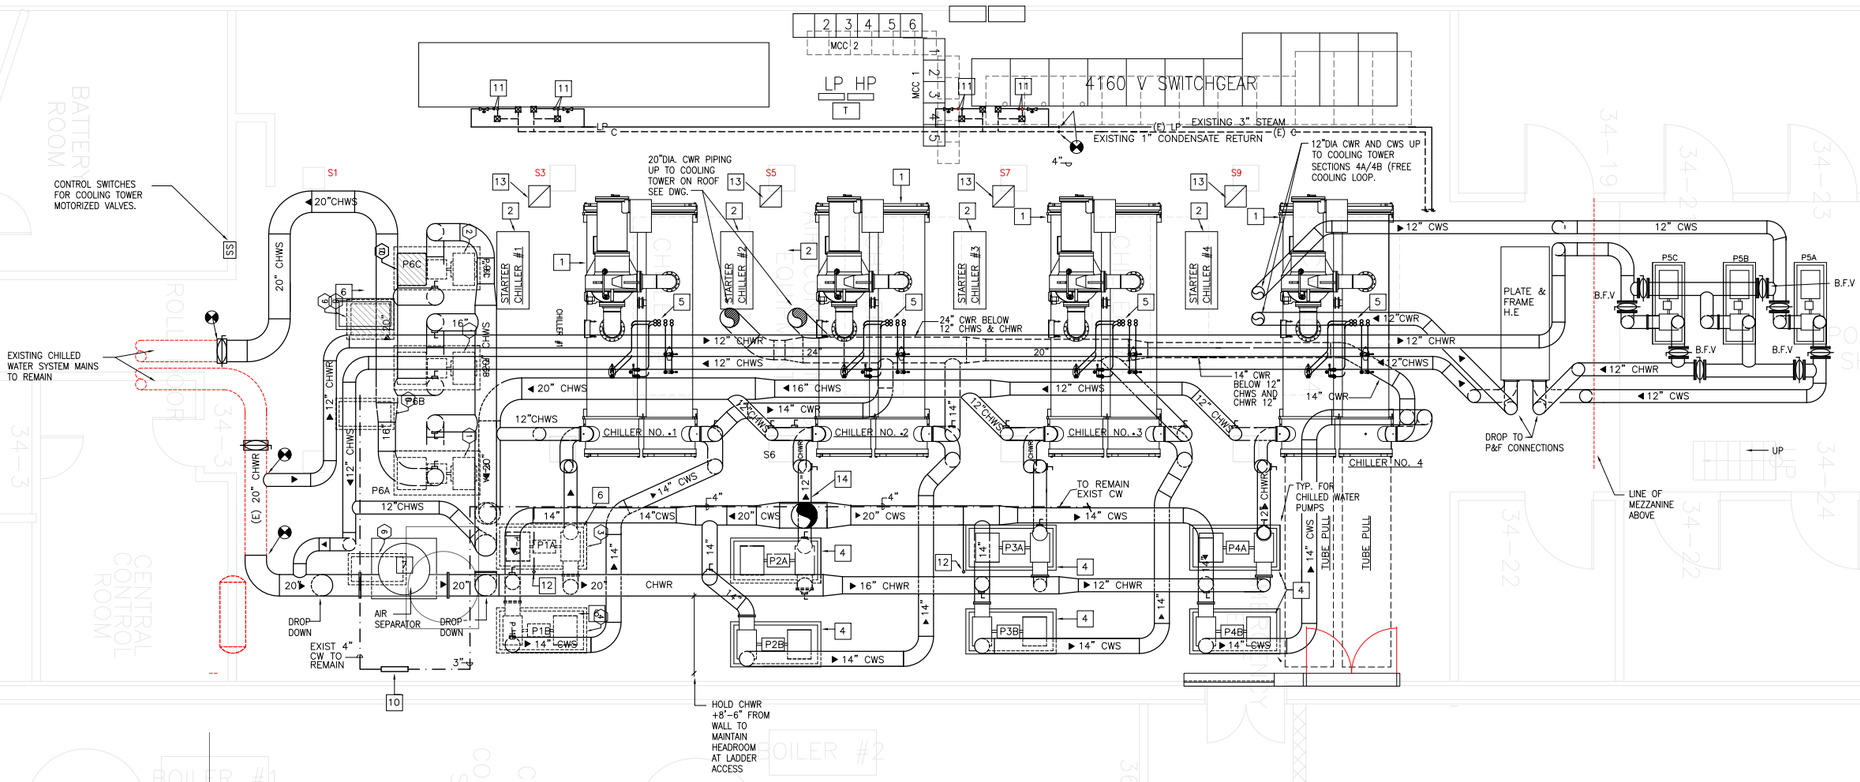

4160 V SWITCHGEAR
LP HP
MCC 1
MCC 2
EXISTING 3" STEAM
EXISTING 1" CONDENSATE RETURN
CONTROL SWITCHES FOR COOLING TOWER MOTORIZED VALVES.
20"DIA. CWR PIPING UP TO COOLING TOWER ON ROOF SEE DWG.
12"DIA CWR AND CWS UP TO COOLING TOWER SECTIONS 4A/4B (FREE COOLING LOOP.
EXISTING CHILLED WATER SYSTEM MAINS TO REMAIN
STARTER CHILLER #1
STARTER CHILLER #2
STARTER CHILLER #3
STARTER CHILLER #4
20" CHWS
12" CHWR
12" CWS
16" CHWS
14" CWR
24" CWR BELOW 12" CHWS & CHWR
14" CWR BELOW 12" CHWS AND CHWR 12"
CHILLER NO. 1
CHILLER NO. 2
CHILLER NO. 3
CHILLER NO. 4
PLATE & FRAME H.E
B.F.V
P5A
P5B
P5C
P6A
P6B
P6C
P1A
P1B
P2A
P2B
P3A
P3B
P4A
P4B
DROP TO P&F CONNECTIONS
LINE OF MEZZANINE ABOVE
UP
TO REMAIN EXIST CW
TYP. FOR CHILLED WATER PUMPS
TUBE PULL
DROP DOWN
AIR SEPARATOR
EXIST 4" CW TO REMAIN
HOLD CHWR +8'-6" FROM WALL TO MAINTAIN HEADROOM AT LADDER ACCESS
BATTERY ROOM
CENTRAL CONTROL ROOM
MEN'S ROOM
ROLL DOOR
POWER PLANT SHOP AREA
BOILER #1
BOILER #2
A-H-U MB-2