CONDENSER WATER SUPPLY
CONDENSER WATER SUPPLY
DISCHARG
TION
4-A

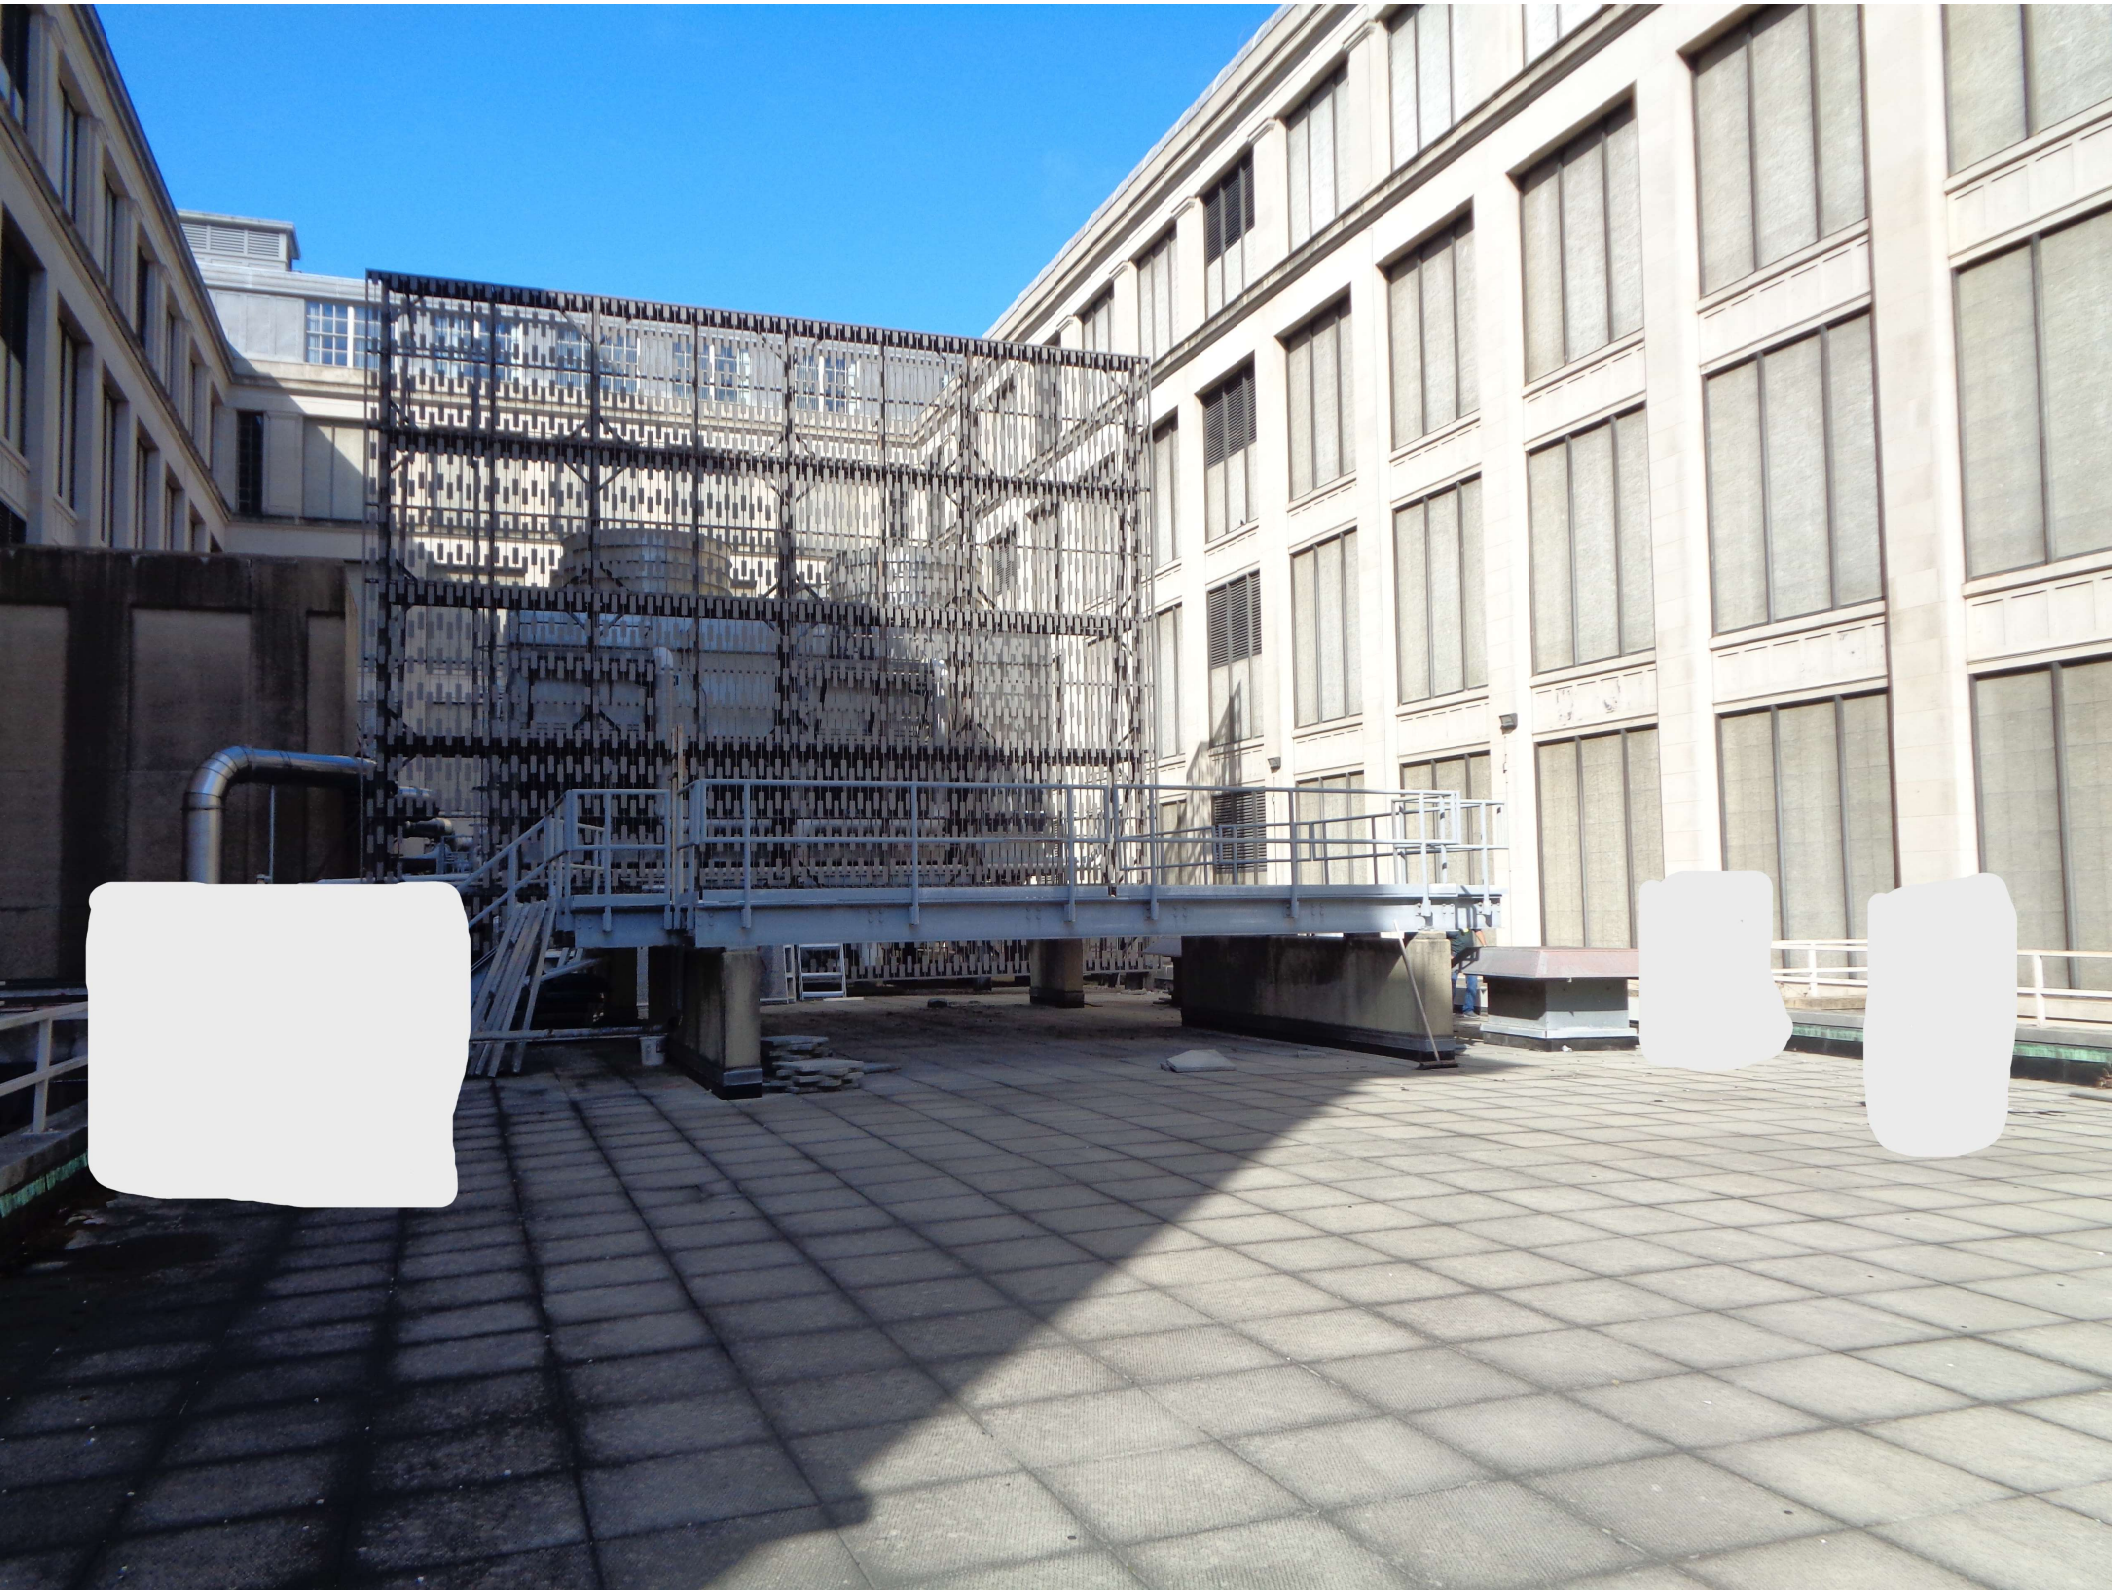

EX FAN 4

EX FAN 1

evapco

POWER PLANT

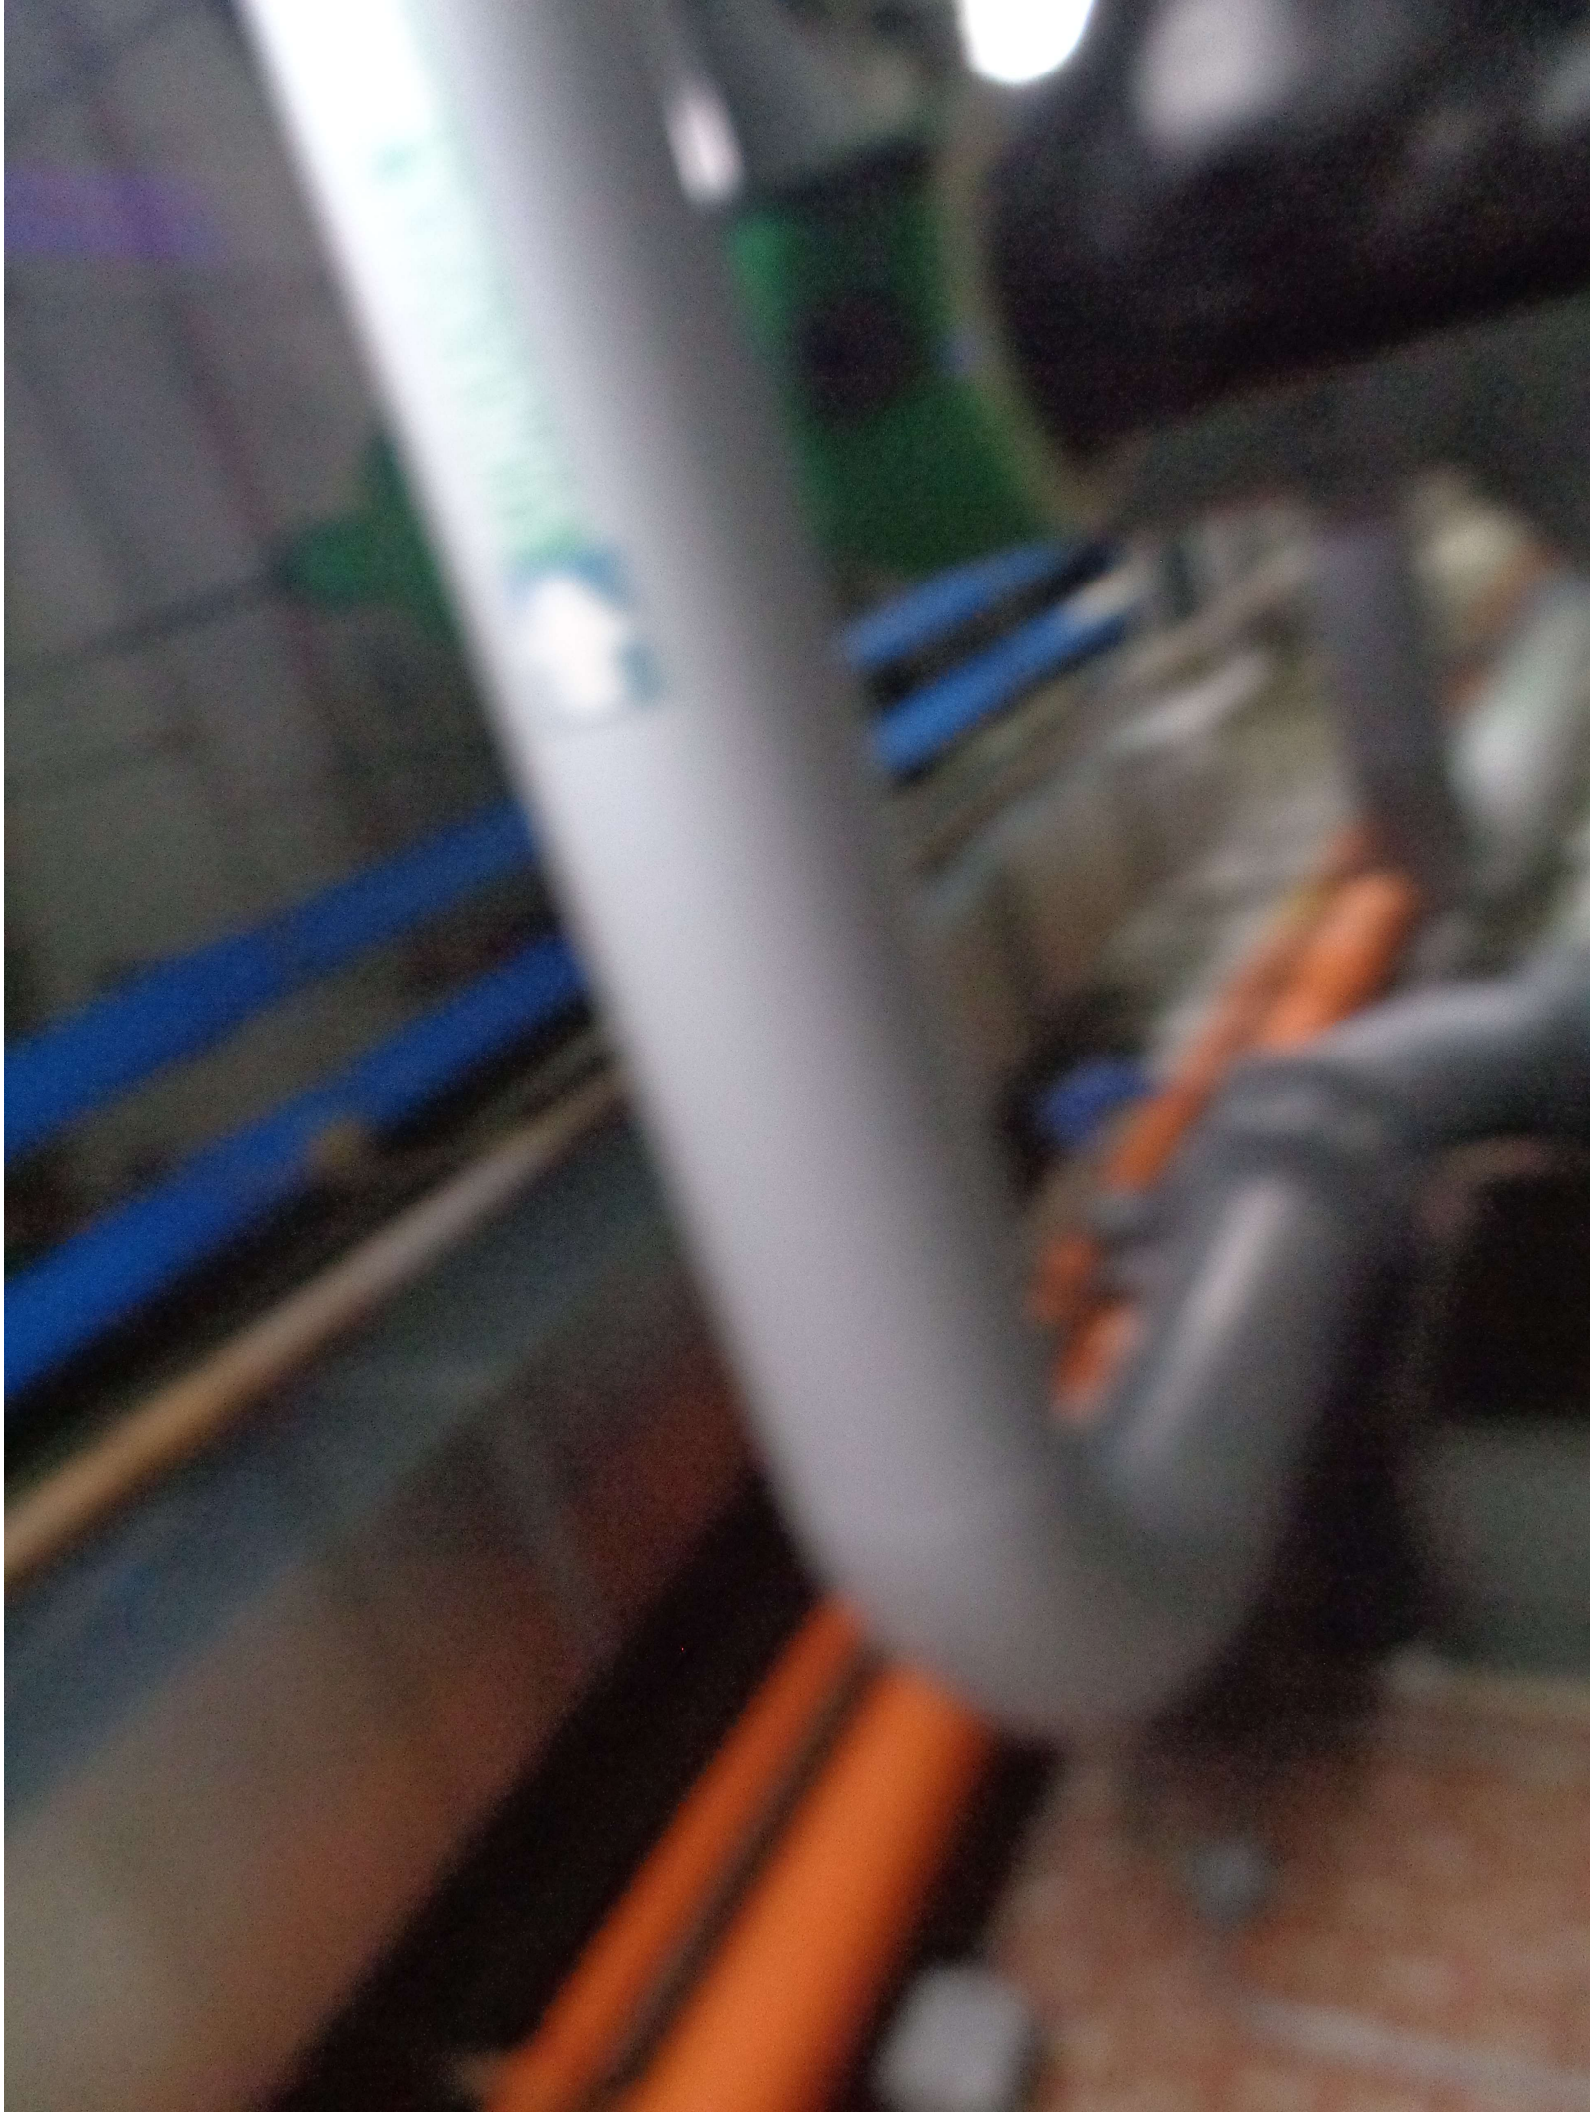

CO DISPATCHER 469-534
PEPCO DISPATCHER BEFORE AND
OPENING OR CLOSING INCOMING
S, TYING A AND C GROUPS, OR
OR UNLOADING ANY GROUP
A - 15624
B - 15623
C - 15621
PLANT
ON
OFF
RELAY TESTING
Pepco
301-469-5341
FIRE
EXTINGUISHER
FIRE
EXTINGUISHER
DO NOT
DO NOT
FI
EXTING
USE ON
A
B

JOHNSON CONTROLS
°F
°C
15psi
3psi

HAZARDOUS MATE
IDENTIFICATION GU
4 EXTREME
3 SERIOUS
2 MODERA
1 SLIGHT
0 MINIM
DEGREE
3 HEALTH
1 FLAMMABILITY
3 REACTIVITY
PROTECTIVE
PE HAZARD