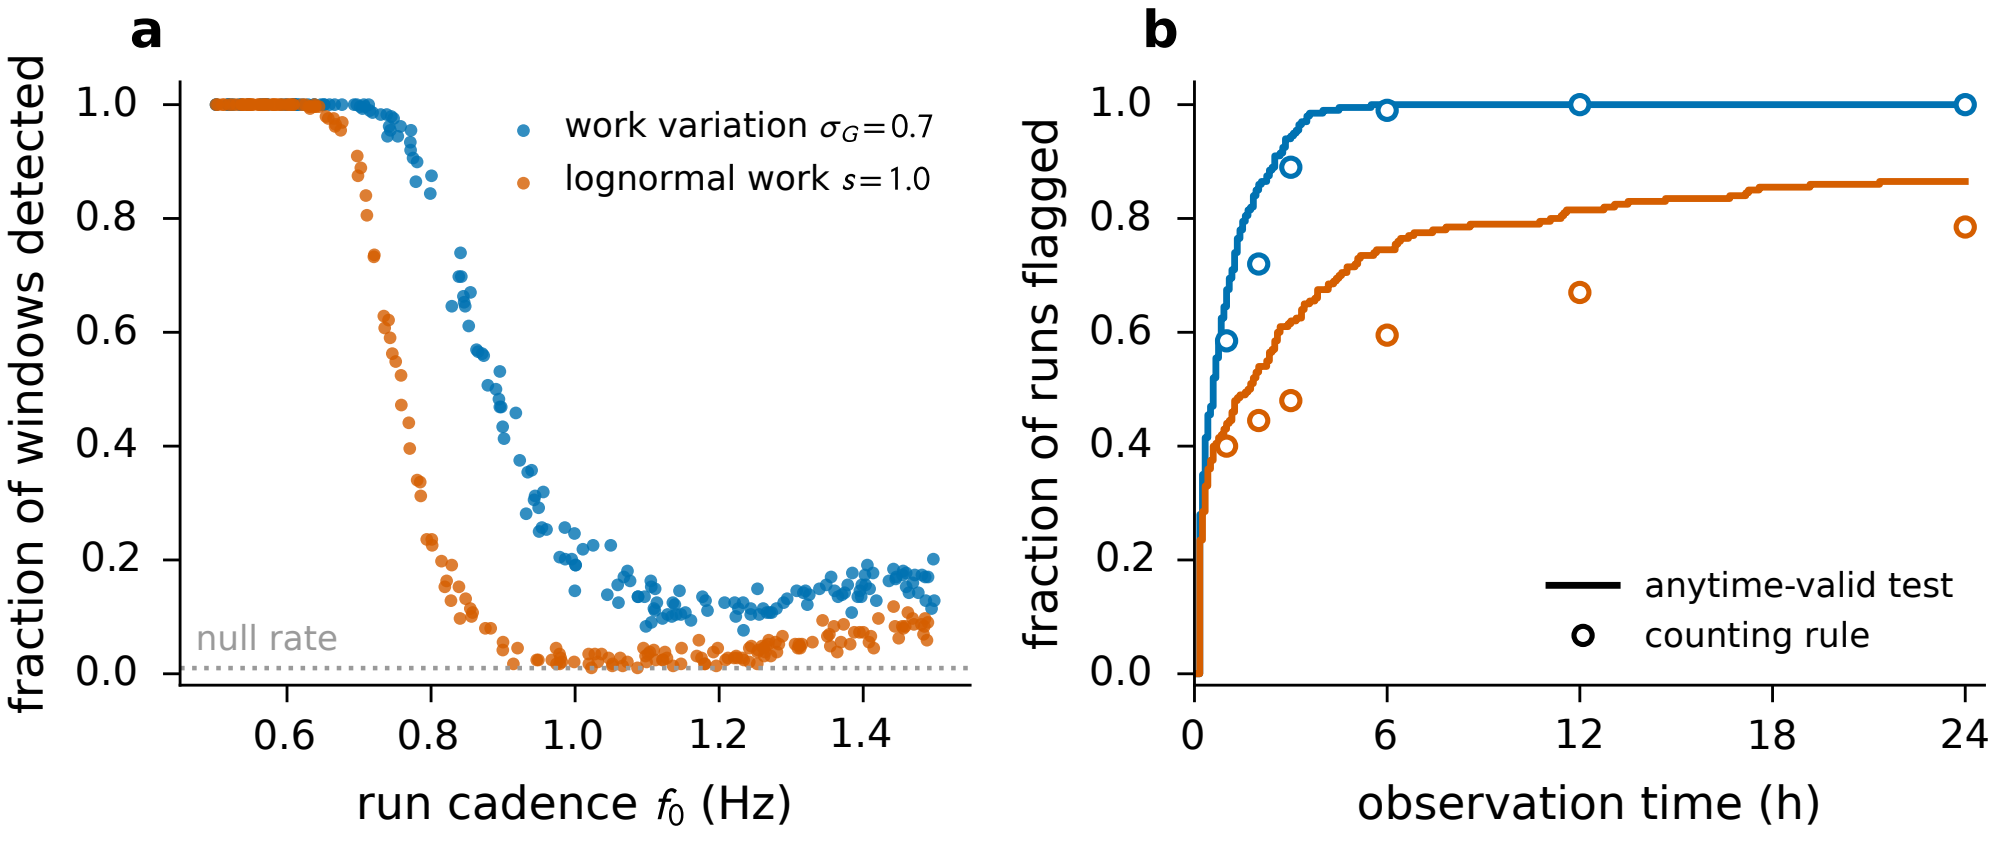
a
b
fraction of windows detected
1.0
0.8
0.6
0.4
0.2
0.0
work variation $\sigma_G = 0.7$
lognormal work $s = 1.0$
null rate
0.6
0.8
1.0
1.2
1.4
run cadence f_0 (Hz)
fraction of runs flagged
anytime-valid test
counting rule
0
6
12
18
24
observation time (h)