



Controlled rooms-timing diagnostic — original sample definition, controls, codes and estimator


Reproduction of the original specification

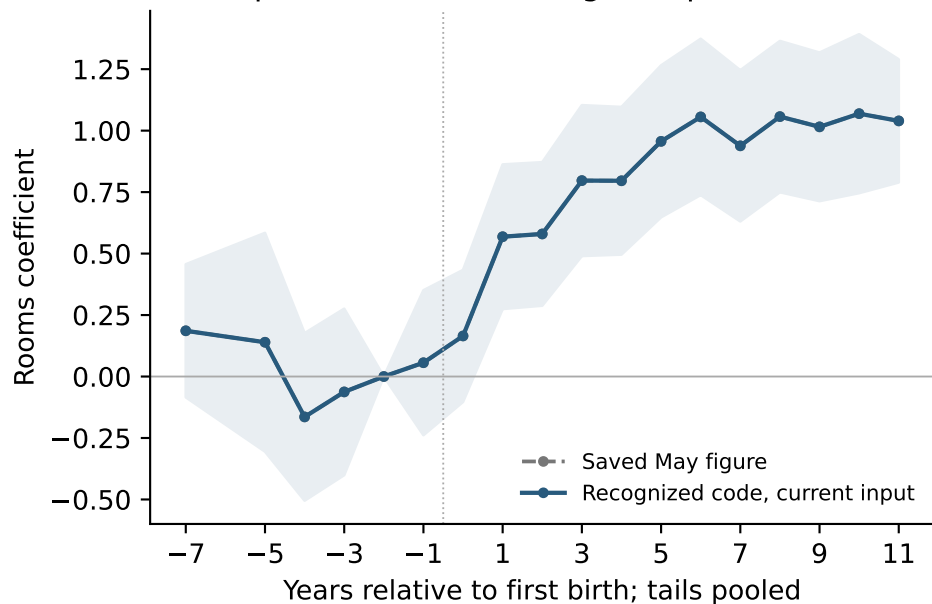

Timing only, identical observations

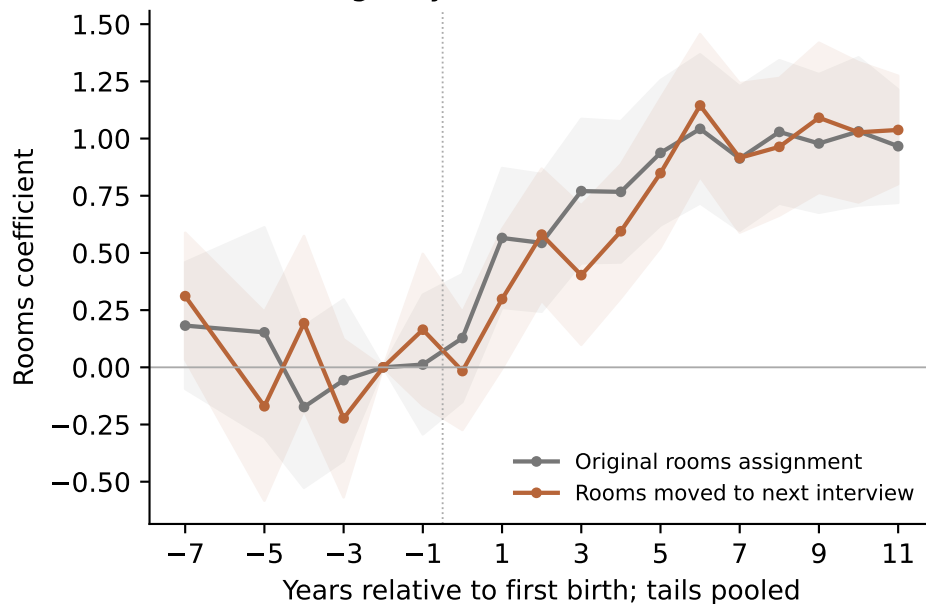

Same estimates, each measured from year -1

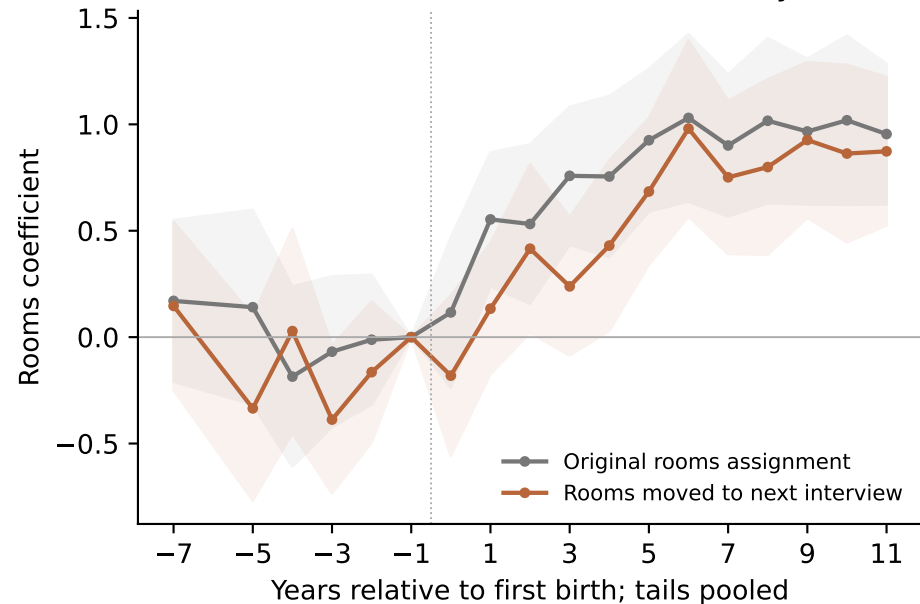

Diagnostic only. Original -2/-6 reference restrictions and last-cohort comparison remain. Shading: 95% intervals.