


1. Electricity & water may be installed in the same trench provided they are separated by a min. distance of 300 mm
2. Min. depth of S.E.C. cable 500mm.
3. Water may be at any convenient depth.
4. Polypropylene gas line must be in separate trench. The gas & fuel corporation carry out the installation of this line as far as the meter.
5. Similarly, telephone cable must be in separate trench.

DETAILS OF UNDERGROUND SERVICES

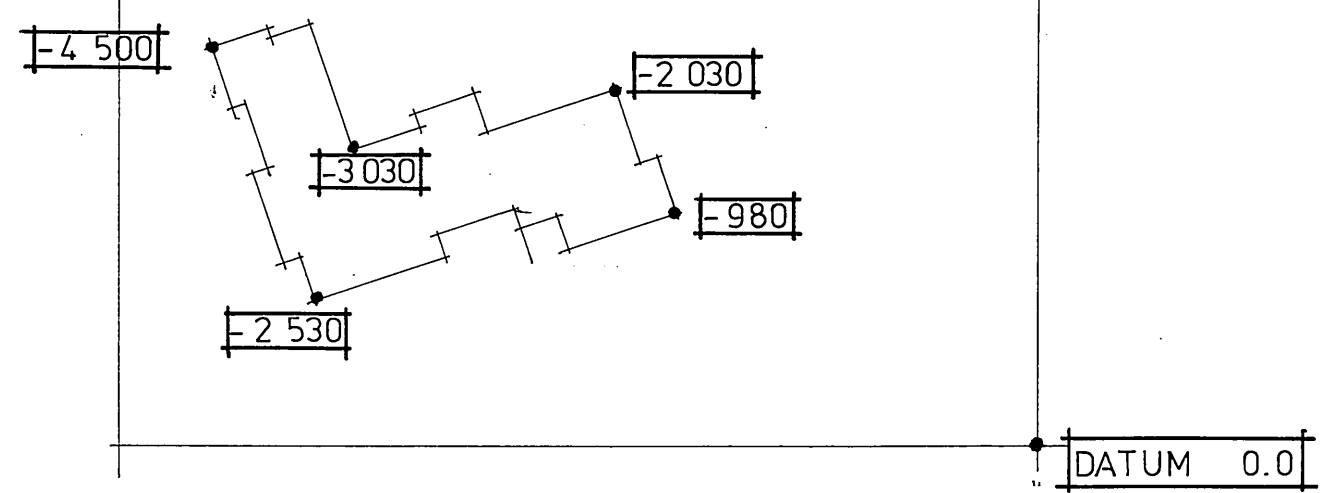

LEVELS AT CORNERS OF HOUSE RELATIVE TO LEVEL AT SOUTH-EAST CORNER OF SITE