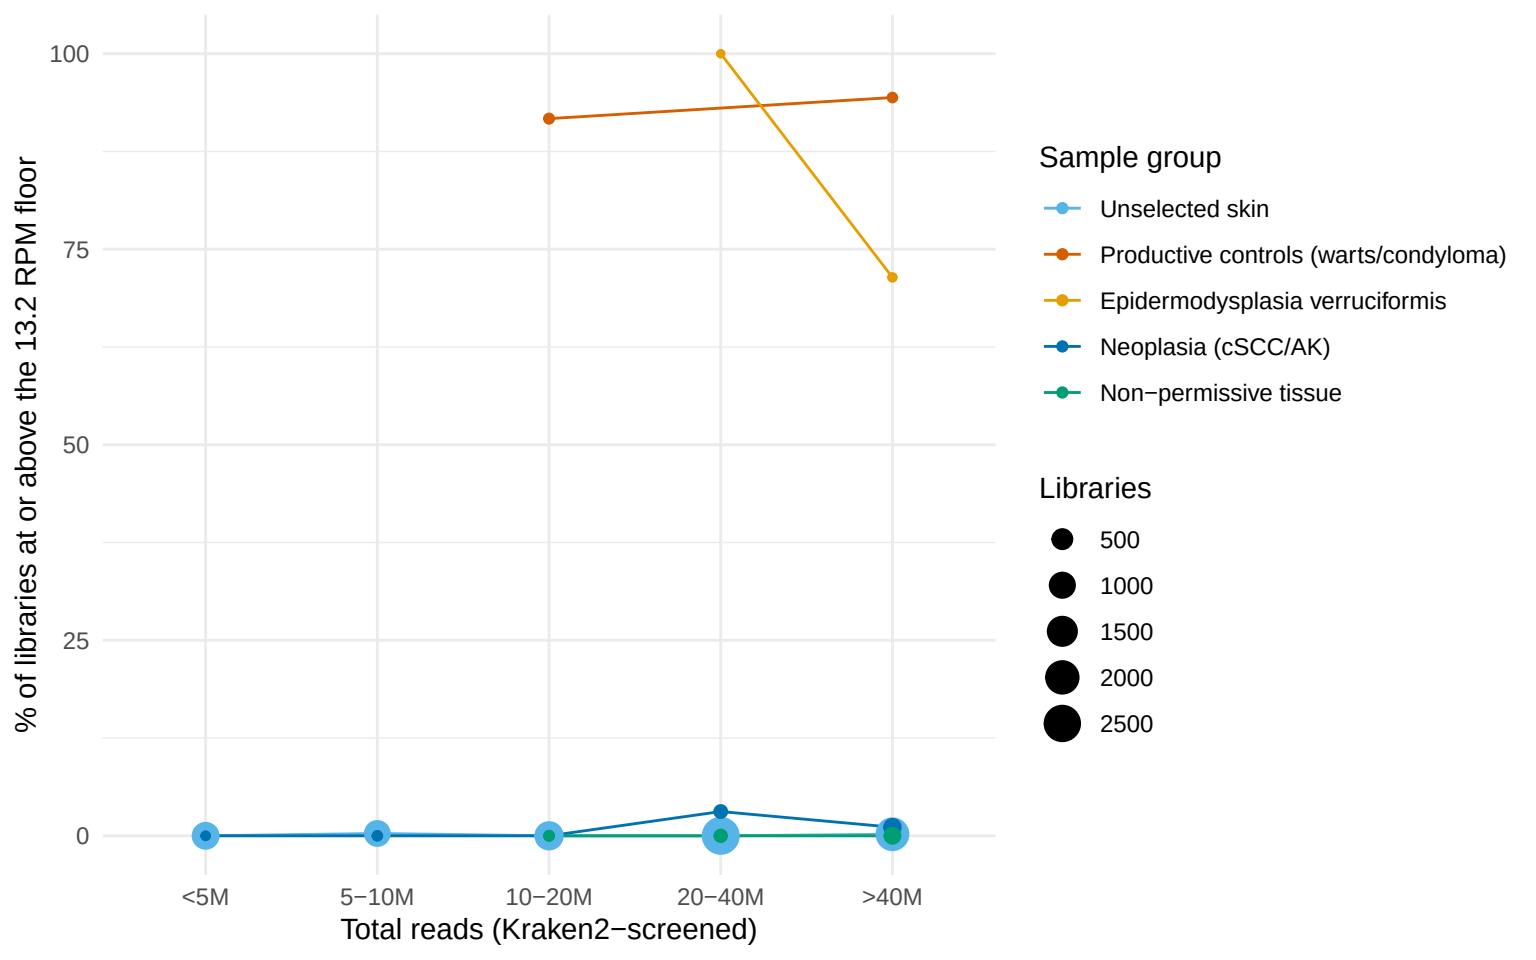
100
75
50
25
0
% of libraries at or above the 13.2 RPM floor
<5M
5−10M
10−20M
20−40M
>40M
Total reads (Kraken2−screened)
Sample group
Unselected skin
Productive controls (warts/condyloma)
Epidermodysplasia verruciformis
Neoplasia (cSCC/AK)
Non−permissive tissue
Libraries
500
1000
1500
2000
2500