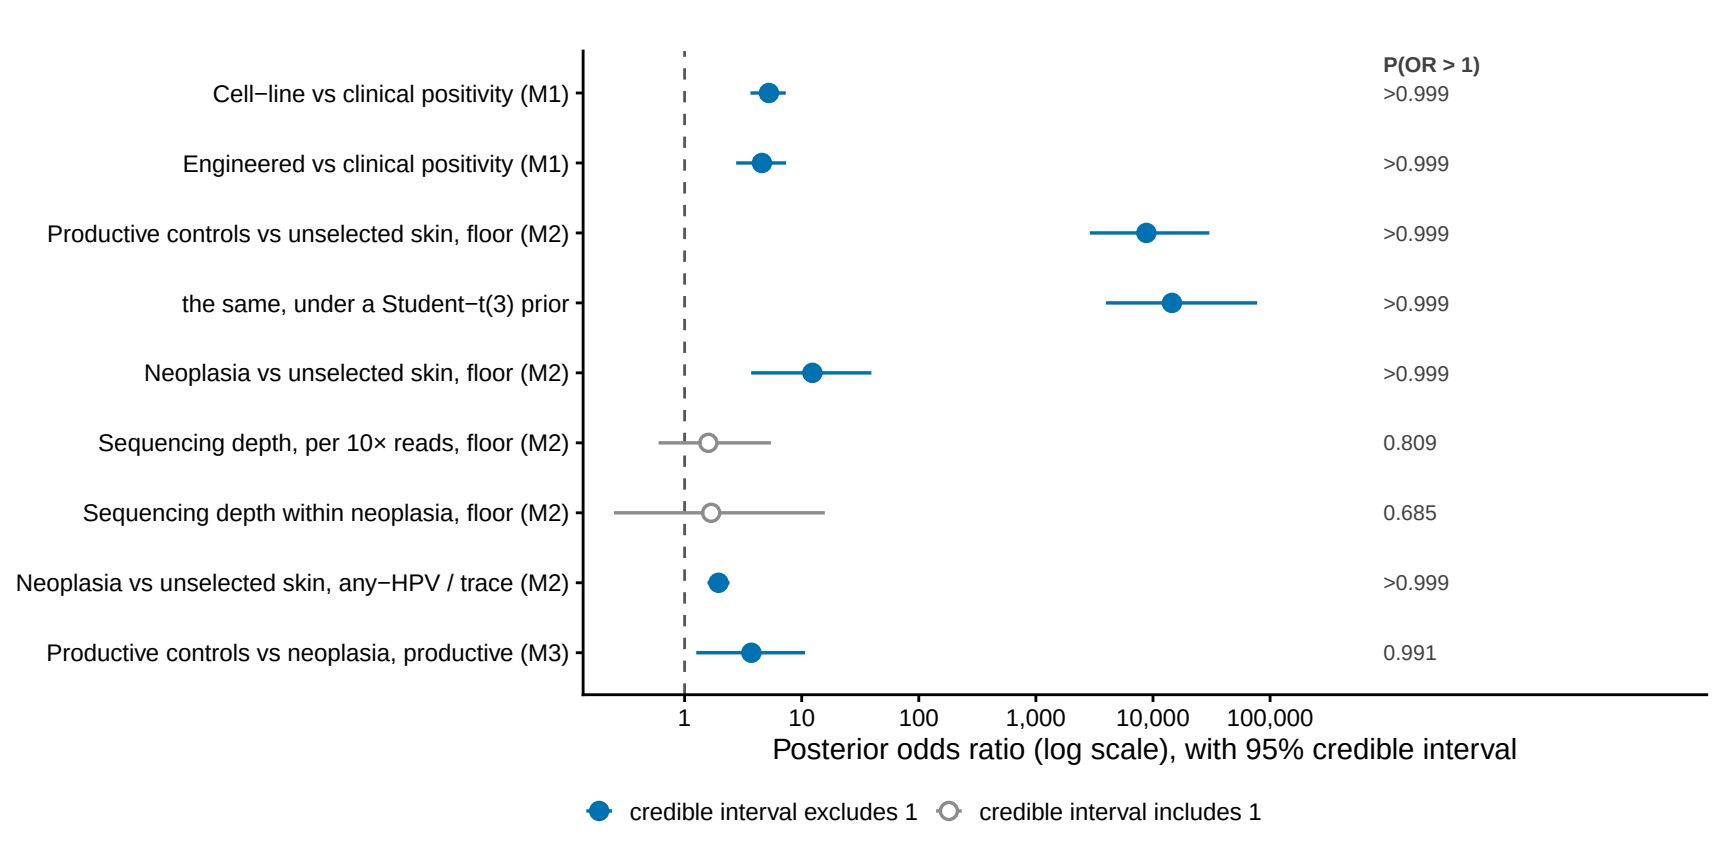
P(OR > 1)
Cell−line vs clinical positivity (M1)
>0.999
Engineered vs clinical positivity (M1)
>0.999
Productive controls vs unselected skin, floor (M2)
>0.999
the same, under a Student−t(3) prior
>0.999
Neoplasia vs unselected skin, floor (M2)
>0.999
Sequencing depth, per 10× reads, floor (M2)
0.809
Sequencing depth within neoplasia, floor (M2)
0.685
Neoplasia vs unselected skin, any−HPV / trace (M2)
>0.999
Productive controls vs neoplasia, productive (M3)
0.991
1
10
100
1,000
10,000
100,000
Posterior odds ratio (log scale), with 95% credible interval
credible interval excludes 1
credible interval includes 1