Manual S Compliance Report
AHU - 1
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

Digitally signed by Dana Mejia
Date: 2025.08.04 10:49:02 -04'00'
CAC1821635 ProCalcs, LLC

REVIEWED
By Tim Malata at 9:24 am, Aug 04, 2025
APPROVED
By Richard at 9:54 am, Aug 04, 2025

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

Project Information

For: Scott Residence
15 Stuyvesant Rd, Biltmore Forest, NC 28803

Cooling Equipment

Design Conditions

Outdoor design DB:	84.2°F	Sensible gain:	35311	Btuh		Entering coil DB:	75.4°F
Outdoor design WB:	69.8°F	Latent gain:	5597	Btuh		Entering coil WB:	62.8°F
Indoor design DB:	75.0°F	Total gain:	40908	Btuh			
Indoor RH:	50%	Estimated airflow:	1678	cfm			

Manufacturer's Performance Data at Actual Design Conditions

Equipment type:	Split ASHP				
Manufacturer:	Bosch Thermotechnol		Model:	BOVA-60RTB-M20S+BIVA-60RCB-M20X	
Actual airflow:	1678	cfm			
Sensible capacity:	38192	Btuh	108% of load		
Latent capacity:	8174	Btuh	146% of load		
Total capacity:	46366	Btuh	113% of load	SHR:	82%

Heating Equipment

Design Conditions

Outdoor design DB:	17.2°F	Heat loss:	39519	Btuh		Entering coil DB:	67.5°F
Indoor design DB:	70.0°F						

Manufacturer's Performance Data at Actual Design Conditions

Equipment type:	Split ASHP						
Manufacturer:	Bosch Thermotechnol		Model:	BOVA-60RTB-M20S+BIVA-60RCB-M20X			
Actual airflow:	1678	cfm					
Output capacity:	41568	Btuh	105% of load			Capacity balance:	3.6 °F
Supplemental heat required:	0	Btuh				Economic balance:	-99 °F

Backup equipment type:	Elec strip				
Manufacturer:	BOSCH		Model:	EHK-10B	
Actual airflow:	1678	cfm			
Output capacity:	10.0	kW	86% of load	Temp. rise:	20 °F

Meets all requirements of ACCA Manual S.

Manual S Compliance Report
AHU - 2
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

Project Information

For: Scott Residence
15 Stuyvesant Rd, Biltmore Forest, NC 28803

Cooling Equipment

Design Conditions

Outdoor design DB:	84.2°F	Sensible gain:	34139	Btuh		Entering coil DB:	75.5°F
Outdoor design WB:	69.8°F	Latent gain:	3233	Btuh		Entering coil WB:	62.7°F
Indoor design DB:	75.0°F	Total gain:	37372	Btuh			
Indoor RH:	50%	Estimated airflow:	1649	cfm			

Manufacturer's Performance Data at Actual Design Conditions

Equipment type:	Split ASHP				
Manufacturer:	Bosch Thermotechnol		Model:	BOVA-60RTB-M20S+BIVA-60RCB-M20X	
Actual airflow:	1649	cfm			
Sensible capacity:	39313	Btuh	115% of load		
Latent capacity:	7053	Btuh	218% of load		
Total capacity:	46366	Btuh	124% of load	SHR:	85%

Heating Equipment

Design Conditions

Outdoor design DB:	17.2°F	Heat loss:	56481	Btuh		Entering coil DB:	67.0°F
Indoor design DB:	70.0°F						

Manufacturer's Performance Data at Actual Design Conditions

Equipment type:	Split ASHP						
Manufacturer:	Bosch Thermotechnol		Model:	BOVA-60RTB-M20S+BIVA-60RCB-M20X			
Actual airflow:	1649	cfm					
Output capacity:	41568	Btuh	74% of load			Capacity balance:	17 °F
Supplemental heat required:	14913	Btuh				Economic balance:	-99 °F

Backup equipment type:	Elec strip				
Manufacturer:	BOSCH		Model:	EHK-10B	
Actual airflow:	1649	cfm			
Output capacity:	10.0	kW	60% of load	Temp. rise:	22 °F

Meets all requirements of ACCA Manual S.

Building Analysis
AHU - 1
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

Project Information

For: Scott Residence
15 Stuyvesant Rd, Biltmore Forest, NC 28803

Design Conditions

Location:
Asheville 8 Ssw, NC, US
Elevation: 2151 ft
Latitude: 35°N

Outdoor:	**Heating**	**Cooling**
Dry bulb (°F)	17	84
Daily range (°F)	-	20 (M)
Wet bulb (°F)	-	70
Wind speed (mph)	15.0	7.5

Indoor:	**Heating**	**Cooling**
Indoor temperature (°F)	70	75
Design TD (°F)	53	9
Relative humidity (%)	50	50
Moisture difference (gr/lb)	47.9	25.5

Infiltration:

Method	Blower door
Shielding / stories	3 (partial) / 2
Pressure /ACH /AVF	50 Pa / 3.0 / 3669 cfm

Heating

Component	Btuh/ft²	Btuh	% of load
Walls	3.4	5517	14.0
Glazing	15.3	16871	42.7
Doors	4.6	112	0.3
Ceilings	1.9	463	1.2
Floors	1.3	3300	8.3
Infiltration	3.4	7739	19.6
Ducts		1661	4.2
Piping		0	0
Humidification		0	0
Ventilation		3857	9.8
Adjustments		0	
Total		**39519**	**100.0**

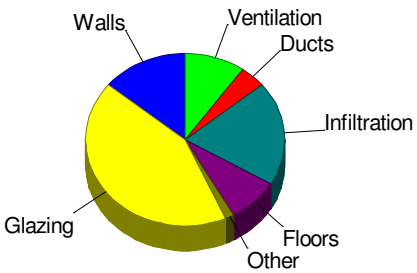

Cooling

Component	Btuh/ft²	Btuh	% of load
Walls	0.6	988	2.8
Glazing	24.4	26901	76.2
Doors	1.8	43	0.1
Ceilings	0.5	112	0.3
Floors	0.2	575	1.6
Infiltration	0.3	627	1.8
Ducts		613	1.7
Ventilation		672	1.9
Internal gains		4780	13.5
Blower		0	0
Adjustments		0	
Total		**35311**	**100.0**

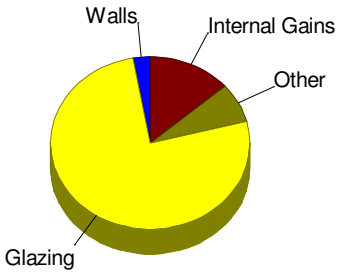

Latent Cooling Load = 5597 Btuh
Overall U-value = 0.228 Btuh/ft²-°F, Window / Floor Area = 41.1 %

WARNING: window to floor area ratio = 41.1% - more than 25%.

Building Analysis
AHU - 2
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

Project Information

For: Scott Residence
15 Stuyvesant Rd, Biltmore Forest, NC 28803

Design Conditions

Location:
Asheville 8 Ssw, NC, US
Elevation: 2151 ft
Latitude: 35°N

Outdoor:	**Heating**	**Cooling**
Dry bulb (°F)	17	84
Daily range (°F)	-	20 (M)
Wet bulb (°F)	-	70
Wind speed (mph)	15.0	7.5

Indoor:	**Heating**	**Cooling**
Indoor temperature (°F)	70	75
Design TD (°F)	53	9
Relative humidity (%)	50	50
Moisture difference (gr/lb)	47.9	25.5

Infiltration:

Method	Blower door
Shielding / stories	3 (partial) / 2
Pressure /ACH /AVF	50 Pa / 3.0 / 3669 cfm

Heating

Component	Btuh/ft²	Btuh	% of load
Walls	2.9	10862	19.2
Glazing	15.3	18793	33.3
Doors	4.6	112	0.2
Ceilings	1.9	7553	13.4
Floors	1.4	2284	4.0
Infiltration	3.4	11805	20.9
Ducts		74	0.1
Piping		0	0
Humidification		0	0
Ventilation		4998	8.8
Adjustments		0	
Total		**56481**	**100.0**

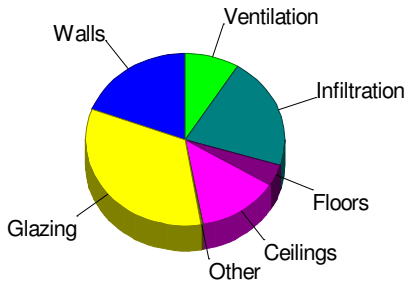

Cooling

Component	Btuh/ft²	Btuh	% of load
Walls	0.5	1814	5.3
Glazing	21.8	26718	78.3
Doors	1.8	43	0.1
Ceilings	0.5	1828	5.4
Floors	0.1	167	0.5
Infiltration	0.3	956	2.8
Ducts		41	0.1
Ventilation		871	2.6
Internal gains		1700	5.0
Blower		0	0
Adjustments		0	
Total		**34139**	**100.0**

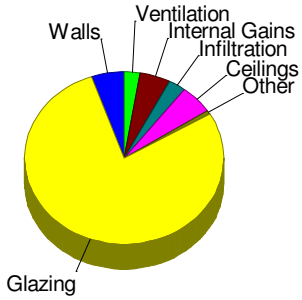

Latent Cooling Load = 3233 Btuh
Overall U-value = 0.206 Btuh/ft²-°F, Window / Floor Area = 25.5 %

WARNING: window to floor area ratio = 25.5% - more than 25%.

Load Short Form
AHU - 1
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

Project Information

For: Scott Residence
15 Stuyvesant Rd, Biltmore Forest, NC 28803

Design Information

	Htg	Clg
Outside db (°F)	17	84
Inside db (°F)	70	75
Design TD (°F)	53	9
Daily range	-	M
Inside humidity (%)	50	50
Moisture difference (gr/lb)	48	26

Infiltration

Method	Blower door
Shielding / stories	3 (partial) / 2
Pressure /ACH /AVF	50 Pa / 3.0 / 3669 cfm

HEATING EQUIPMENT

Make	Bosch Thermotechnology Corp.
Trade	BOSCH
Model	BOVA-60RTB-M20S
AHRI ref	214771733

Efficiency	9.5 HSPF2	
Heating input		
Heating output	55000	Btuh @ 47°F
Temperature rise	32	°F
Actual air flow	1678	cfm
Air flow factor	0.047	cfm/Btuh
Static pressure	0.70	in H2O
Space thermostat		
Capacity balance point = 4 °F		

Backup: BOSCH EHK-10B
Input = 10 kW, Output = 34121 Btuh, 100 AFUE

COOLING EQUIPMENT

Make	Bosch Thermotechnology Corp.
Trade	BOSCH
Cond	BOVA-60RTB-M20S
Coil	BIVA-60RCB-M20X
AHRI ref	214771733

Efficiency	11.7 EER2, 18 SEER2	
Sensible cooling	44720	Btuh
Latent cooling	7280	Btuh
Total cooling	52000	Btuh
Actual air flow	1678	cfm
Air flow factor	0.048	cfm/Btuh
Static pressure	0.70	in H2O
Load sensible heat ratio	0.86	

ROOM NAME	Area (ft²)	Htg load (Btuh)	Clg load (Btuh)	Htg AVF (cfm)	Clg AVF (cfm)
BREAKFAST	267	4784	3563	225	173
DINING	270	775	108	36	5
FOYER	170	4014	3495	189	169
HALL	104	5110	4154	240	201
HALL 1	94	0	0	0	0
HALL 2	159	0	0	0	0
KITCHEN	264	443	2011	21	97
LAUNDRY 1	136	2592	1421	122	69
LIVING	415	8709	8943	410	433
MUDROOM	144	689	87	32	4
ORANGERY	274	6613	10067	311	488
PWDR 1	38	473	29	22	1
SCULLERY	149	1461	761	69	37
STAIRS 1	99	0	0	0	0

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

STAIRS 2	99	0	0	0	0
AHU - 1	2682	35662	34639	1678	1678
Other equip loads		3857	672		
Equip. @ 1.00 RSM			35311		
Latent cooling			5597		
TOTALS	2682	39519	40908	1678	1678

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Load Short Form
AHU - 2
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

Project Information

For: Scott Residence
15 Stuyvesant Rd, Biltmore Forest, NC 28803

Design Information

	Htg	Clg
Outside db (°F)	17	84
Inside db (°F)	70	75
Design TD (°F)	53	9
Daily range	-	M
Inside humidity (%)	50	50
Moisture difference (gr/lb)	48	26

Infiltration

Method	Blower door
Shielding / stories	3 (partial) / 2
Pressure /ACH /AVF	50 Pa / 3.0 / 3669 cfm

HEATING EQUIPMENT

Make	Bosch Thermotechnology Corp.
Trade	BOSCH
Model	BOVA-60RTB-M20S
AHRI ref	214771733

Efficiency	9.5 HSPF2	
Heating input		
Heating output	55000	Btuh @ 47°F
Temperature rise	33	°F
Actual air flow	1649	cfm
Air flow factor	0.032	cfm/Btuh
Static pressure	0.80	in H2O
Space thermostat		
Capacity balance point = 17 °F		

Backup: BOSCH EHK-10B
Input = 10 kW, Output = 34121 Btuh, 100 AFUE

COOLING EQUIPMENT

Make	Bosch Thermotechnology Corp.
Trade	BOSCH
Cond	BOVA-60RTB-M20S
Coil	BIVA-60RCB-M20X
AHRI ref	214771733

Efficiency	11.7 EER2, 18 SEER2	
Sensible cooling	47320	Btuh
Latent cooling	4680	Btuh
Total cooling	52000	Btuh
Actual air flow	1649	cfm
Air flow factor	0.050	cfm/Btuh
Static pressure	0.80	in H2O
Load sensible heat ratio	0.91	

ROOM NAME	Area (ft²)	Htg load (Btuh)	Clg load (Btuh)	Htg AVF (cfm)	Clg AVF (cfm)
ZONE 2A	1735	16436	10821	526	536
ZONE 2B	3072	35047	29535	1123	1464
AHU - 2	4806	51483	33268	1649	1649
Other equip loads		4998	871		
Equip. @ 1.00 RSM			34139		
Latent cooling			3233		
TOTALS	4806	56481	37372	1649	1649

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Load Short Form
ZONE 2A
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

Project Information

For: Scott Residence
15 Stuyvesant Rd, Biltmore Forest, NC 28803

Design Information

	Htg	Clg
Outside db (°F)	17	84
Inside db (°F)	70	75
Design TD (°F)	53	9
Daily range	-	M
Inside humidity (%)	50	50
Moisture difference (gr/lb)	48	26

Infiltration

Method	Blower door
Shielding / stories	3 (partial) / 2
Pressure /ACH /AVF	50 Pa / 3.0 / 3669 cfm

HEATING EQUIPMENT

Make	n/a		
Trade	n/a		
Model	n/a		
AHRI ref	n/a		
Efficiency		n/a	
Heating input			
Heating output		0	Btuh
Temperature rise		0	°F
Actual air flow		0	cfm
Air flow factor		0	cfm/Btuh
Static pressure		0	in H2O
Space thermostat	n/a		

COOLING EQUIPMENT

Make	n/a		
Trade	n/a		
Cond	n/a		
Coil	n/a		
AHRI ref	n/a		
Efficiency		n/a	
Sensible cooling		0	Btuh
Latent cooling		0	Btuh
Total cooling		0	Btuh
Actual air flow		0	cfm
Air flow factor		0	cfm/Btuh
Static pressure		0	in H2O
Load sensible heat ratio		0	

ROOM NAME	Area (ft²)	Htg load (Btuh)	Clg load (Btuh)	Htg AVF (cfm)	Clg AVF (cfm)
LESLIE CLOS	135	1287	259	41	13
P BATH	162	2694	1531	86	76
P HALL	49	0	0	0	0
P TLT	47	555	75	18	4
PRIMARY BED	315	4711	3676	151	182
ROB CLOS	44	92	18	3	1
STUDY	142	1880	2246	60	111
B BATH	188	1077	3	35	0
B STORAGE	88	372	0	12	0
BASEMENT	533	3730	3006	119	149
PWDR 2	33	38	7	1	0

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

ZONE 2A Other equip loads Equip. @ 1.00 RSM Latent cooling	1735	16436 0	10821 0 10821 536	526	536
TOTALS	1735	16436	11357	526	536

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Load Short Form
ZONE 2B
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

Project Information

For: Scott Residence
15 Stuyvesant Rd, Biltmore Forest, NC 28803

Design Information

	Htg	Clg
Outside db (°F)	17	84
Inside db (°F)	70	75
Design TD (°F)	53	9
Daily range	-	M
Inside humidity (%)	50	50
Moisture difference (gr/lb)	48	26

Infiltration

Method	Blower door
Shielding / stories	3 (partial) / 2
Pressure /ACH /AVF	50 Pa / 3.0 / 3669 cfm

HEATING EQUIPMENT

Make	n/a		
Trade	n/a		
Model	n/a		
AHRI ref	n/a		
Efficiency		n/a	
Heating input			
Heating output		0	Btuh
Temperature rise		0	°F
Actual air flow		0	cfm
Air flow factor		0	cfm/Btuh
Static pressure		0	in H2O
Space thermostat	n/a		

COOLING EQUIPMENT

Make	n/a		
Trade	n/a		
Cond	n/a		
Coil	n/a		
AHRI ref	n/a		
Efficiency		n/a	
Sensible cooling		0	Btuh
Latent cooling		0	Btuh
Total cooling		0	Btuh
Actual air flow		0	cfm
Air flow factor		0	cfm/Btuh
Static pressure		0	in H2O
Load sensible heat ratio		0	

ROOM NAME	Area (ft²)	Htg load (Btuh)	Clg load (Btuh)	Htg AVF (cfm)	Clg AVF (cfm)
2F HALL	144	3233	3204	104	159
2F STAIRS 1	142	0	0	0	0
2F STAIRS 2	110	0	0	0	0
BUNK ROOM	174	3114	1115	100	55
GRAHAM BATH	89	933	131	30	7
GRAHAM BED	210	2855	3228	91	160
GRAHAM CLOS	44	109	22	3	1
GRAHAM VEST	55	0	0	0	0
GUEST BATH	76	661	129	21	6
GUEST BED	203	2022	1955	65	97
GUEST CLOS	52	1019	174	33	9
LAUNDRY2	90	2919	2427	93	120
SHARED BATH	70	1560	442	50	22
UTIL	58	117	24	4	1

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

VIEW RM	1133	13355	14578	428	723
WELL BATH	85	963	552	31	27
WELL BED	206	2020	1511	65	75
WELL CLOS	44	167	42	5	2
WELL VEST	87	0	0	0	0
ZONE 2B	3072	35047	29535	1123	1464
Other equip loads		0	0		
Equip. @ 1.00 RSM			29535		
Latent cooling			1204		
TOTALS	3072	35047	30739	1123	1464

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Component Constructions
AHU - 1
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

Project Information

For: Scott Residence
15 Stuyvesant Rd, Biltmore Forest, NC 28803

Design Conditions

Location:
Asheville 8 Ssw, NC, US
Elevation: 2151 ft
Latitude: 35°N

Outdoor:	**Heating**	**Cooling**
Dry bulb (°F)	17	84
Daily range (°F)	-	20 (M)
Wet bulb (°F)	-	70
Wind speed (mph)	15.0	7.5

Indoor:	**Heating**	**Cooling**
Indoor temperature (°F)	70	75
Design TD (°F)	53	9
Relative humidity (%)	50	50
Moisture difference (gr/lb)	47.9	25.5

Infiltration:

Method	Blower door
Shielding / stories	3 (partial) / 2
Pressure /ACH /AVF	50 Pa / 3.0 / 3669 cfm

Construction descriptions	**Or**	**Area** ft²	**U-value** Btuh/ft²-°F	**Insul R** ft²-°F/Btuh	**Htg HTM** Btuh/ft²	**Loss** Btuh	**Clg HTM** Btuh/ft²	**Gain** Btuh
Walls								
Frame Wall 2 x 6, R-19	n	154	0.064	19.0	3.38	520	0.73	113
	e	595	0.064	19.0	3.38	2010	0.73	436
	s	198	0.064	19.0	3.38	669	0.73	145
	sw	18	0.064	19.0	3.38	62	0.73	13
	w	262	0.064	19.0	3.38	887	0.73	192
	nw	17	0.064	19.0	3.38	59	0.73	13
	all	1245	0.064	19.0	3.38	4207	0.73	912
Partitions								
Frame Wall 2 x 6, R-19		388	0.064	19.0	3.38	1310	0.20	76
Windows								
Double Pane, Low-E, Alum: Double Pane, Low-E, Alum; NFRC rated (SHGC=0.24); 50% blinds 45°, medium; foreground = green grass (0.23); 2 ft overhang (6 ft window ht, 0 ft sep.); 9 ft head ht	e	30	0.290	0	15.3	459	20.2	605
	e	36	0.290	0	15.3	551	20.2	726
	all	66	0.290	0	15.3	1011	20.2	1331
Double Pane, Low-E, Alum: Double Pane, Low-E, Alum; NFRC rated (SHGC=0.24); 50% blinds 45°, medium; foreground = green grass (0.23); 2 ft overhang (9 ft window ht, 19 ft sep.); 9 ft head ht	e	108	0.290	0	15.3	1654	24.6	2658
Double Pane, Low-E, Alum: Double Pane, Low-E, Alum; NFRC rated (SHGC=0.24); 50% blinds 45°, medium; foreground = new concrete (0.32); 6 ft overhang (12 ft window ht, 0 ft sep.); 9 ft head ht	e	18	0.290	0	15.3	276	25.9	467
	e	90	0.290	0	15.3	1378	25.9	2335
	all	108	0.290	0	15.3	1654	25.9	2802
Double Pane, Low-E, Alum FD: Double Pane, Low-E, Alum FD; NFRC rated (SHGC=0.24); 50% blinds 45°, medium; foreground = new concrete (0.32); 6 ft overhang (12 ft window ht, 0 ft sep.); 9 ft head ht	e	48	0.290	0	15.3	735	21.2	1016
Double Pane, Low-E, Alum SGD: Double Pane, Low-E, Alum SGD; NFRC rated (SHGC=0.24); 50% blinds 45°, medium; 24 ft overhang (9 ft window ht, 0 ft sep.); 9 ft head ht	s	99	0.290	0	15.3	1516	6.34	627
Double Pane, Low-E, Alum: Double Pane, Low-E, Alum; NFRC rated (SHGC=0.24); 50% blinds 45°, medium; foreground = green grass (0.23); 2 ft overhang (12 ft window ht, 17 ft sep.); 12 ft head ht	sw	36	0.290	0	15.3	551	20.4	733
	nw	37	0.290	0	15.3	567	17.7	655
	all	73	0.290	0	15.3	1118	19.0	1388
Double Pane, Low-E, Alum: Double Pane, Low-E, Alum; NFRC rated (SHGC=0.24); 50% blinds 45°, medium; 18 ft overhang (9 ft window ht, 0 ft sep.); 9 ft head ht	w	135	0.290	0	15.3	2067	6.34	856

Double Pane, Low-E, Alum: Double Pane, Low-E, Alum; NFRC rated (SHGC=0.24); 50% blinds 45°, medium; foreground = green grass (0.23); 12 ft head ht	w	189	0.290	0	15.3	2894	24.6	4652
Double Pane, Low-E, Alum: Double Pane, Low-E, Alum; NFRC rated (SHGC=0.24); 50% blinds 45°, medium; foreground = green grass (0.23); 2 ft overhang (12 ft window ht, 21 ft sep.); 12 ft head ht	w	132	0.290	0	15.3	2021	24.6	3249
Double Pane, Low-E, Alum FD: Double Pane, Low-E, Alum FD; NFRC rated (SHGC=0.24); 50% blinds 45°, medium; 18 ft overhang (9 ft window ht, 0 ft sep.); 9 ft head ht	w	32	0.290	0	15.3	482	4.44	140
Double Pane, Low-E, Alum FD: Double Pane, Low-E, Alum FD; NFRC rated (SHGC=0.24); 50% blinds 45°, medium; 18 ft overhang (9 ft window ht, 2 ft sep.); 9 ft head ht	w	32	0.290	0	15.3	482	4.44	140
Double Pane, Low-E, Alum	s	81	0.290	0	15.3	1237	53.9	4356
Doors								
Metal Insulated Door	n	24	0.088	0	4.65	112	1.81	43
Ceilings								
Encapsulated Tile Roof, R-38		248	0.386	38.0	1.87	463	0.45	112
Floors								
Floor Over Crawlspace, R-10		2618	0.291	10.0	1.26	3300	0.22	575

Component Constructions
AHU - 2
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

Project Information

For: Scott Residence
15 Stuyvesant Rd, Biltmore Forest, NC 28803

Design Conditions

Location:
Asheville 8 Ssw, NC, US
Elevation: 2151 ft
Latitude: 35°N

Outdoor:	**Heating**	**Cooling**
Dry bulb (°F)	17	84
Daily range (°F)	-	20 (M)
Wet bulb (°F)	-	70
Wind speed (mph)	15.0	7.5

Indoor:	**Heating**	**Cooling**
Indoor temperature (°F)	70	75
Design TD (°F)	53	9
Relative humidity (%)	50	50
Moisture difference (gr/lb)	47.9	25.5

Infiltration:

Method	Blower door
Shielding / stories	3 (partial) / 2
Pressure /ACH /AVF	50 Pa / 3.0 / 3669 cfm

Construction descriptions	**Or**	**Area** ft²	**U-value** Btuh/ft²-°F	**Insul R** ft²-°F/Btuh	**Htg HTM** Btuh/ft²	**Loss** Btuh	**Clg HTM** Btuh/ft²	**Gain** Btuh
Walls								
Basement Wall, R-10	n	456	0.022	10.0	1.17	532	0	0
	e	156	0.022	10.0	-1.0	-149	0	0
	s	18	0.022	10.0	1.17	20	0	0
	w	176	0.022	10.0	1.17	205	0	0
	all	806	0.022	10.0	0.76	609	0	0
Frame Wall 2 x 6, R-19	n	743	0.064	19.0	3.38	2512	0.73	545
	e	708	0.064	19.0	3.38	2393	0.73	519
	s	413	0.064	19.0	3.38	1397	0.73	303
	sw	9	0.064	19.0	3.38	31	0.73	7
	w	440	0.064	19.0	3.38	1488	0.73	323
	nw	10	0.064	19.0	3.38	34	0.73	7
	all	2324	0.064	19.0	3.38	7855	0.73	1703
Partitions								
Basement Wall, R-10		117	0.022	10.0	4.64	542	0.03	4
Frame Wall 2 x 6, R-19		549	0.064	19.0	3.38	1856	0.20	107
Windows								
Double Pane, Low-E, Alum: Double Pane, Low-E, Alum; NFRC rated (SHGC=0.24); 50% blinds 45°, medium; 2 ft overhang (6 ft window ht, 0 ft sep.); 9 ft head ht	n	24	0.290	0	15.3	367	6.34	152
	n	22	0.290	0	15.3	345	6.34	143
	w	66	0.290	0	15.3	1011	18.2	1199
	w	60	0.290	0	15.3	919	18.2	1090
	all	172	0.290	0	15.3	2641	15.0	2583
Double Pane, Low-E, Alum: Double Pane, Low-E, Alum; NFRC rated (SHGC=0.24); 50% blinds 45°, medium; 2.5 ft overhang (6 ft window ht, 13 ft sep.); 9 ft head ht	n	16	0.290	0	15.3	245	6.34	101
Double Pane, Low-E, Alum: Double Pane, Low-E, Alum; NFRC rated (SHGC=0.24); 50% blinds 45°, medium; foreground = green grass (0.23); 2 ft overhang (6 ft window ht, 0 ft sep.); 9 ft head ht	n	12	0.290	0	15.3	184	6.34	76
	n	30	0.290	0	15.3	459	6.34	190
	e	54	0.290	0	15.3	827	20.2	1089
	all	96	0.290	0	15.3	1470	14.1	1355
Double Pane, Low-E, Alum: Double Pane, Low-E, Alum; NFRC rated (SHGC=0.24); 50% blinds 45°, medium; foreground = new concrete (0.32); 3 ft overhang (8.67 ft window ht, 0 ft sep.); 8.67 ft head ht	e	95	0.290	0	15.3	1460	28.0	2670

Double Pane, Low-E, Alum: Double Pane, Low-E, Alum; NFRC rated (SHGC=0.24); 50% blinds 45°, medium; 2 ft overhang (6.5 ft window ht, 0 ft sep.); 9 ft head ht	e	39	0.290	0	15.3	597	18.5	722
	e	55	0.290	0	15.3	846	18.5	1023
	all	94	0.290	0	15.3	1443	18.5	1744
Double Pane, Low-E, Alum: Double Pane, Low-E, Alum; NFRC rated (SHGC=0.24); 50% blinds 45°, medium; 2 ft overhang (8 ft window ht, 12 ft sep.); 9 ft head ht	e	56	0.290	0	15.3	857	22.6	1266
	e	96	0.290	0	15.3	1470	22.6	2171
	all	152	0.290	0	15.3	2327	22.6	3437
Double Pane, Low-E, Alum: Double Pane, Low-E, Alum; NFRC rated (SHGC=0.24); 50% blinds 45°, medium; 2 ft overhang (5 ft window ht, 1.13 ft sep.); 8 ft head ht	s	80	0.290	0	15.3	1225	6.34	507
Double Pane, Low-E, Alum: Double Pane, Low-E, Alum; NFRC rated (SHGC=0.24); 50% blinds 45°, medium; 2 ft overhang (5 ft window ht, 6 ft sep.); 8 ft head ht	s	20	0.290	0	15.3	306	8.95	179
Double Pane, Low-E, Alum: Double Pane, Low-E, Alum; NFRC rated (SHGC=0.24); 50% blinds 45°, medium; 2 ft overhang (9 ft window ht, 12 ft sep.); 9 ft head ht	sw	28	0.290	0	15.3	425	18.4	509
	w	99	0.290	0	15.3	1516	22.6	2239
	w	198	0.290	0	15.3	3032	22.6	4477
	nw	27	0.290	0	15.3	413	15.7	424
	all	352	0.290	0	15.3	5386	21.7	7650
Double Pane, Low-E, Alum: Double Pane, Low-E, Alum; NFRC rated (SHGC=0.24); 50% blinds 45°, medium; foreground = green grass (0.23); 2 ft overhang (5.5 ft window ht, 0 ft sep.); 8.5 ft head ht	w	50	0.290	0	15.3	758	19.8	978
Double Pane, Low-E, Alum: Double Pane, Low-E, Alum; NFRC rated (SHGC=0.24); 50% blinds 45°, medium; foreground = green grass (0.23); 2 ft overhang (10 ft window ht, 0 ft sep.); 10 ft head ht	w	40	0.290	0	15.3	612	21.9	878
Double Pane, Low-E, Alum FD: Double Pane, Low-E, Alum FD; NFRC rated (SHGC=0.24); 50% blinds 45°, medium; foreground = green grass (0.23); 2 ft overhang (10 ft window ht, 0 ft sep.); 10 ft head ht	w	60	0.290	0	15.3	919	16.0	958

Doors

Metal Insulated Door	n	24	0.088	0	4.65	112	1.81	43

Ceilings

Encapsulated Tile Roof, R-38		4046	0.386	38.0	1.87	7553	0.45	1828

Floors

Floor Over Ambient, R-19		410	0.054	19.0	2.84	1167	0.22	90
Floor Over Crawlspace, R-10		137	0.291	10.0	1.26	173	0.22	30
Floor Over Garage, R-19		218	0.054	19.0	1.42	310	0.22	48
Slab Below Grade R-10		808	0.014	10.0	0.74	600	0	0
Slab On Grade, R-10		8	0.085	10.0	4.49	34	0	0

Project Summary
AHU - 1
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

Project Information

For: Scott Residence
15 Stuyvesant Rd, Biltmore Forest, NC 28803

Notes: Carlton Edwards
PO BOX 7466
Asheville, NC 28802

Design Information

Weather: Asheville 8 Ssw, NC, US

Winter Design Conditions

Outside db	17	°F
Inside db	70	°F
Design TD	53	°F
Ventilation Method	ASHRAE 62.2-2010	

Summer Design Conditions

Outside db	84	°F
Inside db	75	°F
Design TD	9	°F
Daily range	M	
Relative humidity	50	%
Moisture difference	26	gr/lb

Heating Summary

Structure	34001	Btuh
Ducts (R-6.0)	1661	Btuh
Central vent (72 cfm)	3857	Btuh
Outside air		
Humidification	0	Btuh
Piping	0	Btuh
Equipment load	39519	Btuh

Sensible Cooling Equipment Load Sizing

Structure	34026	Btuh
Ducts (R-6.0)	613	Btuh
Central vent (72 cfm)	672	Btuh
Outside air		
Blower	0	Btuh
Use manufacturer's data	y	
Rate/swing multiplier	1.00	
Equipment sensible load	35311	Btuh

Infiltration

Method	Blower door
Shielding / stories	3 (partial) / 2
Pressure /ACH /AVF	50 Pa / 3.0 / 3669 cfm

	Heating	Cooling
Area (ft²)	2682	2682
Volume (ft³)	35864	35864
Air changes/hour	0.24	0.11
Equiv. AVF (cfm)	144	67

Latent Cooling Equipment Load Sizing

Structure	2274	Btuh
Ducts	2171	Btuh
Central vent (72 cfm)	1152	Btuh
Outside air		
Equipment latent load	5597	Btuh
Equipment Total Load (Sen+Lat)	40908	Btuh
Req. total capacity at 0.86 SHR	3.4	ton

Heating Equipment Summary

Make	Bosch Thermotechnology Corp.
Trade	BOSCH
Model	BOVA-60RTB-M20S
AHRI ref	214771733

Efficiency	9.5 HSPF2	
Heating input		
Heating output	55000	Btuh @ 47°F
Temperature rise	32	°F
Actual air flow	1678	cfm
Air flow factor	0.047	cfm/Btuh
Static pressure	0.70	in H2O

Space thermostat
Capacity balance point = 4 °F

Backup: BOSCH EHK-10B
Input = 10 kW, Output = 34121 Btuh, 100 AFUE

Cooling Equipment Summary

Make	Bosch Thermotechnology Corp.
Trade	BOSCH
Cond	BOVA-60RTB-M20S
Coil	BIVA-60RCB-M20X
AHRI ref	214771733

Efficiency	11.7 EER2, 18 SEER2	
Sensible cooling	44720	Btuh
Latent cooling	7280	Btuh
Total cooling	52000	Btuh
Actual air flow	1678	cfm
Air flow factor	0.048	cfm/Btuh
Static pressure	0.70	in H2O
Load sensible heat ratio	0.86	

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Project Summary
AHU - 2
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

Project Information

For: Scott Residence
15 Stuyvesant Rd, Biltmore Forest, NC 28803

Notes: Carlton Edwards
PO BOX 7466
Asheville, NC 28802

Design Information

Weather: Asheville 8 Ssw, NC, US

Winter Design Conditions

Outside db	17	°F
Inside db	70	°F
Design TD	53	°F
Ventilation Method	ASHRAE 62.2-2010	

Summer Design Conditions

Outside db	84	°F
Inside db	75	°F
Design TD	9	°F
Daily range	M	
Relative humidity	50	%
Moisture difference	26	gr/lb

Heating Summary

Structure	51409	Btuh
Ducts (R-6.0)	74	Btuh
Central vent (93 cfm)	4998	Btuh
Outside air		
Humidification	0	Btuh
Piping	0	Btuh
Equipment load	56481	Btuh

Sensible Cooling Equipment Load Sizing

Structure	33227	Btuh
Ducts (R-6.0)	41	Btuh
Central vent (93 cfm)	871	Btuh
Outside air		
Blower	0	Btuh
Use manufacturer's data	y	
Rate/swing multiplier	1.00	
Equipment sensible load	34139	Btuh

Infiltration

Method	Blower door
Shielding / stories	3 (partial) / 2
Pressure /ACH /AVF	50 Pa / 3.0 / 3669 cfm

	Heating	Cooling
Area (ft²)	4806	4806
Volume (ft³)	37510	37510
Air changes/hour	0.35	0.16
Equiv. AVF (cfm)	220	102

Latent Cooling Equipment Load Sizing

Structure	1639	Btuh
Ducts	101	Btuh
Central vent (93 cfm)	1493	Btuh
Outside air		
Equipment latent load	3233	Btuh
Equipment Total Load (Sen+Lat)	37372	Btuh
Req. total capacity at 0.91 SHR	3.1	ton

Heating Equipment Summary

Make	Bosch Thermotechnology Corp.
Trade	BOSCH
Model	BOVA-60RTB-M20S
AHRI ref	214771733

Efficiency	9.5 HSPF2	
Heating input		
Heating output	55000	Btuh @ 47°F
Temperature rise	33	°F
Actual air flow	1649	cfm
Air flow factor	0.032	cfm/Btuh
Static pressure	0.80	in H2O

Space thermostat
Capacity balance point = 17 °F

Backup: BOSCH EHK-10B
Input = 10 kW, Output = 34121 Btuh, 100 AFUE

Cooling Equipment Summary

Make	Bosch Thermotechnology Corp.
Trade	BOSCH
Cond	BOVA-60RTB-M20S
Coil	BIVA-60RCB-M20X
AHRI ref	214771733

Efficiency	11.7 EER2, 18 SEER2	
Sensible cooling	47320	Btuh
Latent cooling	4680	Btuh
Total cooling	52000	Btuh
Actual air flow	1649	cfm
Air flow factor	0.050	cfm/Btuh
Static pressure	0.80	in H2O
Load sensible heat ratio	0.91	

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
AHU - 1
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

1	Room name						AHU - 1				BREAKFAST			
2	Exposed wall						201.0 ft				32.0 ft			
3	Room height						13.4 ft				13.5 ft		heat/cool	
4	Room dimensions										1.0 x 267.2 ft			
5	Room area						2681.8 ft²				267.2 ft²			
	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	154	154	520	113	68	68	228	49
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	925	595	2010	436	297	189	639	138
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	30	16	459	605	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	36	20	551	726	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	24.61	108	0	1654	2658	108	0	1654	2658
	G	Double Pane, Low-E,	0.290	e	15.31	25.94	18	15	276	467	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	25.94	90	74	1378	2335	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	21.16	48	39	735	1016	0	0	0	0
	W	Basement Wall, R-10	0.088	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	297	198	669	145	68	68	228	49
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	6.34	99	198	1516	627	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	3.38	0.73	54	18	62	13	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	15.31	20.35	36	0	551	733	0	0	0	0
	W	Basement Wall, R-10	0.088	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	782	262	887	192	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	6.34	135	270	2067	856	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	24.61	189	0	2894	4652	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	24.61	132	0	2021	3249	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	4.44	32	63	482	140	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	4.44	32	63	482	140	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	nw	3.38	0.73	54	17	59	13	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	15.31	17.71	37	0	567	655	0	0	0	0
	P	Basement Wall, R-10	0.088	-	0.00	0.00	0	0	0	0	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	3.38	0.20	412	388	1310	76	0	0	0	0
	D	Metal Insulated Door	0.088	n	4.65	1.81	24	24	112	43	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	329	248	463	112	0	0	0	0
6	c) AED excursion									3687				426
	Envelope loss/gain								26262	28619			3085	3380
12	a) Infiltration								7739	627			1475	119
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				6			1380	0			0
		Appliances/other								3400				0
	Subtotal (lines 6 to 13)								34001	34026			4561	3500
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								0	0			0	0
14	Subtotal								34001	34026			4561	3500
15	Duct loads						5%	2%	1661	613	5%	2%	223	63
	Total room load								35662	34639			4784	3563
	Air required (cfm)								1678	1678			225	173

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
AHU - 1
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

		DINING	FOYER
1	Room name	DINING	FOYER
2	Exposed wall	0 ft	17.0 ft
3	Room height	13.5 ft heat/cool	13.5 ft heat/cool
4	Room dimensions	20.0 x 13.5 ft	20.0 x 8.5 ft
5	Room area	270.0 ft²	170.0 ft²

	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	Area N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	Area N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	0	0	0	0	230	74	248	54
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	24.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	25.94	0	0	0	0	18	7	276	467
	G	Double Pane, Low-E,	0.290	e	15.31	25.94	0	0	0	0	90	37	1378	2335
	G	Double Pane, Low-E,	0.290	e	15.31	21.16	0	0	0	0	48	20	735	1016
	W	Basement Wall, R-10	0.088	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	6.34	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	15.31	20.35	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	24.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	24.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	4.44	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	4.44	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	nw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	15.31	17.71	0	0	0	0	0	0	0	0
	P	Basement Wall, R-10	0.088	-	0.00	0.00	0	0	0	0	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	3.38	0.20	0	0	0	0	0	0	0	0
	D	Metal Insulated Door	0.088	n	4.65	1.81	0	0	0	0	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	0	0	0	0	0	0	0	0
6	c) AED excursion									-8				-564
	Envelope loss/gain								340	51			2848	3344
12	a) Infiltration								0	0			784	63
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	0			0
		Appliances/other								0				0
	Subtotal (lines 6 to 13)								340	51			3632	3407
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								398	55			196	26
14	Subtotal								739	106			3827	3433
15	Duct loads						5%	2%	36	2	5%	2%	187	62
	Total room load								775	108			4014	3495
	Air required (cfm)								36	5			189	169

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
AHU - 1
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

1	Room name						HALL				HALL 1			
2	Exposed wall						27.5 ft				0.5 ft			
3	Room height						13.5 ft		heat/cool		13.5 ft		heat/cool	
4	Room dimensions						23.0 x 4.5 ft				21.0 x 4.5 ft			
5	Room area						103.5 ft²				94.5 ft²			
	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	24.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	25.94	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	25.94	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	21.16	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	6.34	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	15.31	20.35	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	310	112	380	82	7	7	23	5
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	6.34	135	135	2067	856	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	24.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	24.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	4.44	32	32	482	140	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	4.44	32	32	482	140	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	nw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	15.31	17.71	0	0	0	0	0	0	0	0
	P	Basement Wall, R-10	0.088	-	0.00	0.00	0	0	0	0	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	3.38	0.20	61	61	205	12	0	0	0	0
	D	Metal Insulated Door	0.088	n	4.65	1.81	0	0	0	0	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	0	0	0	0	0	0	0	0
6	c) AED excursion									2734				-4
	Envelope loss/gain								3748	3986			142	22
12	a) Infiltration								1061	86			23	2
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	0			0
		Appliances/other								0				0
	Subtotal (lines 6 to 13)								4808	4071			165	24
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								64	9			-165	-24
14	Subtotal								4872	4081			0	0
15	Duct loads						5%	2%	238	74	5%	2%	0	0
	Total room load								5110	4154			0	0
	Air required (cfm)								240	201			0	0

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
AHU - 1
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

		HALL 2	KITCHEN
1	Room name	HALL 2	KITCHEN
2	Exposed wall	0 ft	0 ft
3	Room height	13.5 ft heat/cool	13.5 ft heat/cool
4	Room dimensions	1.0 x 159.2 ft	1.0 x 263.5 ft
5	Room area	159.2 ft²	263.5 ft²

	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	24.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	25.94	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	25.94	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	21.16	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	6.34	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	15.31	20.35	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	24.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	24.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	4.44	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	4.44	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	nw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	15.31	17.71	0	0	0	0	0	0	0	0
	P	Basement Wall, R-10	0.088	-	0.00	0.00	0	0	0	0	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	3.38	0.20	0	0	0	0	0	0	0	0
	D	Metal Insulated Door	0.088	n	4.65	1.81	0	0	0	0	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	16	16	31	7	0	0	0	0
6	c) AED excursion									-5				-325
	Envelope loss/gain								186	30			332	-267
12	a) Infiltration								0	0			0	0
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	1			230
		Appliances/other								0				2000
	Subtotal (lines 6 to 13)								186	30			332	1963
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								-186	-30			90	13
14	Subtotal								0	0			422	1976
15	Duct loads						5%	2%	0	0	5%	2%	21	36
	Total room load								0	0			443	2011
	Air required (cfm)								0	0			21	97

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
AHU - 1
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

		LAUNDRY1	LIVING
1	Room name	LAUNDRY1	LIVING
2	Exposed wall	24.5 ft	44.0 ft
3	Room height	13.5 ft heat/cool	13.5 ft heat/cool
4	Room dimensions	16.0 x 8.5 ft	1.0 x 414.8 ft
5	Room area	136.0 ft²	414.8 ft²

	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	Area (ft²) or perimeter (ft) N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	Area (ft²) or perimeter (ft) N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	0	0	0	0	20	20	68	15
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	216	180	608	132	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	36	10	551	726	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	24.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	25.94	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	25.94	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	21.16	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	0	0	0	0	230	130	441	96
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	6.34	0	0	0	0	99	99	1516	627
	W	Frame Wall 2 x 6, R-	0.064	sw	3.38	0.73	0	0	0	0	54	18	62	13
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	15.31	20.35	0	0	0	0	36	0	551	733
	W	Basement Wall, R-10	0.088	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	0	0	0	0	236	104	352	76
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	24.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	24.61	0	0	0	0	132	0	2021	3249
	G	Double Pane, Low-E,	0.290	w	15.31	4.44	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	4.44	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	nw	3.38	0.73	0	0	0	0	54	17	59	13
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	15.31	17.71	0	0	0	0	37	0	567	655
	P	Basement Wall, R-10	0.088	-	0.00	0.00	0	0	0	0	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	3.38	0.20	115	115	388	22	0	0	0	0
	D	Metal Insulated Door	0.088	n	4.65	1.81	0	0	0	0	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	8	8	15	4	16	16	29	7
6	c) AED excursion									-77				982
	Envelope loss/gain								1734	836			6189	6558
12	a) Infiltration								738	60			2032	165
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	5			1150
		Appliances/other								500				900
	Subtotal (lines 6 to 13)								2471	1396			8221	8773
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								0	0			82	12
14	Subtotal								2471	1396			8303	8785
15	Duct loads						5%	2%	121	25	5%	2%	406	158
	Total room load								2592	1421			8709	8943
	Air required (cfm)								122	69			410	433

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
AHU - 1
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

		MUDROOM	ORANGERY
1	Room name	MUDROOM	ORANGERY
2	Exposed wall	9.0 ft	24.5 ft
3	Room height	13.5 ft heat/cool	12.3 ft heat/cool
4	Room dimensions	1.0 x 144.0 ft	1.0 x 273.8 ft
5	Room area	144.0 ft²	273.8 ft²

	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	Area N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	Area N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	0	0	0	0	66	66	223	48
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	24.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	25.94	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	25.94	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	21.16	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	6.34	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	15.31	20.35	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	0	0	0	0	228	39	132	29
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	24.61	0	0	0	0	189	0	2894	4652
	G	Double Pane, Low-E,	0.290	w	15.31	24.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	4.44	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	4.44	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	nw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	15.31	17.71	0	0	0	0	0	0	0	0
	P	Basement Wall, R-10	0.088	-	0.00	0.00	0	0	0	0	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	3.38	0.20	122	98	329	19	0	0	0	0
	D	Metal Insulated Door	0.088	n	4.65	1.81	24	24	112	43	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	0	0	0	0	284	204	380	92
6	c) AED excursion									-13				556
	Envelope loss/gain								622	81			5211	9793
12	a) Infiltration								0	0			1004	81
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	0			0
		Appliances/other								0				0
	Subtotal (lines 6 to 13)								622	81			6215	9874
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								35	5			90	14
14	Subtotal								657	86			6305	9888
15	Duct loads						5%	2%	32	2	5%	2%	308	178
	Total room load								689	87			6613	10067
	Air required (cfm)								32	4			311	488

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
AHU - 1
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

		PWDR 1	SCULLERY
1	Room name	PWDR 1	SCULLERY
2	Exposed wall	8.5 ft	9.0 ft
3	Room height	13.5 ft heat/cool	13.5 ft heat/cool
4	Room dimensions	7.0 x 5.5 ft	1.0 x 148.8 ft
5	Room area	38.5 ft²	148.8 ft²

	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	Area N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	Area N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	0	0	0	0	122	92	309	67
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	0	0	0	0	30	8	459	605
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	24.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	25.94	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	25.94	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	21.16	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	6.34	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	15.31	20.35	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	24.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	24.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	4.44	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	4.44	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	nw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	15.31	17.71	0	0	0	0	0	0	0	0
	P	Basement Wall, R-10	0.088	-	0.00	0.00	0	0	0	0	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	3.38	0.20	115	115	388	22	0	0	0	0
	D	Metal Insulated Door	0.088	n	4.65	1.81	0	0	0	0	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	0	0	0	0	4	4	8	2
6	c) AED excursion									-4				5
	Envelope loss/gain								436	26			964	712
12	a) Infiltration								0	0			415	34
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	0			0
		Appliances/other								0				0
	Subtotal (lines 6 to 13)								436	26			1379	745
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								15	2			13	2
14	Subtotal								451	29			1393	747
15	Duct loads						5%	2%	22	1	5%	2%	68	13
	Total room load								473	29			1461	761
	Air required (cfm)								22	1			69	37

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
AHU - 1
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

		STAIRS 1	STAIRS 2
1	Room name	STAIRS 1	STAIRS 2
2	Exposed wall	0 ft	4.5 ft
3	Room height	13.5 ft heat/cool	13.5 ft heat/cool
4	Room dimensions	18.0 x 5.5 ft	4.5 x 22.0 ft
5	Room area	99.0 ft²	99.0 ft²

	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	Area (ft²) or perimeter (ft) N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	Area (ft²) or perimeter (ft) N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	0	0	0	0	61	61	205	45
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	24.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	25.94	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	25.94	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	21.16	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	6.34	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	15.31	20.35	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	24.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	24.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	4.44	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	4.44	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	nw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	15.31	17.71	0	0	0	0	0	0	0	0
	P	Basement Wall, R-10	0.088	-	0.00	0.00	0	0	0	0	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	3.38	0.20	0	0	0	0	0	0	0	0
	D	Metal Insulated Door	0.088	n	4.65	1.81	0	0	0	0	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	0	0	0	0	0	0	0	0
6	c) AED excursion									-3				-11
	Envelope loss/gain								125	19			299	50
12	a) Infiltration								0	0			207	17
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	0			0
		Appliances/other								0				0
	Subtotal (lines 6 to 13)								125	19			506	67
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								-125	-19			-506	-67
14	Subtotal								0	0			0	0
15	Duct loads						5%	2%	0	0	5%	2%	0	0
	Total room load								0	0			0	0
	Air required (cfm)								0	0			0	0

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
AHU - 2
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

1	Room name						AHU - 2				ZONE 2A			
2	Exposed wall						513.0 ft				236.0 ft			
3	Room height						9.8 ft				10.8 ft			
4	Room dimensions													
5	Room area						4806.5 ft²				1734.8 ft²			
	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²)		Area (ft²) or perimeter (ft)		Load (Btuh)		Area (ft²) or perimeter (ft)		Load (Btuh)	
					Heat	Cool	Gross	N/P/S	Heat	Cool	Gross	N/P/S	Heat	Cool
6	W	Basement Wall, R-10	0.088	n	1.17	0.00	456	456	532	0	456	456	532	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	848	743	2512	545	385	343	1159	251
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	24	0	367	152	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	22	0	345	143	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	15.31	6.34	16	0	245	101	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	15.31	6.34	12	0	184	76	12	0	184	76
	G	Double Pane, Low-E,	0.290	n	15.31	6.34	30	0	459	190	30	0	459	190
	W	Basement Wall, R-10	0.088	e	-0.95	0.00	252	156	-149	0	252	156	-149	0
	G	Double Pane, Low-E,	0.290	e	15.31	28.00	95	54	1460	2670	95	54	1460	2670
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	1008	708	2393	519	220	166	561	122
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	39	20	597	722	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	55	28	846	1023	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	56	0	857	1266	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	96	0	1470	2171	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	54	30	827	1089	54	30	827	1089
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	s	1.17	0.00	18	18	20	0	18	18	20	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	513	413	1397	303	50	50	170	37
	G	Double Pane, Low-E,	0.290	s	15.31	6.34	80	160	1225	507	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	8.95	20	9	306	179	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	3.38	0.73	37	9	31	7	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	15.31	18.35	28	0	425	509	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	w	1.17	0.00	176	176	205	0	176	176	205	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	1013	440	1488	323	261	112	378	82
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	66	36	1011	1199	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	60	33	919	1090	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	99	0	1516	2239	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	198	0	3032	4477	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	19.76	50	30	758	978	50	30	758	978
	G	Double Pane, Low-E,	0.290	w	15.31	21.94	40	13	612	878	40	13	612	878
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	15.96	60	20	919	958	60	20	919	958
	W	Frame Wall 2 x 6, R-	0.064	nw	3.38	0.73	37	10	34	7	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	15.31	15.71	27	0	413	424	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	P	Basement Wall, R-10	0.088	-	4.64	0.03	117	117	542	4	117	117	542	4
	P	Frame Wall 2 x 6, R-	0.064	-	3.38	0.20	573	549	1856	107	573	549	1856	107
	D	Metal Insulated Door	0.088	n	4.65	1.81	24	24	112	43	24	24	112	43
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	4046	4046	7553	1828	974	974	1818	440
6	c) AED excursion									3677				2263
	Envelope loss/gain								39604	30571			13231	10218
12	a) Infiltration								11805	956			3131	254
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	0			0
		Appliances/other								1700				300
	Subtotal (lines 6 to 13)								51409	33227			16362	10771
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								0	0			0	0
14	Subtotal								51409	33227			16362	10771
15	Duct loads						0%	0%	74	41	0%	0%	74	50
	Total room load								51483	33268			16436	10821
	Air required (cfm)								1649	1649			526	536

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
AHU - 2
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

1	Room name	ZONE 2B
2	Exposed wall	277.0 ft
3	Room height	9.2 ft
4	Room dimensions	
5	Room area	3071.8 ft²

	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	Area (ft²) or perimeter (ft) N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area or perimeter Gross	Area or perimeter N/P/S	Load Heat	Load Cool
6	W	Basement Wall, R-10	0.088	n	1.17	0.00	0	0	0	0				
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	463	400	1353	293				
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	24	0	367	152				
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	22	0	345	143				
11	G	Double Pane, Low-E,	0.290	n	15.31	6.34	16	0	245	101				
	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0				
	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0				
	W	Basement Wall, R-10	0.088	e	-0.95	0.00	0	0	0	0				
	G	Double Pane, Low-E,	0.290	e	15.31	28.00	0	0	0	0				
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	788	542	1832	397				
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	39	20	597	722				
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	55	28	846	1023				
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	56	0	857	1266				
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	96	0	1470	2171				
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0				
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0				
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	0	0	0	0				
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0				
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0				
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0				
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0				
	W	Basement Wall, R-10	0.088	s	1.17	0.00	0	0	0	0				
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	463	363	1226	266				
	G	Double Pane, Low-E,	0.290	s	15.31	6.34	80	160	1225	507				
	G	Double Pane, Low-E,	0.290	s	15.31	8.95	20	9	306	179				
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0				
	W	Frame Wall 2 x 6, R-	0.064	sw	3.38	0.73	37	9	31	7				
	G	Double Pane, Low-E,	0.290	sw	15.31	18.35	28	0	425	509				
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0				
	W	Basement Wall, R-10	0.088	w	1.17	0.00	0	0	0	0				
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	752	329	1111	241				
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	66	36	1011	1199				
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	60	33	919	1090				
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	99	0	1516	2239				
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	198	0	3032	4477				
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0				
	G	Double Pane, Low-E,	0.290	w	15.31	19.76	0	0	0	0				
	G	Double Pane, Low-E,	0.290	w	15.31	21.94	0	0	0	0				
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0				
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0				
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0				
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0				
	G	Double Pane, Low-E,	0.290	w	15.31	15.96	0	0	0	0				
	W	Frame Wall 2 x 6, R-	0.064	nw	3.38	0.73	37	10	34	7				
	G	Double Pane, Low-E,	0.290	nw	15.31	15.71	27	0	413	424				
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0				
	P	Basement Wall, R-10	0.088	-	4.64	0.03	0	0	0	0				
	P	Frame Wall 2 x 6, R-	0.064	-	3.38	0.20	0	0	0	0				
	D	Metal Insulated Door	0.088	n	4.65	1.81	0	0	0	0				
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	3072	3072	5734	1388				

6	c) AED excursion					8494	
	Envelope loss/gain				26372	27433	
12	a) Infiltration				8674	702	
	b) Room ventilation				0	0	
13	Internal gains:	Occupants @ 230	0			0	
		Appliances/other				1400	
	Subtotal (lines 6 to 13)				35047	29535	
	Less external load				0	0	
	Less transfer				0	0	
	Redistribution				0	0	
14	Subtotal				35047	29535	
15	Duct loads		0%	0%	0	0	
	Total room load				35047	29535	
	Air required (cfm)				1123	1464	

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
ZONE 2A
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

		ZONE 2A	LESLIE CLOS
1	Room name	ZONE 2A	LESLIE CLOS
2	Exposed wall	236.0 ft	14.0 ft
3	Room height	10.8 ft	9.2 ft heat/cool
4	Room dimensions		15.0 x 9.0 ft
5	Room area	1734.8 ft²	135.0 ft²

	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	1.17	0.00	456	456	532	0	0	0	0	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	385	343	1159	251	82	70	238	52
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	15.31	6.34	12	0	184	76	12	0	184	76
	G	Double Pane, Low-E,	0.290	n	15.31	6.34	30	0	459	190	0	0	0	0
	W	Basement Wall, R-10	0.088	e	-0.95	0.00	252	156	-149	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	28.00	95	54	1460	2670	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	220	166	561	122	46	46	155	34
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	54	30	827	1089	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	s	1.17	0.00	18	18	20	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	50	50	170	37	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	w	1.17	0.00	176	176	205	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	261	112	378	82	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	19.76	50	30	758	978	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	21.94	40	13	612	878	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	15.96	60	20	919	958	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	nw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	P	Basement Wall, R-10	0.088	-	4.64	0.03	117	117	542	4	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	3.38	0.20	573	549	1856	107	0	0	0	0
	D	Metal Insulated Door	0.088	n	4.65	1.81	24	24	112	43	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	974	974	1818	440	135	135	252	61
6	c) AED excursion									2263				-3
	Envelope loss/gain								13231	10218			829	219
12	a) Infiltration								3131	254			438	35
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	0			0
		Appliances/other								300				0
	Subtotal (lines 6 to 13)								16362	10771			1267	255
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								0	0			20	4
14	Subtotal								16362	10771			1287	259
15	Duct loads						0%	0%	74	50	-0%	0%	0	0
	Total room load								16436	10821			1287	259
	Air required (cfm)								526	536			41	13

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
ZONE 2A
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

		P BATH	P HALL
1	Room name	P BATH	P HALL
2	Exposed wall	27.5 ft	0 ft
3	Room height	9.2 ft heat/cool	9.2 ft heat/cool
4	Room dimensions	1.0 x 162.0 ft	3.5 x 14.0 ft
5	Room area	162.0 ft²	49.0 ft²

	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	1.17	0.00	0	0	0	0	0	0	0	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	55	55	186	40	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	e	-0.95	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	28.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	160	106	360	78	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	54	15	827	1089	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	s	1.17	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	37	37	124	27	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	w	1.17	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	19.76	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	21.94	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	15.96	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	nw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	P	Basement Wall, R-10	0.088	-	4.64	0.03	0	0	0	0	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	3.38	0.20	0	0	0	0	0	0	0	0
	D	Metal Insulated Door	0.088	n	4.65	1.81	0	0	0	0	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	158	158	295	71	37	37	69	17
6	c) AED excursion									154				-3
	Envelope loss/gain								1825	1459			69	14
12	a) Infiltration								861	70			0	0
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	0			0
		Appliances/other								0				0
	Subtotal (lines 6 to 13)								2686	1529			69	14
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								8	2			-69	-14
14	Subtotal								2694	1531			0	0
15	Duct loads						-0%	0%	0	0	-0%	0%	0	0
	Total room load								2694	1531			0	0
	Air required (cfm)								86	76			0	0

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
ZONE 2A
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

		PTLT	PRIMARYBED
1	Room name	PTLT	PRIMARYBED
2	Exposed wall	7.5 ft	37.5 ft
3	Room height	9.2 ft heat/cool	11.9 ft heat/cool
4	Room dimensions	1.0 x 47.0 ft	15.0 x 21.0 ft
5	Room area	47.0 ft²	315.0 ft²

	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	1.17	0.00	0	0	0	0	0	0	0	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	55	55	186	40	192	162	549	119
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	30	0	459	190
	W	Basement Wall, R-10	0.088	e	-0.95	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	28.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	14	14	46	10	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	s	1.17	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	0	0	0	0	14	14	46	10
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	w	1.17	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	0	0	0	0	138	38	127	27
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	19.76	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	21.94	0	0	0	0	40	7	612	878
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	15.96	0	0	0	0	60	10	919	958
	W	Frame Wall 2 x 6, R-	0.064	nw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	P	Basement Wall, R-10	0.088	-	4.64	0.03	0	0	0	0	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	3.38	0.20	0	0	0	0	0	0	0	0
	D	Metal Insulated Door	0.088	n	4.65	1.81	0	0	0	0	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	47	47	88	21	436	436	813	197
6	c) AED excursion									-16				1200
	Envelope loss/gain								320	56			3526	3579
12	a) Infiltration								235	19			1174	95
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	0			0
		Appliances/other								0				0
	Subtotal (lines 6 to 13)								555	75			4700	3674
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								0	0			11	2
14	Subtotal								555	75			4711	3676
15	Duct loads						-0%	0%	0	0	-0%	0%	0	0
	Total room load								555	75			4711	3676
	Air required (cfm)								18	4			151	182

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
ZONE 2A
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

		ROB CLOS	STUDY
1	Room name	ROB CLOS	STUDY
2	Exposed wall	0 ft	13.5 ft
3	Room height	9.2 ft heat/cool	9.2 ft heat/cool
4	Room dimensions	5.5 x 8.0 ft	13.5 x 10.5 ft
5	Room area	44.0 ft²	141.8 ft²

	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	1.17	0.00	0	0	0	0	0	0	0	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	e	-0.95	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	28.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	s	1.17	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	w	1.17	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	0	0	0	0	124	74	251	54
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	19.76	0	0	0	0	50	15	758	978
	G	Double Pane, Low-E,	0.290	w	15.31	21.94	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	15.96	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	nw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	P	Basement Wall, R-10	0.088	-	4.64	0.03	0	0	0	0	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	3.38	0.20	0	0	0	0	0	0	0	0
	D	Metal Insulated Door	0.088	n	4.65	1.81	0	0	0	0	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	40	40	75	18	109	109	203	49
6	c) AED excursion									-3				751
	Envelope loss/gain								75	15			1385	1863
12	a) Infiltration								0	0			423	34
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	0			0
		Appliances/other								0				300
	Subtotal (lines 6 to 13)								75	15			1808	2197
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								17	3			0	0
14	Subtotal								92	18			1808	2197
15	Duct loads						-0%	0%	0	0	4%	2%	73	50
	Total room load								92	18			1880	2246
	Air required (cfm)								3	1			60	111

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
ZONE 2A
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

		B BATH	B STORAGE
1	Room name	B BATH	B STORAGE
2	Exposed wall	39.0 ft	22.5 ft
3	Room height	11.7 ft heat/cool	11.7 ft heat/cool
4	Room dimensions	15.0 x 12.5 ft	5.0 x 17.5 ft
5	Room area	187.5 ft²	87.5 ft²

	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	1.17	0.00	146	146	171	0	205	205	239	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	e	-0.95	0.00	0	0	0	0	58	58	68	0
	G	Double Pane, Low-E,	0.290	e	15.31	28.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	s	1.17	0.00	18	18	20	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	w	1.17	0.00	176	176	205	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	19.76	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	21.94	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	15.96	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	nw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	P	Basement Wall, R-10	0.088	-	4.64	0.03	117	117	542	4	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	3.38	0.20	0	0	0	0	0	0	0	0
	D	Metal Insulated Door	0.088	n	4.65	1.81	0	0	0	0	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	0	0	0	0	0	0	0	0
6	c) AED excursion									-1				0
	Envelope loss/gain								1077	3			372	0
12	a) Infiltration								0	0			0	0
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	0			0
		Appliances/other								0				0
	Subtotal (lines 6 to 13)								1077	3			372	0
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								0	0			0	0
14	Subtotal								1077	3			372	0
15	Duct loads						-0%	0%	0	0	-0%	0%	0	0
	Total room load								1077	3			372	0
	Air required (cfm)								35	0			12	0

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
ZONE 2A
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

		BASEMENT	PWDR 2
1	Room name	BASEMENT	PWDR 2
2	Exposed wall	74.5 ft	0 ft
3	Room height	11.7 ft heat/cool	9.2 ft heat/cool
4	Room dimensions	1.0 x 533.0 ft	5.5 x 6.0 ft
5	Room area	533.0 ft²	33.0 ft²

	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	1.17	0.00	105	105	123	0	0	0	0	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	e	-0.95	0.00	193	98	-217	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	28.00	95	27	1460	2670	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	20.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	s	1.17	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	w	1.17	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	19.76	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	21.94	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	15.96	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	nw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	P	Basement Wall, R-10	0.088	-	4.64	0.03	0	0	0	0	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	3.38	0.20	573	549	1856	107	0	0	0	0
	D	Metal Insulated Door	0.088	n	4.65	1.81	24	24	112	43	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	0	0	0	0	12	12	23	6
6	c) AED excursion									185				-1
	Envelope loss/gain								3730	3006			23	5
12	a) Infiltration								0	0			0	0
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	0			0
		Appliances/other								0				0
	Subtotal (lines 6 to 13)								3730	3006			23	5
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								0	0			13	3
14	Subtotal								3730	3006			36	7
15	Duct loads						-0%	0%	0	0	4%	2%	1	0
	Total room load								3730	3006			38	7
	Air required (cfm)								119	149			1	0

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
ZONE 2B
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

1	Room name						ZONE 2B				2F HALL			
2	Exposed wall						277.0 ft				27.0 ft			
3	Room height						9.2 ft				9.2 ft		heat/cool	
4	Room dimensions										1.0 x	143.5 ft		
5	Room area						3071.8 ft²				143.5 ft²			
	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	463	400	1353	293	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	24	0	367	152	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	22	0	345	143	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	15.31	6.34	16	0	245	101	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	788	542	1832	397	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	39	20	597	722	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	55	28	846	1023	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	56	0	857	1266	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	96	0	1470	2171	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	463	363	1226	266	18	18	62	13
	G	Double Pane, Low-E,	0.290	s	15.31	6.34	80	160	1225	507	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	8.95	20	9	306	179	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	3.38	0.73	37	9	31	7	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	15.31	18.35	28	0	425	509	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	752	329	1111	241	229	147	497	108
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	66	36	1011	1199	22	6	337	400
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	60	33	919	1090	60	16	919	1090
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	99	0	1516	2239	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	198	0	3032	4477	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	nw	3.38	0.73	37	10	34	7	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	15.31	15.71	27	0	413	424	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	P	Basement Wall, R-10	0.088	-	0.00	0.00	0	0	0	0	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	0.00	0.00	0	0	0	0	0	0	0	0
	D	Metal Insulated Door	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	3072	3072	5734	1388	144	144	268	65
6	c) AED excursion									8494				1401
	Envelope loss/gain								26372	27433			2083	3077
12	a) Infiltration								8674	702			845	68
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	0			0
		Appliances/other								1400				0
	Subtotal (lines 6 to 13)								35047	29535			2928	3145
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								0	0			305	59
14	Subtotal								35047	29535			3233	3204
15	Duct loads						0%	0%	0	0	-0%	0%	0	0
	Total room load								35047	29535			3233	3204
	Air required (cfm)								1123	1464			104	159

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
ZONE 2B
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

		2F STAIRS 1	2F STAIRS 2
1	Room name	2F STAIRS 1	2F STAIRS 2
2	Exposed wall	4.5 ft	23.5 ft
3	Room height	9.2 ft heat/cool	9.2 ft heat/cool
4	Room dimensions	31.5 x 4.5 ft	5.0 x 22.0 ft
5	Room area	141.8 ft²	110.0 ft²

	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	Area (ft²) or perimeter (ft) N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	Area (ft²) or perimeter (ft) N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	0	0	0	0	170	154	519	113
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	16	0	245	101
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	0	0	0	0	46	46	155	34
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	41	21	72	16	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	6.34	20	20	306	127	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	8.95	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	15.31	18.35	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	nw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	15.31	15.71	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	P	Basement Wall, R-10	0.088	-	0.00	0.00	0	0	0	0	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	0.00	0.00	0	0	0	0	0	0	0	0
	D	Metal Insulated Door	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	142	142	265	64	110	110	205	50

6	c) AED excursion									110				1
	Envelope loss/gain								681	322			1124	298
12	a) Infiltration								141	11			736	60
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	0			0
		Appliances/other								0				0
	Subtotal (lines 6 to 13)								822	333			1860	358
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								-822	-333			-1860	-358
14	Subtotal								0	0			0	0
15	Duct loads						-0%	0%	0	0	-0%	0%	0	0
	Total room load								0	0			0	0
	Air required (cfm)								0	0			0	0

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
ZONE 2B
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

		BUNK ROOM	GRAHAM BATH
1	Room name	BUNK ROOM	GRAHAM BATH
2	Exposed wall	28.5 ft	12.0 ft
3	Room height	9.2 ft heat/cool	9.2 ft heat/cool
4	Room dimensions	1.0 x 174.0 ft	1.0 x 89.0 ft
5	Room area	174.0 ft²	89.0 ft²

	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	0	0	0	0	46	46	155	34
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	110	90	306	66	64	64	217	47
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	20	5	299	361	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	151	111	376	82	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	6.34	40	40	612	253	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	8.95	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	15.31	18.35	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	nw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	15.31	15.71	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	P	Basement Wall, R-10	0.088	-	0.00	0.00	0	0	0	0	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	0.00	0.00	0	0	0	0	0	0	0	0
	D	Metal Insulated Door	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	174	174	325	79	89	89	166	40
6	c) AED excursion									114				-24
	Envelope loss/gain								2058	977			538	97
12	a) Infiltration								892	72			376	30
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	0			0
		Appliances/other								0				0
	Subtotal (lines 6 to 13)								2951	1049			914	127
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								163	66			20	4
14	Subtotal								3114	1115			933	131
15	Duct loads						-0%	0%	0	0	-0%	0%	0	0
	Total room load								3114	1115			933	131
	Air required (cfm)								100	55			30	7

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
ZONE 2B
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

		GRAHAM BED	GRAHAM CLOS
1	Room name		
2	Exposed wall	20.5 ft	0 ft
3	Room height	9.2 ft heat/cool	9.2 ft heat/cool
4	Room dimensions	15.0 x 14.0 ft	8.0 x 5.5 ft
5	Room area	210.0 ft²	44.0 ft²

	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	138	42	140	30	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	96	0	1470	2171	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	50	50	170	37	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	8.95	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	15.31	18.35	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	nw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	15.31	15.71	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	P	Basement Wall, R-10	0.088	-	0.00	0.00	0	0	0	0	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	0.00	0.00	0	0	0	0	0	0	0	0
	D	Metal Insulated Door	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	210	210	392	95	44	44	82	20
6	c) AED excursion									835				-3
	Envelope loss/gain								2173	3168			82	17
12	a) Infiltration								642	52			0	0
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	0			0
		Appliances/other								0				0
	Subtotal (lines 6 to 13)								2814	3220			82	17
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								40	8			26	5
14	Subtotal								2855	3228			109	22
15	Duct loads						-0%	0%	0	0	-0%	0%	0	0
	Total room load								2855	3228			109	22
	Air required (cfm)								91	160			3	1

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
ZONE 2B
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

		GRAHAM VEST	GUEST BATH
1	Room name	GRAHAM VEST	GUEST BATH
2	Exposed wall	0 ft	0 ft
3	Room height	9.2 ft heat/cool	9.2 ft heat/cool
4	Room dimensions	10.0 x 5.5 ft	9.0 x 8.5 ft
5	Room area	55.0 ft²	76.5 ft²

	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	Area (ft²) or perimeter (ft) N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	Area (ft²) or perimeter (ft) N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	8.95	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	15.31	18.35	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	nw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	15.31	15.71	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	P	Basement Wall, R-10	0.088	-	0.00	0.00	0	0	0	0	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	0.00	0.00	0	0	0	0	0	0	0	0
	D	Metal Insulated Door	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	55	55	103	25	76	76	143	35
6	c) AED excursion									-4				-5
	Envelope loss/gain								103	21			143	29
12	a) Infiltration								0	0			0	0
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	0			0
		Appliances/other								0				0
	Subtotal (lines 6 to 13)								103	21			143	29
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								-103	-21			518	100
14	Subtotal								0	0			661	129
15	Duct loads						-0%	0%	0	0	-0%	0%	0	0
	Total room load								0	0			661	129
	Air required (cfm)								0	0			21	6

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
ZONE 2B
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

		GUEST BED	GUEST CLOS
1	Room name	GUEST BED	GUEST CLOS
2	Exposed wall	11.5 ft	5.5 ft
3	Room height	9.2 ft heat/cool	9.2 ft heat/cool
4	Room dimensions	1.0 x 202.8 ft	5.5 x 9.5 ft
5	Room area	202.8 ft²	52.2 ft²

	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	105	49	167	36	50	50	170	37
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	56	0	857	1266	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	8.95	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	15.31	18.35	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	nw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	15.31	15.71	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	P	Basement Wall, R-10	0.088	-	0.00	0.00	0	0	0	0	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	0.00	0.00	0	0	0	0	0	0	0	0
	D	Metal Insulated Door	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	203	203	378	92	52	52	98	24
6	c) AED excursion									482				-12
	Envelope loss/gain								1403	1876			268	49
12	a) Infiltration								360	29			172	14
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	0			0
		Appliances/other								0				0
	Subtotal (lines 6 to 13)								1763	1905			440	63
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								259	50			579	111
14	Subtotal								2022	1955			1019	174
15	Duct loads						-0%	0%	0	0	-0%	0%	0	0
	Total room load								2022	1955			1019	174
	Air required (cfm)								65	97			33	9

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
ZONE 2B
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

		LAUNDRY2	SHARED BATH
1	Room name	LAUNDRY2	SHARED BATH
2	Exposed wall	28.0 ft	16.0 ft
3	Room height	9.2 ft heat/cool	9.2 ft heat/cool
4	Room dimensions	9.0 x 10.0 ft	7.0 x 10.0 ft
5	Room area	90.0 ft²	70.0 ft²

	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	Area (ft²) or perimeter (ft) N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	Area (ft²) or perimeter (ft) N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	92	69	234	51	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	22	0	345	143	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	82	82	279	60	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	0	0	0	0	92	72	242	53
	G	Double Pane, Low-E,	0.290	s	15.31	6.34	0	0	0	0	20	20	306	127
	G	Double Pane, Low-E,	0.290	s	15.31	8.95	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	15.31	18.35	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	82	38	130	28	55	55	186	40
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	44	12	674	799	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	nw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	15.31	15.71	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	P	Basement Wall, R-10	0.088	-	0.00	0.00	0	0	0	0	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	0.00	0.00	0	0	0	0	0	0	0	0
	D	Metal Insulated Door	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	90	90	168	41	70	70	131	32
6	c) AED excursion									693				96
	Envelope loss/gain								1829	1815			964	363
12	a) Infiltration								877	71			501	41
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	0			0
		Appliances/other								500				0
	Subtotal (lines 6 to 13)								2706	2386			1465	403
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								213	41			95	39
14	Subtotal								2919	2427			1560	442
15	Duct loads						-0%	0%	0	0	-0%	0%	0	0
	Total room load								2919	2427			1560	442
	Air required (cfm)								93	120			50	22

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
ZONE 2B
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

		UTIL	VIEW RM
1	Room name	UTIL	VIEW RM
2	Exposed wall	0 ft	79.0 ft
3	Room height	9.2 ft heat/cool	9.2 ft heat/cool
4	Room dimensions	1.0 x 57.5 ft	1.0 x 1133.0 ft
5	Room area	57.5 ft²	1133.0 ft²

	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	Area N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	Area N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	0	0	0	0	156	132	445	97
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	24	0	367	152
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	0	0	0	0	110	90	304	66
	G	Double Pane, Low-E,	0.290	s	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	8.95	0	0	0	0	20	4	306	179
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	3.38	0.73	0	0	0	0	37	9	31	7
	G	Double Pane, Low-E,	0.290	sw	15.31	18.35	0	0	0	0	28	0	425	509
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	0	0	0	0	385	88	297	64
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	0	0	0	0	99	0	1516	2239
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	0	0	0	0	198	0	3032	4477
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	nw	3.38	0.73	0	0	0	0	37	10	34	7
	G	Double Pane, Low-E,	0.290	nw	15.31	15.71	0	0	0	0	27	0	413	424
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	P	Basement Wall, R-10	0.088	-	0.00	0.00	0	0	0	0	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	0.00	0.00	0	0	0	0	0	0	0	0
	D	Metal Insulated Door	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	58	58	107	26	1133	1133	2115	512

6	c) AED excursion									-4				4497
	Envelope loss/gain								107	22			10486	13326
12	a) Infiltration								0	0			2475	200
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	0			0
		Appliances/other								0				900
	Subtotal (lines 6 to 13)								107	22			12961	14426
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								10	2			394	152
14	Subtotal								117	24			13355	14578
15	Duct loads						-0%	0%	0	0	-0%	0%	0	0
	Total room load								117	24			13355	14578
	Air required (cfm)								4	1			428	723

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
ZONE 2B
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

		WELL BATH	WELL BED
1	Room name	WELL BATH	WELL BED
2	Exposed wall	8.5 ft	12.5 ft
3	Room height	9.2 ft heat/cool	9.2 ft heat/cool
4	Room dimensions	8.5 x 10.0 ft	12.5 x 16.5 ft
5	Room area	85.0 ft²	206.2 ft²

	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	Area (ft²) or perimeter (ft) N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	Area (ft²) or perimeter (ft) N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	78	58	197	43	115	59	200	43
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	20	5	299	361	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	0	0	0	0	55	14	846	1023
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	8.95	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	15.31	18.35	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	nw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	15.31	15.71	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	P	Basement Wall, R-10	0.088	-	0.00	0.00	0	0	0	0	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	0.00	0.00	0	0	0	0	0	0	0	0
	D	Metal Insulated Door	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	85	85	159	38	206	206	385	93

6	c) AED excursion									80				246
	Envelope loss/gain								655	522			1432	1405
12	a) Infiltration								266	22			391	32
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	0			0
		Appliances/other								0				0
	Subtotal (lines 6 to 13)								921	544			1823	1437
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								42	9			197	74
14	Subtotal								963	552			2020	1511
15	Duct loads						-0%	0%	0	0	-0%	0%	0	0
	Total room load								963	552			2020	1511
	Air required (cfm)								31	27			65	75

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Right-J® Worksheet
ZONE 2B
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

		WELL CLOS	WELL VEST
1	Room name		
2	Exposed wall	0 ft	0 ft
3	Room height	9.2 ft heat/cool	9.2 ft heat/cool
4	Room dimensions	8.0 x 5.5 ft	1.0 x 87.2 ft
5	Room area	44.0 ft²	87.2 ft²

	Ty	Construction number	U-value (Btuh/ft²-°F)	Or	HTM (Btuh/ft²) Heat	HTM (Btuh/ft²) Cool	Area (ft²) or perimeter (ft) Gross	Area (ft²) or perimeter (ft) N/P/S	Load (Btuh) Heat	Load (Btuh) Cool	Area (ft²) or perimeter (ft) Gross	Area (ft²) or perimeter (ft) N/P/S	Load (Btuh) Heat	Load (Btuh) Cool
6	W	Basement Wall, R-10	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
.	W	Frame Wall 2 x 6, R-	0.064	n	3.38	0.73	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
.	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
11	G	Double Pane, Low-E,	0.290	n	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	n	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	e	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	18.51	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	e	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	s	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	6.34	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	15.31	8.95	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	s	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	sw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	15.31	18.35	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	sw	0.00	0.00	0	0	0	0	0	0	0	0
	W	Basement Wall, R-10	0.088	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	w	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	18.16	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	15.31	22.61	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	w	0.00	0.00	0	0	0	0	0	0	0	0
	W	Frame Wall 2 x 6, R-	0.064	nw	3.38	0.73	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	15.31	15.71	0	0	0	0	0	0	0	0
	G	Double Pane, Low-E,	0.290	nw	0.00	0.00	0	0	0	0	0	0	0	0
	P	Basement Wall, R-10	0.088	-	0.00	0.00	0	0	0	0	0	0	0	0
	P	Frame Wall 2 x 6, R-	0.064	-	0.00	0.00	0	0	0	0	0	0	0	0
	D	Metal Insulated Door	0.088	n	0.00	0.00	0	0	0	0	0	0	0	0
	C	Encapsulated Tile Ro	0.386	-	1.87	0.45	44	44	82	20	87	87	163	39
6	c) AED excursion									-3				-6
	Envelope loss/gain								82	17			163	33
12	a) Infiltration								0	0			0	0
	b) Room ventilation								0	0			0	0
13	Internal gains:	Occupants @	230				0			0	0			0
		Appliances/other								0				0
	Subtotal (lines 6 to 13)								82	17			163	33
	Less external load								0	0			0	0
	Less transfer								0	0			0	0
	Redistribution								85	25			-163	-33
14	Subtotal								167	42			0	0
15	Duct loads						-0%	0%	0	0	-0%	0%	0	0
	Total room load								167	42			0	0
	Air required (cfm)								5	2			0	0

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.

Duct System Summary
AHU - 1
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

Project Information

For: Scott Residence
15 Stuyvesant Rd, Biltmore Forest, NC 28803

	Heating		Cooling	
External static pressure	0.70	in H2O	0.70	in H2O
Pressure losses	0.27	in H2O	0.27	in H2O
Available static pressure	0.43	in H2O	0.43	in H2O
Supply / return available pressure	0.242 / 0.188	in H2O	0.242 / 0.188	in H2O
Lowest friction rate	0.112	in/100ft	0.112	in/100ft
Actual air flow	1678	cfm	1678	cfm
Total effective length (TEL)		386 ft		

Supply Branch Detail Table

Name		Design (Btuh)	Htg (cfm)	Clg (cfm)	Design FR	Diam (in)	H x W (in)	Duct Matl	Actual Ln (ft)	Ftg.Eqv Ln (ft)	Trunk
BREAKFAST	h	2392	113	0	0.129	6.0	0x 0	ShMt	67.0	120.0	st24
BREAKFAST-A	h	2392	113	0	0.112	6.0	0x 0	ShMt	77.0	140.0	st24
DINING	h	775	36	0	0.224	4.0	0x 0	ShMt	23.0	85.0	st2
FOYER	h	2007	94	0	0.225	6.0	0x 0	ShMt	32.5	75.0	st2
FOYER-A	h	2007	94	0	0.220	6.0	0x 0	ShMt	35.0	75.0	st2
HALL	h	2555	120	0	0.126	6.0	0x 0	ShMt	62.0	130.0	st27
HALL-A	h	2555	120	0	0.129	6.0	0x 0	ShMt	52.0	135.0	st27
KITCHEN	h	443	21	0	0.130	4.0	0x 0	ShMt	45.5	140.0	st26
LAUNDRY 1	h	1296	61	0	0.119	6.0	0x 0	ShMt	84.0	120.0	st25
LAUNDRY 1-A	h	1296	61	0	0.114	6.0	0x 0	ShMt	76.5	135.0	st25
LIVING	h	2177	102	0	0.149	6.0	0x 0	ShMt	47.0	115.0	st31
LIVING-A	h	2177	102	0	0.158	6.0	0x 0	ShMt	38.0	115.0	st31
LIVING-B	h	2177	102	0	0.129	6.0	0x 0	ShMt	37.0	150.0	st28
LIVING-C	h	2177	102	0	0.154	6.0	0x 0	ShMt	47.0	110.0	st31
MUDROOM	h	689	32	0	0.112	4.0	0x 0	ShMt	86.0	130.0	st25
ORANGERY	h	2204	104	0	0.165	6.0	0x 0	ShMt	22.0	125.0	st32
ORANGERY-A	h	2204	104	0	0.170	6.0	0x 0	ShMt	22.5	120.0	st31
ORANGERY-B	h	2204	104	0	0.199	6.0	0x 0	ShMt	21.5	100.0	st32
PWDR 1	h	473	22	0	0.129	4.0	0x 0	ShMt	67.0	120.0	st27
SCULLERY	h	1461	69	0	0.116	6.0	0x 0	ShMt	68.5	140.0	st25

Supply Trunk Detail Table

Name	Trunk Type	Htg (cfm)	Clg (cfm)	Design FR	Veloc (fpm)	Diam (in)	H x W (in)	Duct Material	Trunk
st24	Peak AVF	225	0	0.112	540	7.7	6 x 10	ShtMetl	st26
st25	Peak AVF	223	0	0.112	669	7.7	6 x 8	ShtMetl	st26
st26	Peak AVF	469	0	0.112	675	10.1	10 x 10	ShtMetl	st28
st32	Peak AVF	207	0	0.165	622	6.9	8 x 6	ShtMetl	st3
st28	Peak AVF	834	0	0.112	858	12.6	10 x 14	ShtMetl	st31
st27	Peak AVF	263	0	0.126	630	8.0	6 x 10	ShtMetl	st28
st31	Peak AVF	1245	0	0.112	830	***14.7***	***12*** x ***18***	ShtMetl	st3
st2	Peak AVF	225	0	0.220	676	6.7	6 x 8	ShtMetl	
st3	Peak AVF	1453	0	0.112	872	***15.9***	***12*** x ***20***	ShtMetl	

Return Branch Detail Table

Name	Grille Size (in)	Htg (cfm)	Clg (cfm)	TEL (ft)	Design FR	Veloc (fpm)	Diam (in)	H x W (in)	Stud/Joist Opening (in)	Duct Matl	Trunk
rb5	0x 0	311	0	168.5	0.112	560	***8.8***	***10***x ***8***		ShMt	rt2
rb2	0x 0	1367	0	139.5	0.135	547	***14.0***	***18***x ***20***		ShMt	rt2

Return Trunk Detail Table

Name	Trunk Type	Htg (cfm)	Clg (cfm)	Design FR	Veloc (fpm)	Diam (in)	H x W (in)	Duct Material	Trunk
rt2	Peak AVF	1678	0	0.112	671	16.3	18 x 20	ShtMetl	

Bold/italic values have been manually overridden

Duct System Summary
AHU - 2
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

Project Information

For: Scott Residence
15 Stuyvesant Rd, Biltmore Forest, NC 28803

	Heating		Cooling	
External static pressure	0.80	in H2O	0.80	in H2O
Pressure losses	0.27	in H2O	0.27	in H2O
Available static pressure	0.53	in H2O	0.53	in H2O
Supply / return available pressure	0.199 / 0.331	in H2O	0.199 / 0.331	in H2O
Lowest friction rate	0.070	in/100ft	0.070	in/100ft
Actual air flow	1649	cfm	1649	cfm
Total effective length (TEL)	762	ft		

Supply Branch Detail Table

Name		Design (Btuh)	Htg (cfm)	Clg (cfm)	Design FR	Diam (in)	H x W (in)	Duct Matl	Actual Ln (ft)	Ftg.Eqv Ln (ft)	Trunk
2F HALL	h	3233	101	0	0.108	6.0	0x 0	ShMt	39.5	145.0	st4
B BATH	h	1077	34	0	0.146	4.0	0x 0	ShMt	26.0	110.0	st16
B STORAGE	h	372	12	0	0.118	4.0	0x 0	ShMt	43.5	125.0	st19
BASEMENT	h	3730	117	0	0.130	6.0	0x 0	ShMt	28.5	125.0	st16
BUNK ROOM	h	1557	49	0	0.073	4.0	0x 0	ShMt	116.5	155.0	st7
BUNK ROOM-A	h	1557	49	0	0.071	4.0	0x 0	ShMt	121.0	160.0	st7
GRAHAM BATH	h	933	29	0	0.083	4.0	0x 0	ShMt	69.0	170.0	st7
GRAHAM BED	h	2855	89	0	0.070	6.0	0x 0	ShMt	86.5	200.0	st7
GRAHAM CLOS	h	326	10	0	0.099	4.0	0x 0	ShMt	61.5	140.0	st6
GUEST BATH	h	661	21	0	0.106	4.0	0x 0	ShMt	38.0	150.0	st6
GUEST BED	h	2022	63	0	0.086	6.0	0x 0	ShMt	60.5	170.0	st7
GUEST CLOS	h	1019	32	0	0.090	4.0	0x 0	ShMt	51.5	170.0	st7
LAUNDRY 2	h	2919	91	0	0.111	6.0	0x 0	ShMt	34.0	145.0	st14
LESLIE CLOS	h	1287	40	0	0.097	4.0	0x 0	ShMt	49.5	155.0	st19A
P BATH	h	1347	42	0	0.087	4.0	0x 0	ShMt	73.0	155.0	st20
P BATH-A	h	1347	42	0	0.090	4.0	0x 0	ShMt	62.5	160.0	st20
P TLT	h	555	17	0	0.091	4.0	0x 0	ShMt	54.5	165.0	st20
PRIMARY BED	h	1570	49	0	0.126	4.0	0x 0	ShMt	42.5	115.0	st16
PRIMARY BED-A	h	1570	49	0	0.132	4.0	0x 0	ShMt	31.0	120.0	st16
PRIMARY BED-B	h	1570	49	0	0.134	4.0	0x 0	ShMt	33.5	115.0	st16
PWDR 2	h	325	10	0	0.133	4.0	0x 0	ShMt	20.0	130.0	st16
ROB CLOS	h	317	10	0	0.094	4.0	0x 0	ShMt	67.5	145.0	st20
SHARED BATH	h	1560	49	0	0.072	4.0	0x 0	ShMt	128.5	150.0	st7
STUDY	h	1879	59	0	0.133	6.0	0x 0	ShMt	20.0	130.0	st16
UTIL	h	310	10	0	0.099	4.0	0x 0	ShMt	55.5	145.0	st6
VIEW RM	h	2671	84	0	0.077	6.0	0x 0	ShMt	107.5	150.0	st4A
VIEW RM-A	h	2671	84	0	0.077	6.0	0x 0	ShMt	98.5	160.0	st4A
VIEW RM-B	h	2671	84	0	0.093	6.0	0x 0	ShMt	74.5	140.0	st4
VIEW RM-C	h	2671	84	0	0.093	6.0	0x 0	ShMt	83.5	130.0	st4
VIEW RM-D	h	2671	84	0	0.078	6.0	0x 0	ShMt	90.0	165.0	st4A
WELL BATH	h	963	30	0	0.077	4.0	0x 0	ShMt	93.0	165.0	st7
WELL BED	h	2020	63	0	0.075	6.0	0x 0	ShMt	105.0	160.0	st7
WELL CLOS	h	385	12	0	0.098	4.0	0x 0	ShMt	74.0	130.0	st6

Supply Trunk Detail Table

Name	Trunk Type	Htg (cfm)	Clg (cfm)	Design FR	Veloc (fpm)	Diam (in)	H x W (in)	Duct Material	Trunk
st7	Peak AVF	454	0	0.070	545	11.0	10 x 12	ShtMetl	st5
st16	Peak AVF	531	0	0.087	637	11.2	10 x 12	ShtMetl	st1
st20	Peak AVF	112	0	0.087	447	6.2	6 x 6	ShtMetl	st19A
st19A	Peak AVF	152	0	0.087	456	7.0	8 x 6	ShtMetl	st19
st4	Peak AVF	520	0	0.077	624	11.4	10 x 12	ShtMetl	st14
st6	Peak AVF	53	0	0.098	474	4.6	4 x 4	ShtMetl	st5
st5	Peak AVF	507	0	0.070	608	11.5	10 x 12	ShtMetl	st14
st14	Peak AVF	1118	0	0.070	732	15.4	10 x 22	ShtMetl	st1
st19	Peak AVF	164	0	0.087	491	7.2	8 x 6	ShtMetl	st16
st4A	Peak AVF	251	0	0.077	502	8.7	6 x 12	ShtMetl	st4
st1	Peak AVF	1649	0	0.070	848	***17.6***	***14*** x ***20***	ShtMetl	

Bold/italic values have been manually overridden

Return Branch Detail Table

Name	Grille Size (in)	Htg (cfm)	Clg (cfm)	TEL (ft)	Design FR	Veloc (fpm)	Diam (in)	H x W (in)	Stud/Joist Opening (in)	Duct Matl	Trunk
rb9	0x 0	531	0	320.0	0.103	531	***11.6***	***12*** x ***12***		ShMt	rt1
rb6	0x 0	146	0	435.0	0.076	420	8.0	0x 0		ShMt	rt7
rb3	0x 0	116	0	476.0	0.070	332	8.0	0x 0		ShMt	rt8
rb7	0x 0	106	0	450.5	0.073	302	8.0	0x 0		ShMt	rt7
rb8	0x 0	129	0	440.5	0.075	369	8.0	0x 0		ShMt	rt8
rb4	0x 0	621	0	457.5	0.072	532	***12.3***	***12*** x ***14***		ShMt	rt8

Return Trunk Detail Table

Name	Trunk Type	Htg (cfm)	Clg (cfm)	Design FR	Veloc (fpm)	Diam (in)	H x W (in)	Duct Material	Trunk
rt8	Peak AVF	866	0	0.070	649	***14.1***	***12*** x ***16***	ShtMetl	rt3
rt3	Peak AVF	1118	0	0.070	671	15.4	12 x 20	ShtMetl	rt1
rt7	Peak AVF	252	0	0.073	567	8.8	8 x 8	ShtMetl	rt3
rt1	Peak AVF	1649	0	0.070	660	***17.9***	***18*** x ***20***	ShtMetl	

Bold/italic values have been manually overridden

Static Pressure and Friction Rate
AHU - 1
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

Project Information

For: Scott Residence
15 Stuyvesant Rd, Biltmore Forest, NC 28803

Available Static Pressure

	Heating (in H2O)	Cooling (in H2O)
External static pressure	0.70	0.70
Pressure losses		
Coil	0	0
Heat exchanger	0.03	0.03
Supply diffusers	0.03	0.03
Return grilles	0.03	0.03
Filter	0.15	0.15
Humidifier	0	0
Balancing damper	0.03	0.03
Other device	0	0
Available static pressure	0.43	0.43

Total Effective Length

	Supply (ft)	Return (ft)
Measured length of run-out	12	18
Measured length of trunk	64	15
Equivalent length of fittings	140	135
Total length	217	168
Total effective length		386

Friction Rate

	Heating (in/100ft)		Cooling (in/100ft)	
Supply Ducts	0.112	OK	0.112	OK
Return Ducts	0.112	OK	0.112	OK

Fitting Equivalent Length Details

Supply 8E=10, 4W=35, 2E1=30, 2B0=20, 2E0=25, 1D=10, 8E=10: TotalEL=140

Return 6O=10, 6C2=30, 8AF=15, 8E=10, 6C1=10, 8E=10, 8E=10, 5A=40: TotalEL=135

Static Pressure and Friction Rate
AHU - 2
ProCalcs, LLC

Job: Scott Residence
Date: Aug 4, 2025
By: Jayvee Layug

P.O. Box 882032, Port Saint Lucie, FL 34988 Phone: 772-882-5700 Email: tom@procalcs.net Web: www.ProCalcs.Net License: CAC1815254

Project Information

For: Scott Residence
15 Stuyvesant Rd, Biltmore Forest, NC 28803

Available Static Pressure

	Heating (in H2O)	Cooling (in H2O)
External static pressure	0.80	0.80
Pressure losses		
Coil	0	0
Heat exchanger	0.03	0.03
Supply diffusers	0.03	0.03
Return grilles	0.03	0.03
Filter	0.15	0.15
Humidifier	0	0
Balancing damper	0.03	0.03
Other device	0	0
Available static pressure	0.53	0.53

Total Effective Length

	Supply (ft)	Return (ft)
Measured length of run-out	20	11
Measured length of trunk	66	220
Equivalent length of fittings	200	245
Total length	286	476
Total effective length		762

Friction Rate

	Heating (in/100ft)		Cooling (in/100ft)	
Supply Ducts	0.070	OK	0.070	OK
Return Ducts	0.070	OK	0.070	OK

Fitting Equivalent Length Details

Supply	4W=35, 8AF=15, 8AF=15, 2E5=50, 8E=10, 8E=10, 8E=10, 8E=10, 2E0=25, 1D=10, 8E=10: TotalEL=200
Return	6O=10, 8AF=15, 8E=10, 6C4=75, 6CA=10, 8E=10, 8E=10, 8E=10, 6AB=25, 8E=10, 8E=10, 5B=40, USR1=10: TotalEL=245