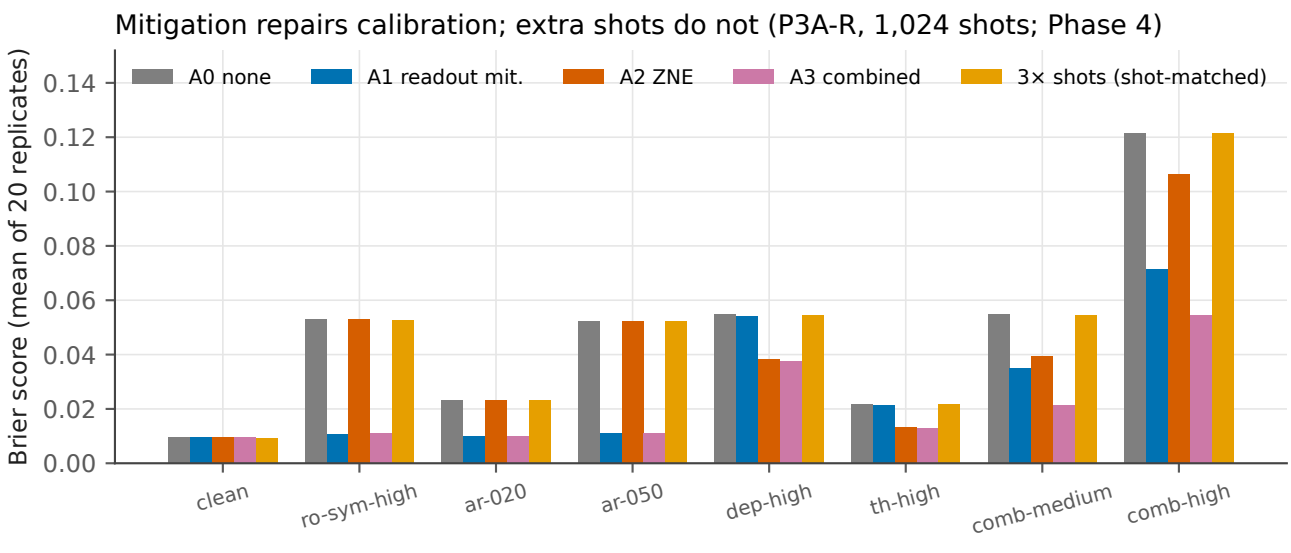
Mitigation repairs calibration; extra shots do not (P3A-R, 1,024 shots; Phase 4)
A0 none
A1 readout mit.
A2 ZNE
A3 combined
3× shots (shot-matched)
Brier score (mean of 20 replicates)
0.14
0.12
0.10
0.08
0.06
0.04
0.02
0.00
clean
ro-sym-high
ar-020
ar-050
dep-high
th-high
comb-medium
comb-high