
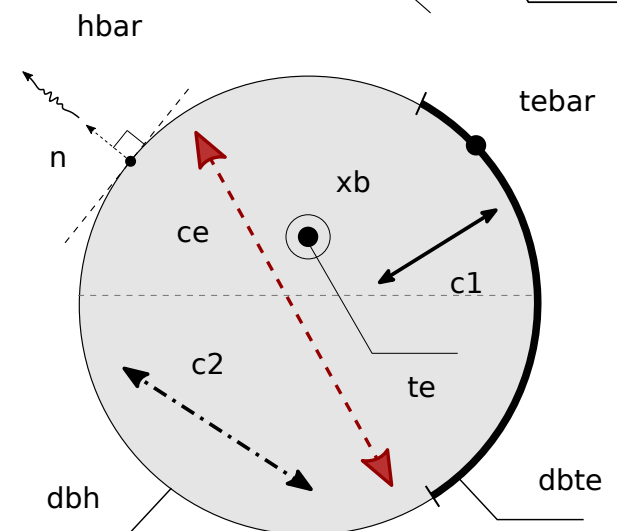
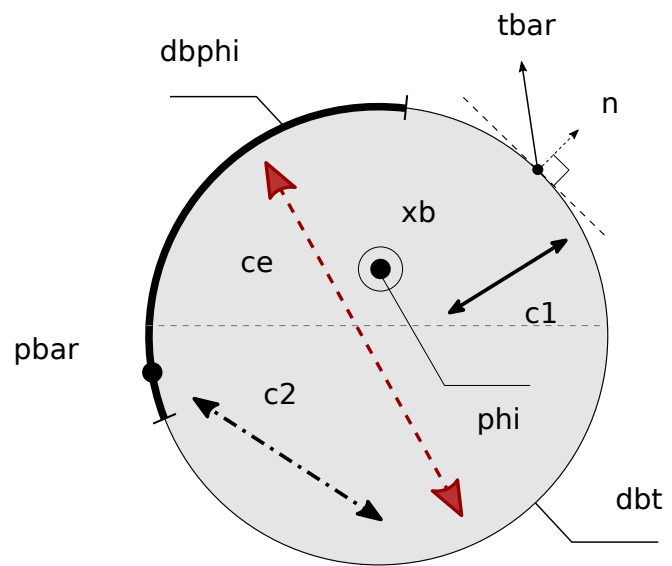
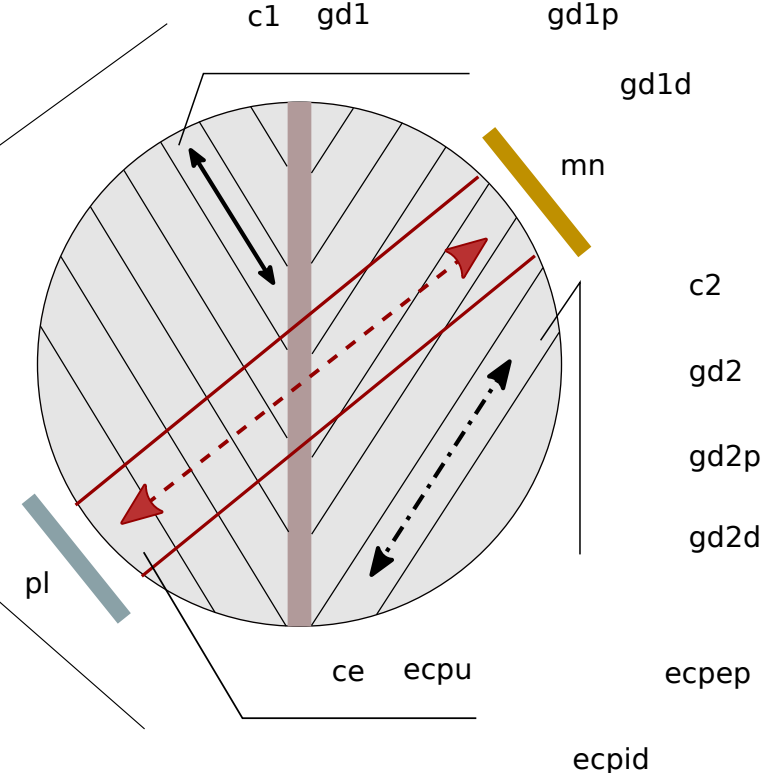
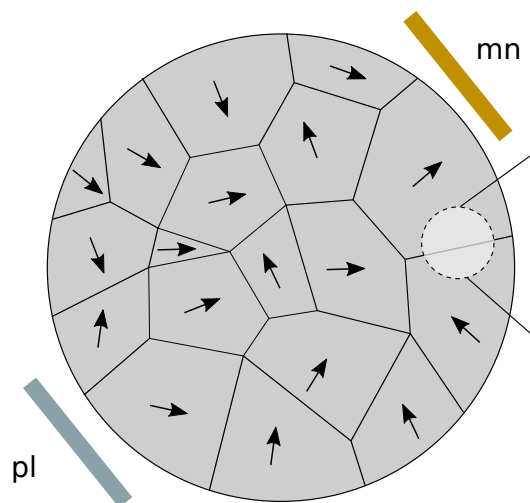


plc

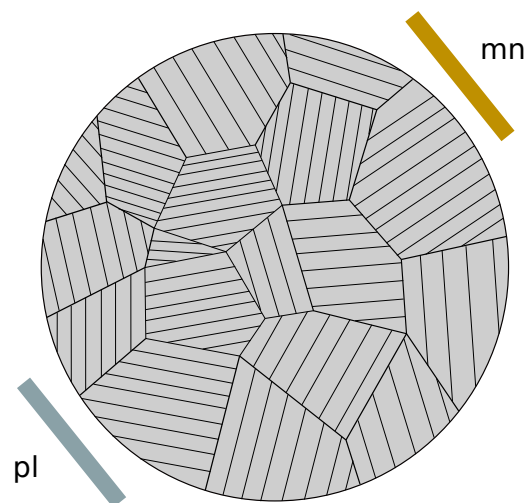

dispmu

temp