CHIND00249A 803195

3524 W PRIVATE RD 975 N BRAZIL, **IN** 47834

CLAY COUNTY, INDIANA CODE COMPLIANCE

ALL WORK SHALL BE PERFORMED AND MATERIALS INSTALLED IN ACCORDANCE WITH THE CURRENT EDITIONS OF THE FOLLOWING CODES AS ADOPTED BY THE LOCAL GOVERNING AUTHORITIES. NOTHING IN THESE PLANS IS TO BE CONSTRUED TO PERMIT WORK NOT CONFORMING TO THESE CODES:

CODE
2014 INDIANA BUILDING CODE/2012 IBC W/ STATE AMENDMENTS 2014 INDIANA MECHANICAL CODE/2012 IMC W/ STATE AMENDMENTS 2009 INDIANA ELECTRICAL CODE/2008 NEC W/ STATE AMENDMENTS MECHANICAL ELECTRICAL

SHEET INDEX	
SHEET NO.	SHEET TITLE
T-1	TITLE SHEET
A-1	OVERALL AND ENLARGED SITE PLAN
A-2	ELEVATION, ANTENNA LAYOUT AND SCHEDULE
A-3	EQUIPMENT PLATFORM AND H-FRAME DETAILS
A-4	EQUIPMENT DETAILS
A-5	EQUIPMENT DETAILS
A-6	EQUIPMENT DETAILS
E-1	ELECTRICAL/FIBER ROUTE PLAN AND NOTES
E-2	ELECTRICAL DETAILS
E-3	ELECTRICAL ONE-LINE, FAULT CALCS & PANEL SCHEDULE
G-1	GROUNDING PLANS AND NOTES
G-2	GROUNDING DETAILS
G-3	GROUNDING DETAILS
RF-1	RF CABLE COLOR CODE
RF-2	RF PLUMBING DIAGRAM
GN-1	LEGEND AND ABBREVIATIONS
GN-2	GENERAL NOTES
GN-3	GENERAL NOTES
GN-4	GENERAL NOTES

SCOPE OF WORK


THIS IS NOT AN ALL INCLUSIVE LIST. CONTRACTOR SHALL UTILIZE SPECIFIED EQUIPMENT PART OR ENGINEER APPROVED EQUIVALENT. CONTRACTOR SHALL VERIFY ALL NEEDED EQUIPMENT TO PROVIDE A FUNCTIONAL SITE. THE PROJECT GENERALLY CONSISTS OF THE FOLLOWING:

TOWER SCOPE OF WORK:

- INSTALL (3) PROPOSED PANEL ANTENNAS (1 PER SECTOR)
- INSTALL (3) PROPOSED ANTENNA MOUNTS (1 PER SECTOR) • INSTALL (6) PROPOSED RRUS (2 PER SECTOR)
- INSTALL (1) PROPOSED OVER VOLTAGE PROTECTION DEVICE (OVP)
 INSTALL (1) PROPOSED HYBRID CABLE

GROUND SCOPE OF WORK:

- INSTALL (1) PROPOSED METAL PLATFORM
- INSTALL (1) PROPOSED ICE BRIDGE
- INSTALL (1) PROPOSED PPC CABINET
- INSTALL (1) PROPOSED EQUIPMENT CABINET
- INSTALL (1) PROPOSED POWER CONDUIT
- INSTALL (1) PROPOSED TELCO CONDUIT
- INSTALL (1) PROPOSED TELCO-FIBER BOX INSTALL (1) PROPOSED GPS UNIT
- INSTALL (1) PROPOSED SAFETY SWITCH (IF REQUIRED)
- INSTALL (1) PROPOSED FIBER NID (IF REQUIRED)

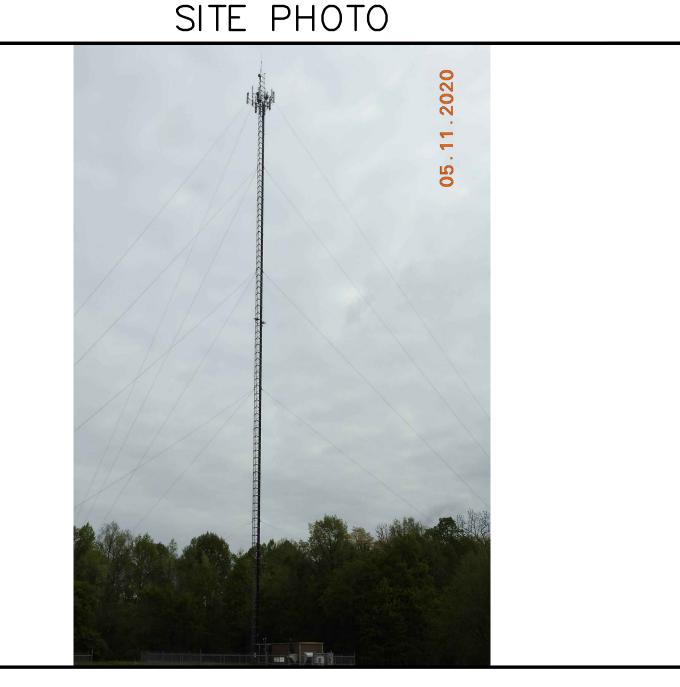



UNDERGROUND SERVICE ALERT - INDIANA 811 UTILITY NOTIFICATION CENTER OF INDIANA (800) 382-5544

WWW.IN.GOV/OUCC/2380.HTM

CALL 2 WORKING DAYS UTILITY NOTIFICATION PRIOR TO CONSTRUCTION



GENERAL NOTES

THE FACILITY IS UNMANNED AND NOT FOR HUMAN HABITATION. A TECHNICIAN WILL VISIT THE SITE AS REQUIRED FOR ROUTINE MAINTENANCE. THE PROJECT WILL NOT RESULT IN ANY SIGNIFICANT DISTURBANCE OR EFFECT ON DRAINAGE. NO SANITARY SEWER SERVICE, POTABLE WATER, OR TRASH DISPOSAL IS REQUIRED AND NO COMMERCIAL SIGNAGE IS PROPOSED.

11"x17" PLOT WILL BE HALF SCALE UNLESS OTHERWISE NOTED

CONTRACTOR SHALL VERIFY ALL PLANS, EXISTING DIMENSIONS, AND CONDITIONS ON THE JOB SITE, AND SHALL IMMEDIATELY NOTIFY THE ENGINEER IN WRITING OF ANY DISCREPANCIES BEFORE PROCEEDING WITH THE WORK.

PROJECT DIRECTORY SITE INFORMATION CROWN CASTLE TOWERS 09 LLC **APPLICANT:** PROPERTY OWNER: ADDRESS: POST OFFICE BOX 203469 C/O CROWN CASTLE INVESTMENT CORP SOLE HOUSTON TX 77216-3469 TOWER TYPE: **GUYED TOWER OWNER:** TOWER CO SITE ID: 803195 TOWER APP NUMBER: 539558 COUNTY: CLAY SITE DESIGNER: LATITUDE (NAD 83): 39° 31′ 51.89″ N 39.531081 N LONGITUDE (NAD 83): 87° 10′ 15.72" W 87.171033 W ZONING JURISDICTION: IN - CLAY COUNTY 2013 SITE ACQUISITION: ZONING DISTRICT: S1 PARCEL NUMBER: 0030064200 CONSTRUCTION MANAGER: OCCUPANCY GROUP: CONSTRUCTION TYPE: **RF ENGINEER:** POWER COMPANY: DUKE ENERGY (IN) TELEPHONE COMPANY: EVERSTREAM SOLUTIONS LLC

DIRECTIONS

DIRECTIONS FROM NEAREST TERRE HAUTE REGIONAL AIRPORT:

HEAD WEST TOWARD MAYNARD WHEELER RD, TURN LEFT ONTO MAYNARD WHEELER RD, TURN RIGHT ONTO S AIRPORT ST, TURN RIGHT ONTO IN-42 E, TURN LEFT ONTO CHAMBERLAIN ST, TURN RIGHT ONTO US-40 E, TURN LEFT ONTO N COUNTY RD 425 W, TURN RIGHT ONTO IN-340 E TURN LEFT ONTO N KENNEDYS CROSSING RD, TURN LEFT ONTO PR-975

