# Option B Layout Corrections & Floor-Plan Guide

Calbayog Cultural Convention Center · corrects the Option B plans in draft/06 against the standards in 20_RRL.md, then shows how to draw each floor plan with dimensions

**How to read this:** Part 1 gives the hall dimensions and standards every plan uses. Part 2 gives the decision rules for your six questions (seating, stage, catering, ramp, lighting, speakers). Part 3 answers them scenario by scenario and lists what to change in 06. Part 4 is the step-by-step drafting guide with four dimensioned example plans. Everything is kept to the simplest layout the standards support.

## The Five Biggest Corrections

| What 06 says now | Change to | Why |
|---|---|---|
| 1A stage at “600 or 900 mm with an accessible 1:12 ramp”. | 600 mm stage, made accessible with a platform lift beside it inside the stage recess (or accept losing roughly 20–40 seats to a switchback ramp). | A 1:12 ramp to 900 mm needs 10.8 m of run and about 13.8 m with landings; to 600 mm it needs 7.2 m with an intermediate landing. The stage sits in an 11.11 m recess, so a long ramp has to come out into the seating. BP 344 allows a ramp *or* a platform lift (RRL, Stage Ergonomics §4). |
| 3A banquet “statutory capacity ceiling of 250–300”; 500 is “illegal”. | Call 300 the **ergonomic** ceiling, not the statutory one. | The 1.40 m² dining load factor gives 490 occupants for 711 m² (aisles are part of the floor area). What limits you to 300 is the table spacing standard (1,620–1,800 mm between tables) plus room for catering inside the hall. That is still a strong, defensible number; just cite the right reason. |
| 2A full-hall training uses 24–28 collaborative pods. | Classroom rows (straight or V/chevron) facing the screen; pods only for workshop-type days. | The RRL seating table lists classroom and chevron for training and note-taking. Pods put half of each group with their backs to the screen. |
| 1C, 4A stages at 600 mm; 2B/2C/4B unspecified. | 300 mm for 1C, 2A, 4A, 4C, 4D; no stage for 2B, 2C, 4B. | The sightline check (Part 2) passes at 300 mm for these sizes, and a 300 mm ramp is short enough to fit in the recess. |
| 3A catering staged in the lobby. | Catering crew and buffets in the rear hall corners; the lobby stays for guest arrival. | The lobby is the only guest entrance; staging food there crosses waiters with arriving guests (RRL, Neufert: separate service and delegate flow). |

# Part 1 · Hall Dimensions and Standards Used

## Base dimensions (verify against your CAD before drafting)

| Item | Value used | Source / note |
|---|---|---|
| Main Hall clear width (Grid 1 → 4) | 21.1 m | Site audit: soffit 2 × 2.5 m + baffle field 16.075 m. 711 m² ÷ 32.5 m would give 21.9 m; 21.1 m is the safer clear width. |
| Main Hall length (Grid B → E) | 32.5 m | Site audit (soffit length 32.505 m). |
| Lobby depth (Grid A → B) | ≈ 5.9 m | 129 m² ÷ hall width. |
| Stage recess (Grid E → F) | 11.11 × 4.2 m | Existing dais footprint. 11.11 × 4.20 = 46.7 m², not the 52.5 m² quoted elsewhere; confirm. Assumes the concrete dais can be removed for the modular stage. |
| Grid D | ≈ 10.8 m from Grid E | Only if the three bays are equal; confirm (used for the 1C screen line). |
| Doors | Main door Grid A 2.0 m double · side sliding doors Grids 1 & 4, 2.0 m | Exact side-door positions are not in the audit file; the example plans do not place them. Keep every side door clear (Step 2). |
| Occupant load factors (NBCP Table XII.1) | plenary 0.65 m² → 1055 · dining/exhibit 1.40 → 490 · classroom 1.80 → 381 | These are code maximums for egress design. The posted venue maximum of 500 governs plenary. |

## Standards quick reference (all from 20_RRL.md)

| Item | Dimension | RRL section · source |
|---|---|---|
| Theater seat pitch / clear passage | 900 mm / 305 mm | Anthropometric A · Neufert 2012 |
| Seat width | 500 mm min, 550 mm preferred | Anthropometric A |
| Sightline C-value | 120 mm, or 60 mm with staggered seats | Anthropometric A · Neufert |
| Classroom desk height / seat clearance / aisle behind chair | 740–760 / 450–500 / 400–450 mm | Anthropometric B |
| Round table (10 pax) / footprint with chairs | Ø1,500–1,800 / 3,200–3,500 mm | Anthropometric C |
| Table-to-table clear (banquet) | 1,620–1,800 mm (2 × 450 seated + 720–900 walk) | Anthropometric C; Catering C |
| Walkways | single 750–900 · two-way 1,500–1,800 · crowd corridor 2,400 mm | Anthropometric D |
| Waiter with tray | 900–1,050 one-way · 1,500–1,800 two-way | Catering C · Panero & Zelnik |
| Buffet queue | 900 mm per person + 1,200 mm bypass | Catering C · De Chiara & Callender |
| Catering staging area | 8–15% of hall plate (57–107 m²) | Table 2-Z |
| Stage height (flat floor) | 600–1,100 mm typical | Stage E §1 · Neufert |
| Front row setback | ≥ 2.0–3.0 m and ≥ 1.5–2.0 × stage height (gaze ≤ 30°) | Stage E §1; Interface D |
| Stage depth | lectern 2.4–3.0 · panel/head table 3.6–4.5 · dance 6.0–9.0 m (3–5 m²/dancer) | Stage E §2 |
| Modular decks | 1.22 × 2.44 m; legs 300/600/900; 5.0–7.5 kN/m² | Stage E §3 |
| Ramp | 1:12 max · 1,200 clear width · 1,500 × 1,500 landings at top, bottom, every ≤ 6.0 m of run | Stage E §4 · BP 344 |

| Item | Dimension | RRL section · source |
|---|---|---|
| Wheelchair space / route / turning | 760 × 1,220 bay + companion seat beside it · 1,200 route · Ø1,500 turn | Universal Design · BP 344 |
| Door standoff | 2,000 mm clear from every door threshold | Pre-Function E · RA 9514 |
| FOH console | 600–750 deep + 900–1,200 behind; centre-rear, on axis | FOH B · Lawson; Panero & Zelnik |
| Lighting | plenary 300–500 lx 4000 K · classroom 400–500 lx · banquet 100–200 lx 2700–3000 K · exhibit 300–750 lx CRI ≥ 90 · UGR ≤ 19 | Lighting B, Table 2-Y |
| Travel distance to exit | ≤ 45 m (unsprinklered) | Phil. Standards C · RA 9514 |

### Not in your RRL yet (add a source before you cite these)

- Seats per row: a common assembly rule is no seat more than 7 seats from an aisle (blocks ≤ 14 seats between two aisles). The templates below keep blocks at 12; confirm the NBCP / RA 9514 IRR wording.
- Ramp handrails, stair riser and tread sizes, and platform-lift footprints (≈ 1.5 × 1.5 m is typical; check a product).
- Per-diner width at long communal tables (≈ 600 mm is typical).
- Stage-lighting angles and delay-speaker distances. The guide says when to add them, not how to aim them; leave that to the AV supplier.
- Product sizes for buffet tables (0.75 × 1.8–2.4 m), chairs (≈ 0.45 × 0.50 m) and display stalls (2 × 2 m).

## Part 2 · Decision Rules for the Six Questions

### 1. Which seating layout?

Pick from the RRL seating table by what the client is doing, then check it fits.

| Client mainly wants to… | Use | RRL basis |
|---|---|---|
| Watch a stage: graduations, assemblies, hearings, programs | Theater rows, straight or slight V (≤ 15°), staggered seats | Seating Styles: Theater/V-shaped; Anthropometric A |
| Take notes facing a screen: seminars, lectures | Classroom rows (straight or chevron) | Seating Styles: Classroom, Chevron |
| Work in groups but still see the front: workshops | Cabaret: Ø1,800 rounds with 6–7 seats on the far arc | Seating Styles: Cabaret; reuses banquet tables |
| Eat and socialise: galas, weddings | Banquet rounds (10 pax), grid or diamond | Seating Styles: Banquet; Anthropometric C |
| Walk and browse: exhibits, fairs | Booth or screen islands on a looped aisle | Anthropometric D |

*Using one table type (Ø1,800 rounds) for banquet, cabaret and workshops, plus one classroom table, keeps storage and setup simple.*

### 2. Does it need a stage, and how high?

A stage is needed when more than about 8 rows of people must see a standing presenter, or when there is a program (awards, performances, officials' table). Set the height with the sightline check: a row is fine when its clearance C stays ≥ 60 mm with staggered seats. On a flat floor, **C = (stage height + 1.5 − 1.15) × row pitch ÷ distance to presenter**, where 1.15 m is seated eye height and 1.5 m is the presenter's face above the stage. The table gives the farthest row that passes, measured from the stage edge:

| Row type (pitch) | 300 mm stage | 600 mm stage | 900 mm stage |
|---|---|---|---|
| Theater rows (0.9 m) | 8.8 m | 13.3 m | 17.8 m |
| Classroom rows (1.4 m) | 14.2 m | 21.2 m | 28.2 m |
| Banquet / cabaret rows (3.6 m) | 38.0 m | 56.0 m | 74.0 m |

*Beyond these distances, rely on a raised LED screen. Banquets and cabaret pass at any height in this hall, so choose their stage height for the program, not for sightlines.*

### 3. How big, and how far are the front seats?

- Default stage: **3 × 3 decks = 7.32 × 3.66 m**, centred in the recess. Depth fits a lectern or a head table (3.6–4.5 m). It leaves **1.89 m** each side for stairs and a lift or ramp.
- Lectern only, no ramp: 3 × 2 decks (7.32 × 2.44 m). With a ramp, keep 3 decks deep so the ramp's top landing (1.5 × 1.5 m) sits beside the stage.
- Dance or cultural performances: add 2–3 rows of decks forward into the hall for 6.1–7.3 m depth (≈ 45–53 m², about 9–17 dancers at 3–5 m² each).
- Front setback: 2.5 m from the stage edge to the first row or chair back. Use 2.0 m only for a 300 mm dais; use 3.2 m on the side where a ramp lands. With no stage, keep 2.0 m between the presenter's table and the first row.

### 4. Ramp, lift, or no stage?

| Stage height | 1:12 ramp needed | Fits in this hall? | Use |
|---|---|---|---|
| None | — | — | Best for workshops, small trainings, weddings (presenter on the floor). |
| 300 mm | 3.6 m run, no intermediate landing; 5.1 m with bottom landing | Yes: run it in the 1.9 m side gap of the recess; it comes ~3.1 m into the hall. | Ramp. Push that side's first row to 3.2 m. |

| Stage height | 1:12 ramp needed | Fits in this hall? | Use |
|---|---|---|---|
| 600 mm | 7.2 m run, 1 intermediate landing; 10.2 m straight | Only as a switchback ≈ 6.6 × 2.9 m in front of the stage; costs roughly 20–40 plenary seats or 1–2 banquet tables. | Platform lift in the recess side gap (no floor lost), or the switchback if you accept the loss. |
| 900 mm | 10.8 m run, 1 intermediate landing; 13.8 m straight | No. | Avoid; use 600 mm. |

*Every event open to the public needs stage access for PWD speakers or awardees (BP 344), so if there is a stage, show the ramp or lift on the plan.*

### 5. Catering

- Inside the hall, at the rear corners (Grid B side), never in the lobby when guests arrive through it. Crew enter through the side door nearest that corner (the Grid 4 doors are the usual loading doors).
- Size: 8–15% of the hall plate for full banquets (57–107 m²). Buffet line: 0.75 m table, 0.9 m server zone behind, 0.9 m queue in front, 1.2 m bypass. Planners use 2 buffet lines from about 200 guests up (interview EP5).
- Hide staging behind mobile banig screens (acoustic and smell buffer, RRL Catering C). Waiter routes: 1.5–1.8 m two-way.

### 6. Lighting and speakers

- **House lights** (the proposed dimmable DALI grid and cove) cover the RRL lux levels for every typology. Set the scene: plenary 300–500 lx 4000 K, classroom 400–500 lx, banquet 100–200 lx warm, exhibits 300–750 lx accent.
- **Add stage lights on the overhead grid** whenever people on stage are photographed or filmed (graduations, awards, performances, weddings): a front wash for faces on the batten nearest the stage, plus effects for galas. House downlights light the floor, not faces. No extra stage lights for plain seminars.
- **Speakers:** always fly the main left/right pair from the grid pick points beside the stage, never on floor stands. This frees the floor and the side aisles and spreads sound evenly (RRL Rigging; interview EP1). Add a flown delay pair at mid-hall when the rear tables or rows are much farther than the front ones; let the AV supplier decide. Floor monitors stay on the stage only.
- **FOH:** 2.4 × 1.8 m console zone plus 1.2 m behind, centre-rear just off the centre aisle; power and audio come down from ceiling drops, not across the floor.

## Part 3 · Scenario by Scenario

Each card answers your six questions and ends with what to change in 06. Capacities are checked against the standards and the hall size in Part 1.

| | **1A · Peak plenary · 250–300** |
|---|---|
| Client wants | Everyone seated facing the stage, a processional march, parents able to see and photograph. |
| Seating | Theater rows, 2 blocks × 12 seats (500 mm), 900 mm pitch, staggered; centre aisle 1.8 m (march); side aisles 3.65 m. 12 rows = 288 seats + 4 wheelchair bays with companion seats. |
| Stage | Yes, 600 mm, 3 × 3 decks. Setback 2.5 m. Last row at 12.4 m passes the 600 mm check (13.3 m). At 300 mm only ~7 rows would pass. |
| Ramp | Platform lift in the recess side gap (a switchback would cost roughly 20–40 seats). Stairs on the other side. |
| Catering | None in the hall. Snack packs: tables at a lobby end wall, 2.0 m off the doors, 1.2 m bypass. |
| Lighting | House 300–500 lx 4000 K + stage front wash on the grid (photos). |
| Speakers | Flown L/R mains; no floor stands in the side aisles (wheelchair bays are there). FOH behind the last row. |
| Fix in 06 | “600 or 900” → 600 + lift · splay 15–30° → straight or ≤ 15° · add companion seats · drop “35% faster evacuation” unless you have a source · drop “continental” (its spacing rules are not in the RRL). |

| | **1B · Mid plenary · 150–200** |
|---|---|
| Client wants | Assembly or council meeting facing officials; delegates come and go. |
| Seating | Theater rows, 2 blocks × 10 seats, centre aisle 1.5 m, side aisles ≈ 4.8 m; 10 rows = 200 (+2 bays). |
| Stage | Yes, 600 mm (300 mm fails beyond ~7 rows). Officials' table: 3 × 3 decks. |
| Ramp | Platform lift in the recess side gap (simplest). A switchback (≈ 6.6 × 2.9 m) costs seats in the front rows, as in 1A. |
| Catering | Snacks or lunch: one buffet line behind screens in the rear third (the hall is only half used). |
| Lighting | House 300–500 lx; front wash only if filmed. |
| Speakers | Flown L/R mains; no delays needed. |
| Fix in 06 | Add companion seats; add the catering zone; show the lift or ramp. |

| | **1C · Compact commencement · 80–100** |
|---|---|
| Client wants | A dignified, intimate ceremony; graduates wait somewhere cool. |
| Seating | Theater rows, 2 blocks × 7 seats, centre aisle 1.5 m; 7 rows = 98. Inside the front zone (Grid D–E). |
| Stage | Yes, **300 mm** (8 rows pass at 300 mm; limit 8.8 m). Setback 2.0 m. |
| Ramp | Straight 3.6 m ramp in the recess side gap. |
| Catering | Merienda behind the screen line, in the empty rear hall; graduates hold in the air-conditioned lobby. |
| Lighting | Only the front zone's house circuits on; stage front wash for photos. |
| Speakers | One flown pair is enough for the front zone. |
| Fix in 06 | 600 → 300 mm · leave 1.5 m openings in the screen line at both side aisles for egress · confirm Grid D · label RT60 0.95 s as modeled. |

| | 2A · Full-hall training · 160–200 |
|---|---|
| Client wants | Lectures with note-taking; occasional group tasks. |
| Seating | Classroom rows: 2 blocks × 4 tables (1.8 × 0.45 m, 3 seats each), row pitch 1.4 m (0.45 desk + 0.5 chair + 0.45 aisle), centre aisle 1.5 m, side aisles 2.60 m; 8 rows = 192. Group tasks: odd rows turn chairs to the row behind. |
| Stage | 300 mm dais, 3 × 3 decks (3 deep so the ramp's top landing sits beside it). 8 rows pass (14.2 m limit). |
| Ramp | 3.6 m ramp in the recess gap; first row at 3.2 m; leave the bottom landing sideways along the front cross-aisle. |
| Catering | AM/PM snacks and lunch for 200: 2 buffet lines behind a screen line in the rear 15 m; participants eat at desks. |
| Lighting | 400–500 lx 4000 K at desks, UGR ≤ 19; dim the screen zone. No stage lights. |
| Speakers | Flown L/R mains; laptop power from ceiling drops at row ends (not over the middle of rows). |
| Fix in 06 | Pods → classroom rows · add the dais and ramp · add the lunch zone. |

| | 2B · Mid workshop · 80–120 |
|---|---|
| Client wants | Group work with a facilitator moving around. |
| Seating | Cabaret: 17 Ø1.8 m rounds × 7 seats (≈ 119), centres 3.6 m apart; 5 across, 4 rows; every gap ≥ 1.8 m, so the facilitator can reach every table. |
| Stage | None; presenter on the floor with the screen. First tables 2.0 m from the presenter. |
| Ramp | Not needed. |
| Catering | One buffet line behind the screens in the rear half. |
| Lighting | 400–500 lx; no stage lights. |
| Speakers | One flown pair; wireless mics. |
| Fix in 06 | Define the clusters as cabaret rounds (no backs to the front) · no stage. |

| | 2C / 4B · Compact workshop + craft tables · 30–60 |
|---|---|
| Client wants | Training plus product display for 53 creatives. |
| Seating | Cabaret: 8 rounds × 7 = 56 in the front zone (2 rows of 4). |
| Stage | None. |
| Ramp | Not needed. |
| Catering | Registration and break buffet in the air-conditioned lobby, 2.0 m off both doors. |
| Lighting | 400–500 lx at tables; craft tables 300–750 lx accent, CRI ≥ 90 from the track. |
| Speakers | One small flown pair, or none. |
| Fix in 06 | 2C and 4B are the same layout: merge them, or keep 4B only as “2C + craft tables”. |

| | 3A-1 · Full gala, rounds · up to 300 |
|---|---|
| Client wants | Seated dinner with program and awards; waiters moving freely. |
| Seating | 30 Ø1.8 m rounds × 10, square grid at 3.6 m centres (1.8 m clear between tables), 5 across × 6 rows; perimeter lane 2.00 m clear of chairs. Diamond stagger is optional, not needed. |
| Stage | 600 mm, 3 × 3 decks (+ forward decks if there is a dance number). Setback 2.5 m to chair backs. |
| Ramp | Lift in the recess gap, or a switchback (costs 1–2 tables). |
| Catering | 2 buffet lines + 2 crew pockets in the rear corners ≈ 72 m² (10% of the hall, within 8–15%). Crew via the side door; waiters on 1.5–1.8 m lanes. |
| Lighting | Banquet 100–200 lx warm + stage wash and effects on the grid; replaces the centre truss. |
| Speakers | Flown L/R mains + a flown delay pair at mid-hall (rear tables ≈ 22 m away). |
| Fix in 06 | “statutory” → ergonomic ceiling (load factor gives ≈ 507) · catering out of the lobby · state the 3.6 m centre-to-centre. |

| | 3A-2 · Full gala, processional · 240–280 |
|---|---|
| Client wants | Long communal tables and a ceremonial aisle (carroza, sword arch). |
| Seating | Central aisle 2.4–3.0 m; 3 continuous table rows each side, rows 2.2–2.4 m apart centre to centre (0.6 table + 2 × 0.45 seated + 0.72–0.9 walk); rows ≈ 14 m long with a 1.2 m cross gap; ≈ 0.6 m per diner. |
| Stage | 600 mm at the end of the processional aisle. |
| Ramp | Lift, as 3A-1. |
| Catering | As 3A-1; side lanes 1.5 m are the waiter routes. |
| Lighting | As 3A-1, plus a follow or wash along the aisle for the procession. |
| Speakers | As 3A-1. |
| Fix in 06 | State the row spacing and per-diner width so 240–280 can be checked. |

| | 3B · Mid banquet · 180–220 |
|---|---|
| Client wants | Fellowship dinner with awards. |
| Seating | 20 rounds × 10, 5 across × 4 rows at 3.6 m centres. |
| Stage | 600 mm (awards) or 300 mm (no performances). |
| Ramp | Lift for 600; 3.6 m ramp for 300. |
| Catering | 2 buffet lines at the rear corners (about 200 guests). |
| Lighting | Banquet warm + stage wash. |
| Speakers | Flown mains; delay optional. |
| Fix in 06 | Give the table spacing as 3.6 m centres; add the catering zone. |

| | **3C · Wedding / milestone · 80–150** |
|---|---|
| Client wants | Intimate reception, dance floor, couple's table, photobooth. |
| Seating | 12–15 rounds × 10 in the centre; 6 × 6 m dance floor in front of the stage area; 2.0 m perimeter buffer. |
| Stage | None, or a 300 mm dais for the couple's table only (planners cover the stage for weddings: EP1, EP5). |
| Ramp | 3.6 m ramp if the dais is used. |
| Catering | One buffet line behind banig screens at a rear corner; photobooth and guestbook in the lobby. |
| Lighting | Warm 100–200 lx; stylist's decor hung from the grid; dance-floor effects. |
| Speakers | Flown mains; DJ or band booth 2.4 × 1.8 m at the dance-floor edge. |
| Fix in 06 | Say whether the stage is used; place the DJ; one buffet line. |

| | **4A · Classroom + indoor exhibit · 130–200** |
|---|---|
| Client wants | Masterclass for 132 seated plus a walk-through art and craft exhibit. |
| Seating | Front half: cabaret, 19–20 rounds × 7 ≈ 133. |
| Stage | **300 mm**, 3 × 3 decks (cabaret passes at any height; 3 deep for the ramp landing). |
| Ramp | 3.6 m ramp in the recess gap. |
| Catering | None (as observed); a coffee station at a lobby end wall if needed. |
| Lighting | Front half 400–500 lx; exhibit half 300–750 lx accent, CRI ≥ 90 (06 says 300–500: raise it). |
| Speakers | Flown mains for the front half only. |
| Fix in 06 | 600 → 300 mm · exhibit lighting to 300–750 lx · draw screen islands with a 2.4 m main loop and 1.5 m side aisles. |

| | **4C · Cookfest + judging · 100–180** |
|---|---|
| Client wants | 13 cooking stations, a judging moment everyone can see, an audience. |
| Seating | Theater rows in the centre: 2 blocks × 11, centre aisle 1.5 m, 7 rows ≈ 154. Stations along both side walls: 1.0 m cook zone + 0.75 m table, then a 2.4 m crowd aisle. |
| Stage | 300 mm dais at the front for the judging table and awards (replaces the central “elevated radial hub”). |
| Ramp | 3.6 m ramp in the recess gap. |
| Catering | Tasting is the event; dish queue to the dais with stanchions at 0.9 m per person + 1.2 m bypass. |
| Lighting | 300–750 lx, CRI ≥ 90 on the stations (true food colour). |
| Speakers | Flown mains for the emcee; nothing on the floor near the stoves. |
| Fix in 06 | Replace the central hub and tiered radial seating (needs bleachers) with a front dais and theater rows · note the BFP permit for butane indoors and drapery tied back from stoves. |

| | 4D · Banquet + lobby expo · 150–200 |
|---|---|
| Client wants | Gala dinner in the hall while municipalities exhibit in the lobby. |
| Seating | Hall: 20 rounds × 10 at 3.6 m centres. Lobby: 8 stalls of 2 × 2 m (4 on the Grid A wall, 2 on each end wall), 3.9 m aisle, 2.0 m clear around the main door. |
| Stage | 300 mm presentation dais, 3 × 3 decks. |
| Ramp | 3.6 m ramp in the recess gap. |
| Catering | 2 buffet lines + crew pockets in the rear hall corners; registration just inside the hall entrance. |
| Lighting | Hall warm + stage wash; lobby stalls 300–750 lx accent. |
| Speakers | Flown mains in the hall; none in the lobby. |
| Fix in 06 | “8–10 stalls” → 8 stalls of 2 × 2 m (3 × 3 m tents do not fit with the door standoff) · move catering from the lobby to the rear hall. |

| | Job fair · Zero-stage expo · 20–26 booths |
|---|---|
| Seating | None. 2 × 2 m booths in back-to-back islands; 2.4 m main loop, 1.5 m secondary aisles; 1.40 m² per person ≈ 507 at a time. |
| Stage / ramp | None (decks stowed). |
| Catering | Water station only; registration queue lanes in the lobby. |
| Lighting / speakers | 300–750 lx accent on booths; one flown PA for announcements. |

## Part 4 · How to Draw Each Floor Plan (Step by Step)

Draw every template on the same base plan, in this order. Each step lists the dimensions to put on the drawing.

| Step | Do this | Dimensions to show |
|---|---|---|
| 1. Base plan | Trace the hall (21.1 × 32.5 m), lobby (≈ 5.9 m deep) and stage recess (11.11 × 4.2 m) from CAD. Grid lines A, B, E, F and 1–4. Mark every door and its swing. | Overall dimensions, grid spacing, door widths. |
| 2. No-go zones | Hatch a 2.0 m clear zone in front of every door. Draw a 1.2 m minimum perimeter route to each side door. | 2.0 m standoffs; 1.2 m routes. |
| 3. Stage | Place the stage with deck lines (1.22 × 2.44 m), centred in the recess. Pick the height from the sightline table. Draw stairs on one side and the ramp (300 mm) or lift (600 mm) on the other. | Stage width × depth, height label, ramp run and landings. |
| 4. Setback line | Draw the first-row line 2.5 m from the stage edge (2.0 m for a 300 mm dais; 3.2 m beside a ramp). | Setback dimension. |
| 5. Main aisles | Centre aisle (1.5 m; 1.8 m for marches; 2.4–3.0 m processional), side aisles to the walls, and a 1.2–1.5 m cross aisle behind the last row. | Every aisle width. |
| 6. Furniture blocks | Theater: 500 mm seats, 900 mm pitch, ≤ 12 per block, staggered. Classroom: 1.8 × 0.45 m tables, 1.4 m pitch. Banquet/cabaret: Ø1.8 m rounds at 3.6 m centres. Exhibit: 2 × 2 m stalls, 2.4 / 1.5 m aisles. | Pitch, centre-to-centre spacing, seats per row, total count. |
| 7. Accessibility | Wheelchair bays 760 × 1,220 mm at row ends on an aisle, with a companion seat beside each; Ø1.5 m turning space at dead ends. | Bay size; number of bays. |
| 8. Catering | Crew pockets and buffets in the rear corners; queue 0.9 m + bypass 1.2 m; waiter lanes 1.5–1.8 m. Keep the total within 8–15% of the hall for banquets. | Buffet line depth, lanes, area in m². |
| 9. AV | FOH 2.4 × 1.8 m + 1.2 m behind, centre-rear off the centre aisle. Show flown speaker and power-drop points on the RCP, not on the floor plan. | FOH zone; RCP point legend. |
| 10. Lighting scene | Note the scene on the plan title: lux, colour temperature, and whether a stage wash is used. | Scene note. |
| 11. Check | Count seats; compare with the load factor; check the farthest seat is within 45 m of an exit; check no furniture sits in a door standoff. | A small check box in the title block. |


### Furniture blocks to make once in CAD

| Block | Size | Note |
|---|---|---|
| Theater chair | 0.50 × 0.50 m (0.55 wide preferred) | Seat width from the RRL; depth typical. |
| Classroom table | 1.80 × 0.45 m, 3 seats | Desk 740–760 mm high. |
| Round table | Ø1.80 m, 10 seats; draw a Ø2.70 m chair ring | Use the same block for cabaret (7 seats). |
| Communal table | 1.80 × 0.60 m | ≈ 0.6 m per diner along each side. |
| Stage deck | 1.22 × 2.44 m | Label height 300 / 600 / 900. |
| Wheelchair bay | 0.76 × 1.22 m + companion seat | BP 344. |
| Mobile screen | 1.20 m wide | From 06; show feet if known. |
| Buffet table | 0.75 × 1.80–2.40 m | Typical product size. |
| FOH zone | 2.40 × 1.80 m + 1.20 m clearance | Console 600–750 deep. |
| Display stall | 2.00 × 2.00 m | Lobby and job fair. |


## Worked Example Plans (schematic, to scale)

*Lobby on the left (Grid A–B), stage recess on the right (Grid E–F). Blue = seats/tables, grey = stage, teal = accessibility, yellow = catering, purple = AV, pink = stalls, red text = dimensions. Side doors are not drawn because their positions are not in the audit file; add them from CAD and keep their 2.0 m standoffs clear. Every clearance shown was checked by the script that drew these plans.*


**Template 1A — Peak plenary, ~290 seats (theater, staggered, 600 mm stage + lift)**

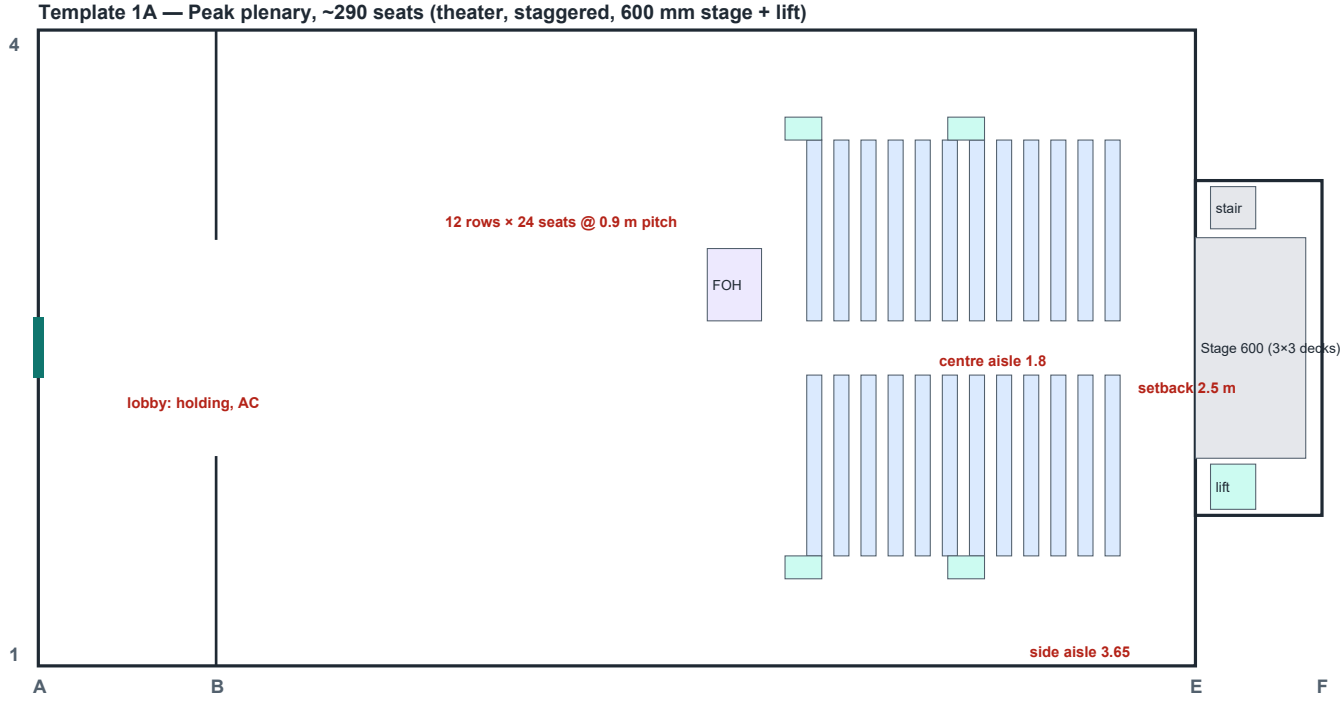



**Template 2A — Full-hall training, 192 seats (classroom rows, 300 mm dais + in-recess ramp)**

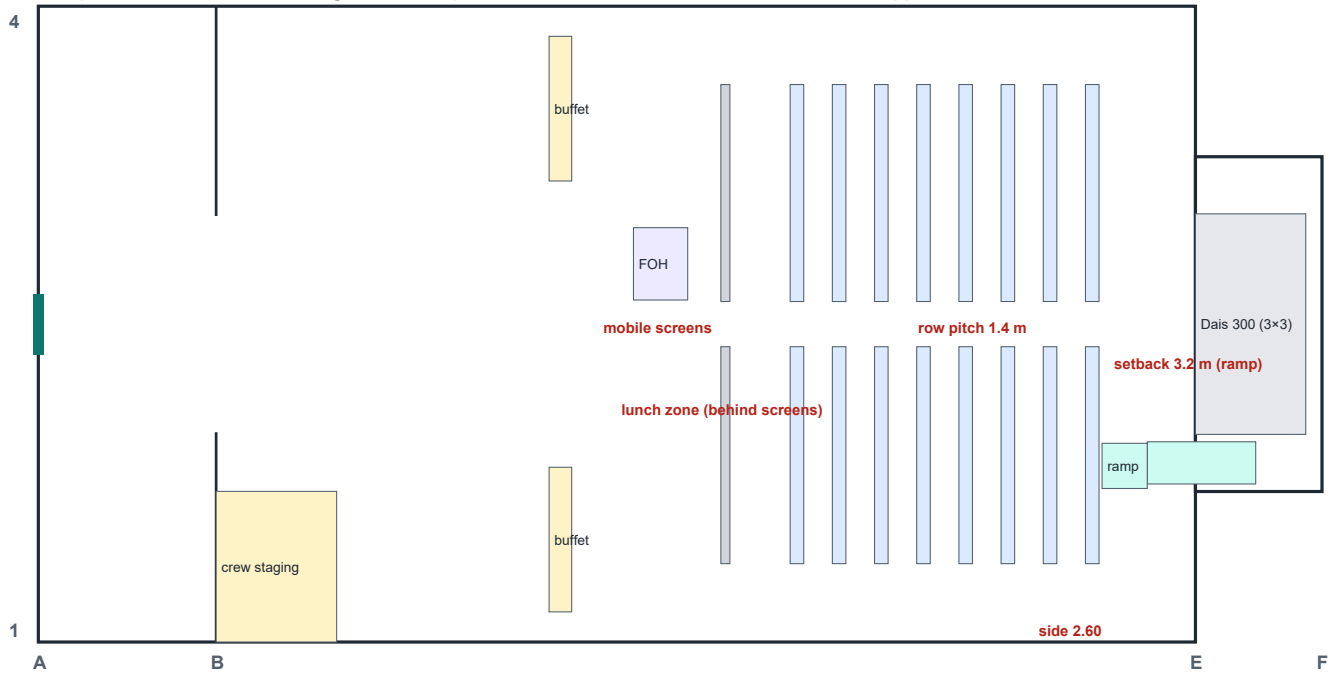

**Template 3A-1 — Full gala, 30 rounds × 10 = 300 (grid, 600 mm stage + lift)**

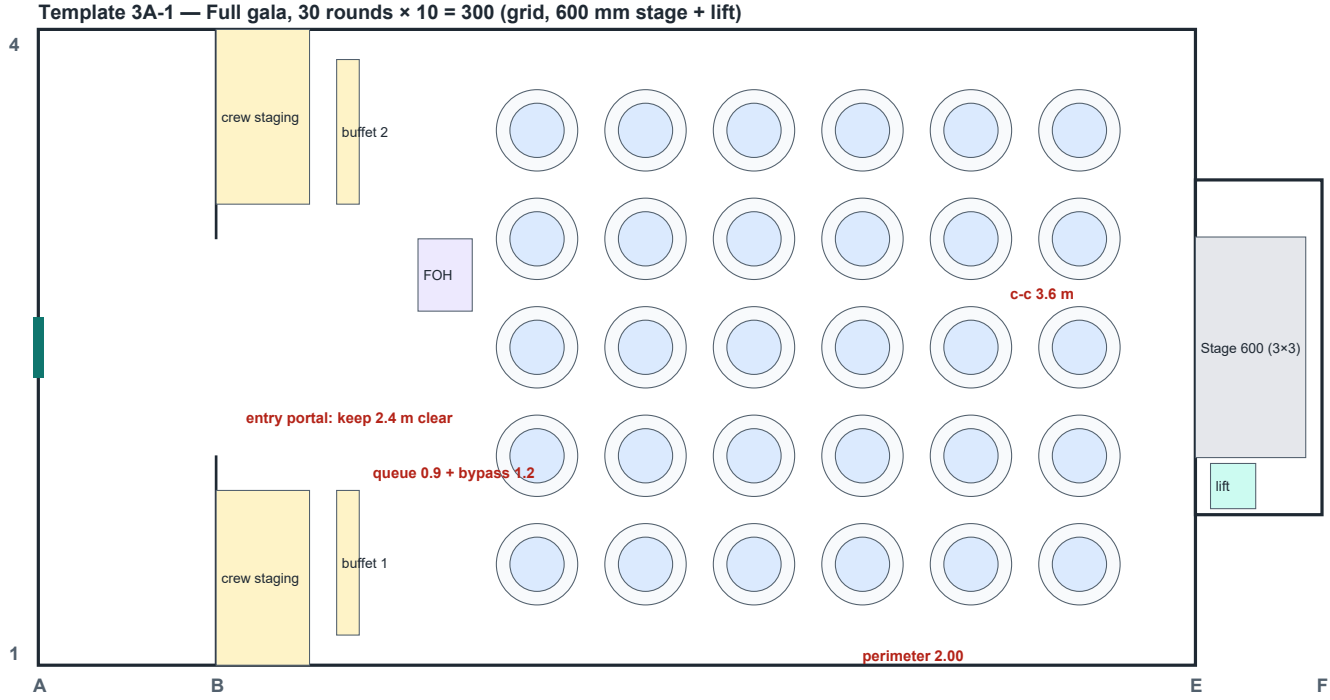


**Template 4D — Banquet 200 + lobby expo (8 stalls 2×2 m, 2.0 m door standoff)**

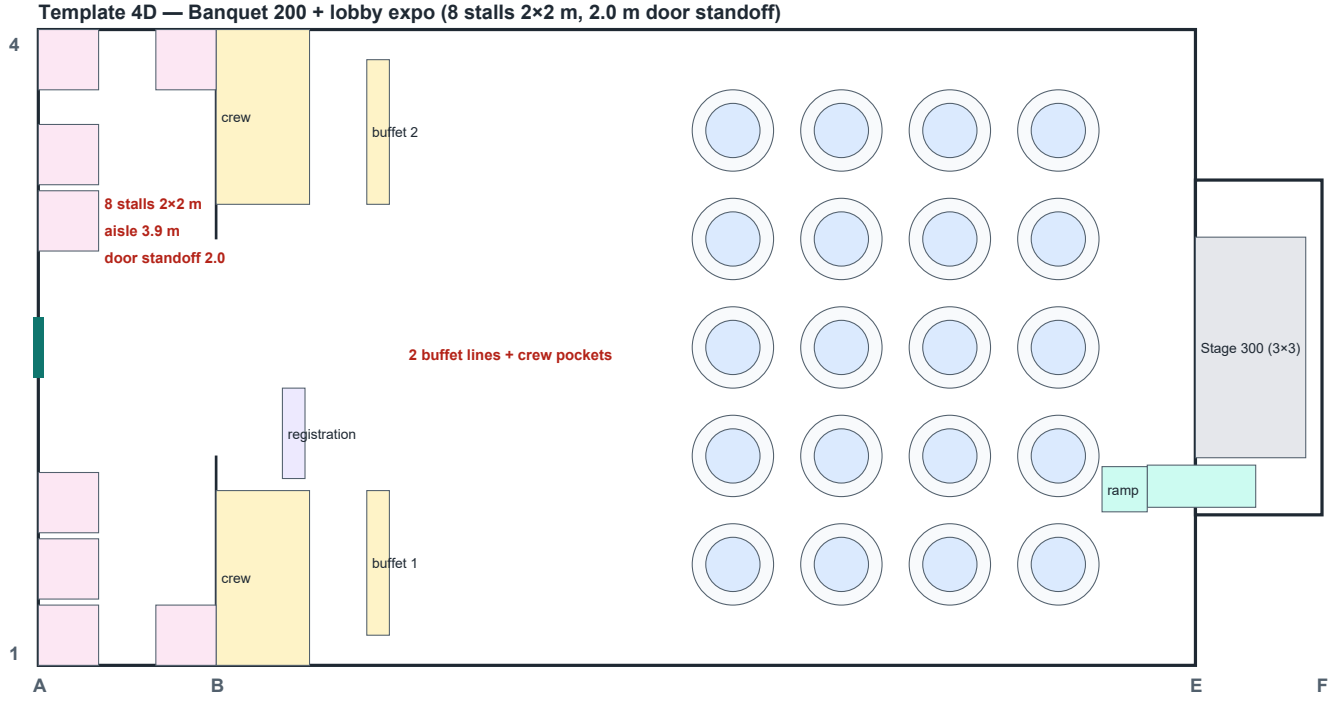


Before you finalise: confirm the hall's clear width (21.1 m vs 21.9 m), the side-door positions, the Grid D line, the stage recess size, and whether the concrete dais can be removed. If the dais must stay, the modular decks can only go in front of it, and every stage setback above moves 4.2 m into the hall.